

INCOMING	INCOMING	TRANSITION	TRANSFORMER	TRANSITION	MAIN CIRCUIT BREAKER	ACB	ACB
						ACB	ACB
						ACB	ACB
						ACB	ACB

A. REFERENCE FEEDER SCHEDULE, E011

B. CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.

C. SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.

D. UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:

- PRIMARY SWITCH STATUS (OPEN/CLOSED)
- TRANSFORMER WINDING TEMPERATURE
- TRANSFORMER FAN RUN STATUS
- BREAKER STATUS
- POWER METER DATA


E. ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. NOT USED.
4. SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.

03/11/2025

Registered Professional Engineer (Electrical)
CERTIFICATE NO
30536
WILLIAM J.
BETHURUM, IV
Date of Birth: 01/01/1961
Date of Issuance: 03/11/2025

SEAL EXPIRES: 09/30/26

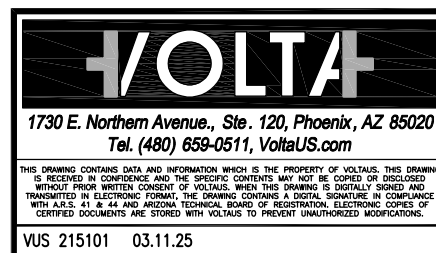

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

ELECTRICAL ONE LINE DIAGRAM

	DATE	REMARKS
	11/01/2024	IBC-074 1P FULL CD PACKAGE
	12/17/2024	F01 IBC-074 REVISIONS
	02/11/2025	F10 CD REVISIONS
	03/11/2025	F10 CD REVISIONS

PA/PM:	WB
DRAWN BY.:	ETS/AO/IA/JG
JOB NO.:	PHX21-5038-00

SHEET

1F0-E650