




1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KEY-KICK INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. ADD LUG SECTION FOR CABLE BUS CONNECTION WHEN REQUIRED BY MANUFACTURER.
4. SQUARE D / SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
5. ENGINEERED CABLE BUS ASSEMBLY, CONDUIT, OR CABLE TRAY TO BUS DUCT CABLE TAP BOX.

NOTES:				
*800A AND ABOVE BUS PLUGS REQUIRE	TOTAL LOAD (KVA)	7275	2910	TOTAL DEMAND LOAD (KVA)
MANUFACTURER INSTALLED BUS PLATE. SEE POWER				3500.1 DEMAND AMPS
PLAN FOR LOCATION				5000 RATING (A)
				70 % LOADING

2 EQUIPMENT ELEVATION

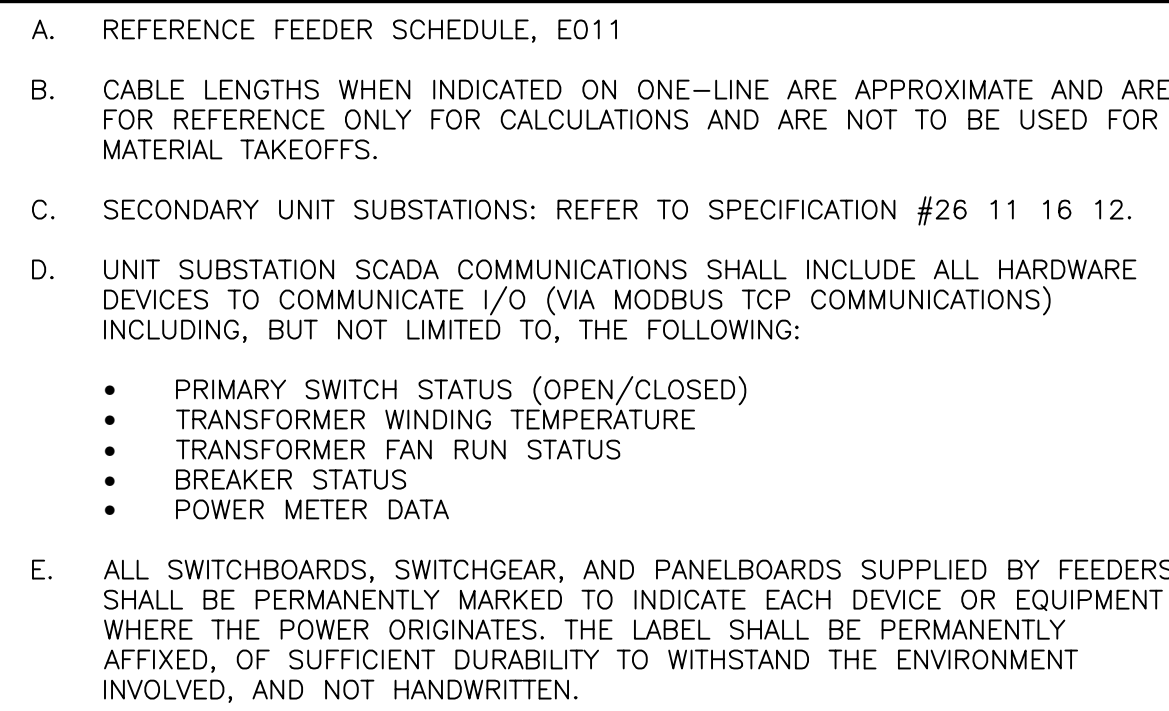

PA/PM:	WB
DRAWN BY.:	ETS/AO/IA/JG
JOB NO.:	PHX21-5038-00

1F0-E613

PLOT DATE: 06/19/2025

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF WARE MALCOMB AND SHALL NOT BE USED ON ANY OTHER WORK EXCEPT BY AGREEMENT WITH WARE MALCOMB. WRITTEN DIMENSIONS SHALL TAKE PREFERENCE OVER SCALED DIMENSIONS AND SHALL BE VERIFIED ON THE JOB SITE. ANY DISCREPANCY SHALL BE BROUGHT TO THE NOTICE OF WARE MALCOMB PRIOR TO THE COMMENCEMENT OF ANY WORK.

VOLTA

1730 E. Northern Avenue, Ste. 120, Phoenix, AZ 85020
Tel. (480) 659-0511, VoltaUS.com

This offering contains facts and information which is the property of VoltaUS. This information is furnished in confidence and the recipient is prohibited from making any disclosure of this information without the prior written consent of VoltaUS. This information is furnished for informational purposes only and is not intended to constitute an offer of securities. This information is not to be used in connection with any securities offering. This information is not to be used in connection with any securities offering. This information is not to be used in connection with any securities offering.

VUS 215101 06.19.25

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140