


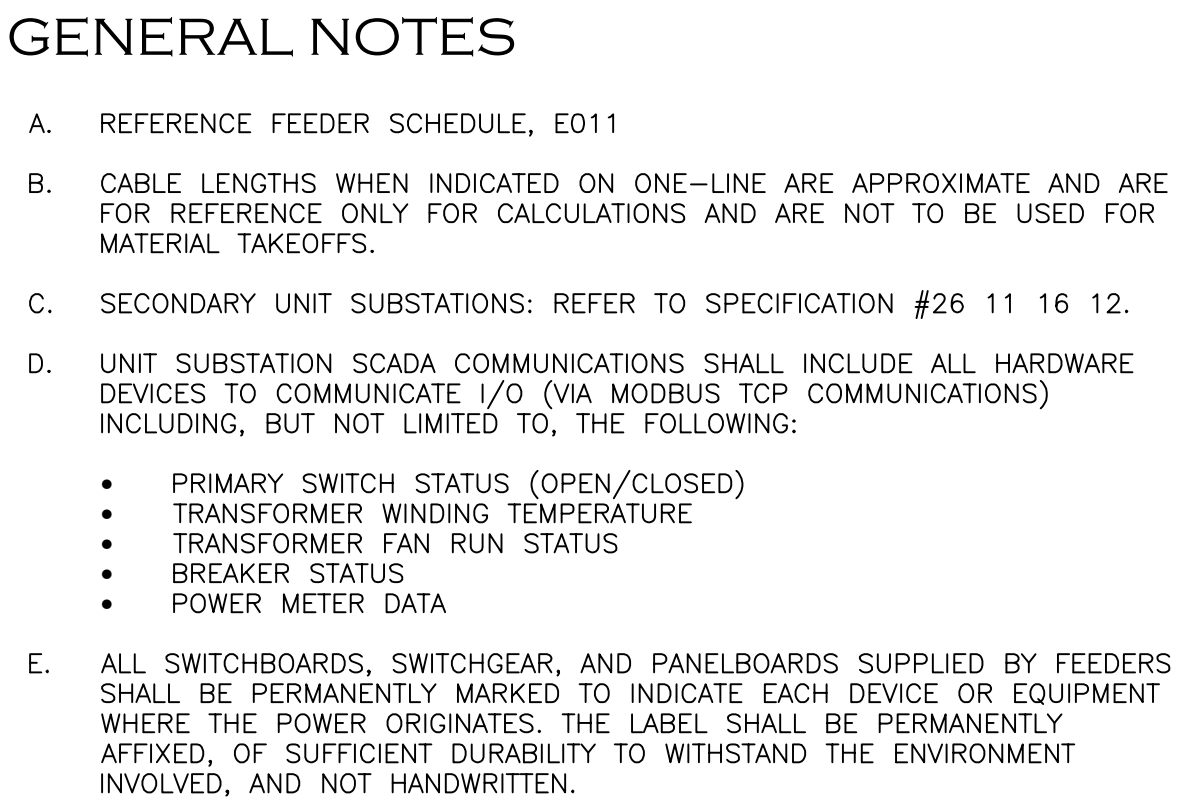

1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. NOT USED
4. SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
5. ENGINEERED CABLE BUS ASSEMBLY, CONDUIT, OR CABLE TRAY TO BUS DUCT CABLE, TAP BOX.

3 BUS DUCT LOAD SCHEDULE

1 ONE LINE DIAGRAM - (1 FO) ASSEMBLY-1 "B" (PARTIAL)
NO SCALE

2 EQUIPMENT ELEVATION

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

SHEET
1F0-E625

PLOT DATE: 08/21/2025

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF WARE MALCOMB AND SHALL NOT BE USED ON ANY OTHER WORK EXCEPT BY AGREEMENT WITH WARE MALCOMB. WRITTEN DIMENSIONS SHALL TAKE PREFFERENCE OVER SCALED DIMENSIONS AND SHALL BE VERIFIED ON THE JOB SITE. ANY DISCREPANCY SHALL BE BROUGHT TO THE NOTICE OF WARE MALCOMB PRIOR TO THE COMMENCEMENT OF ANY WORK.