


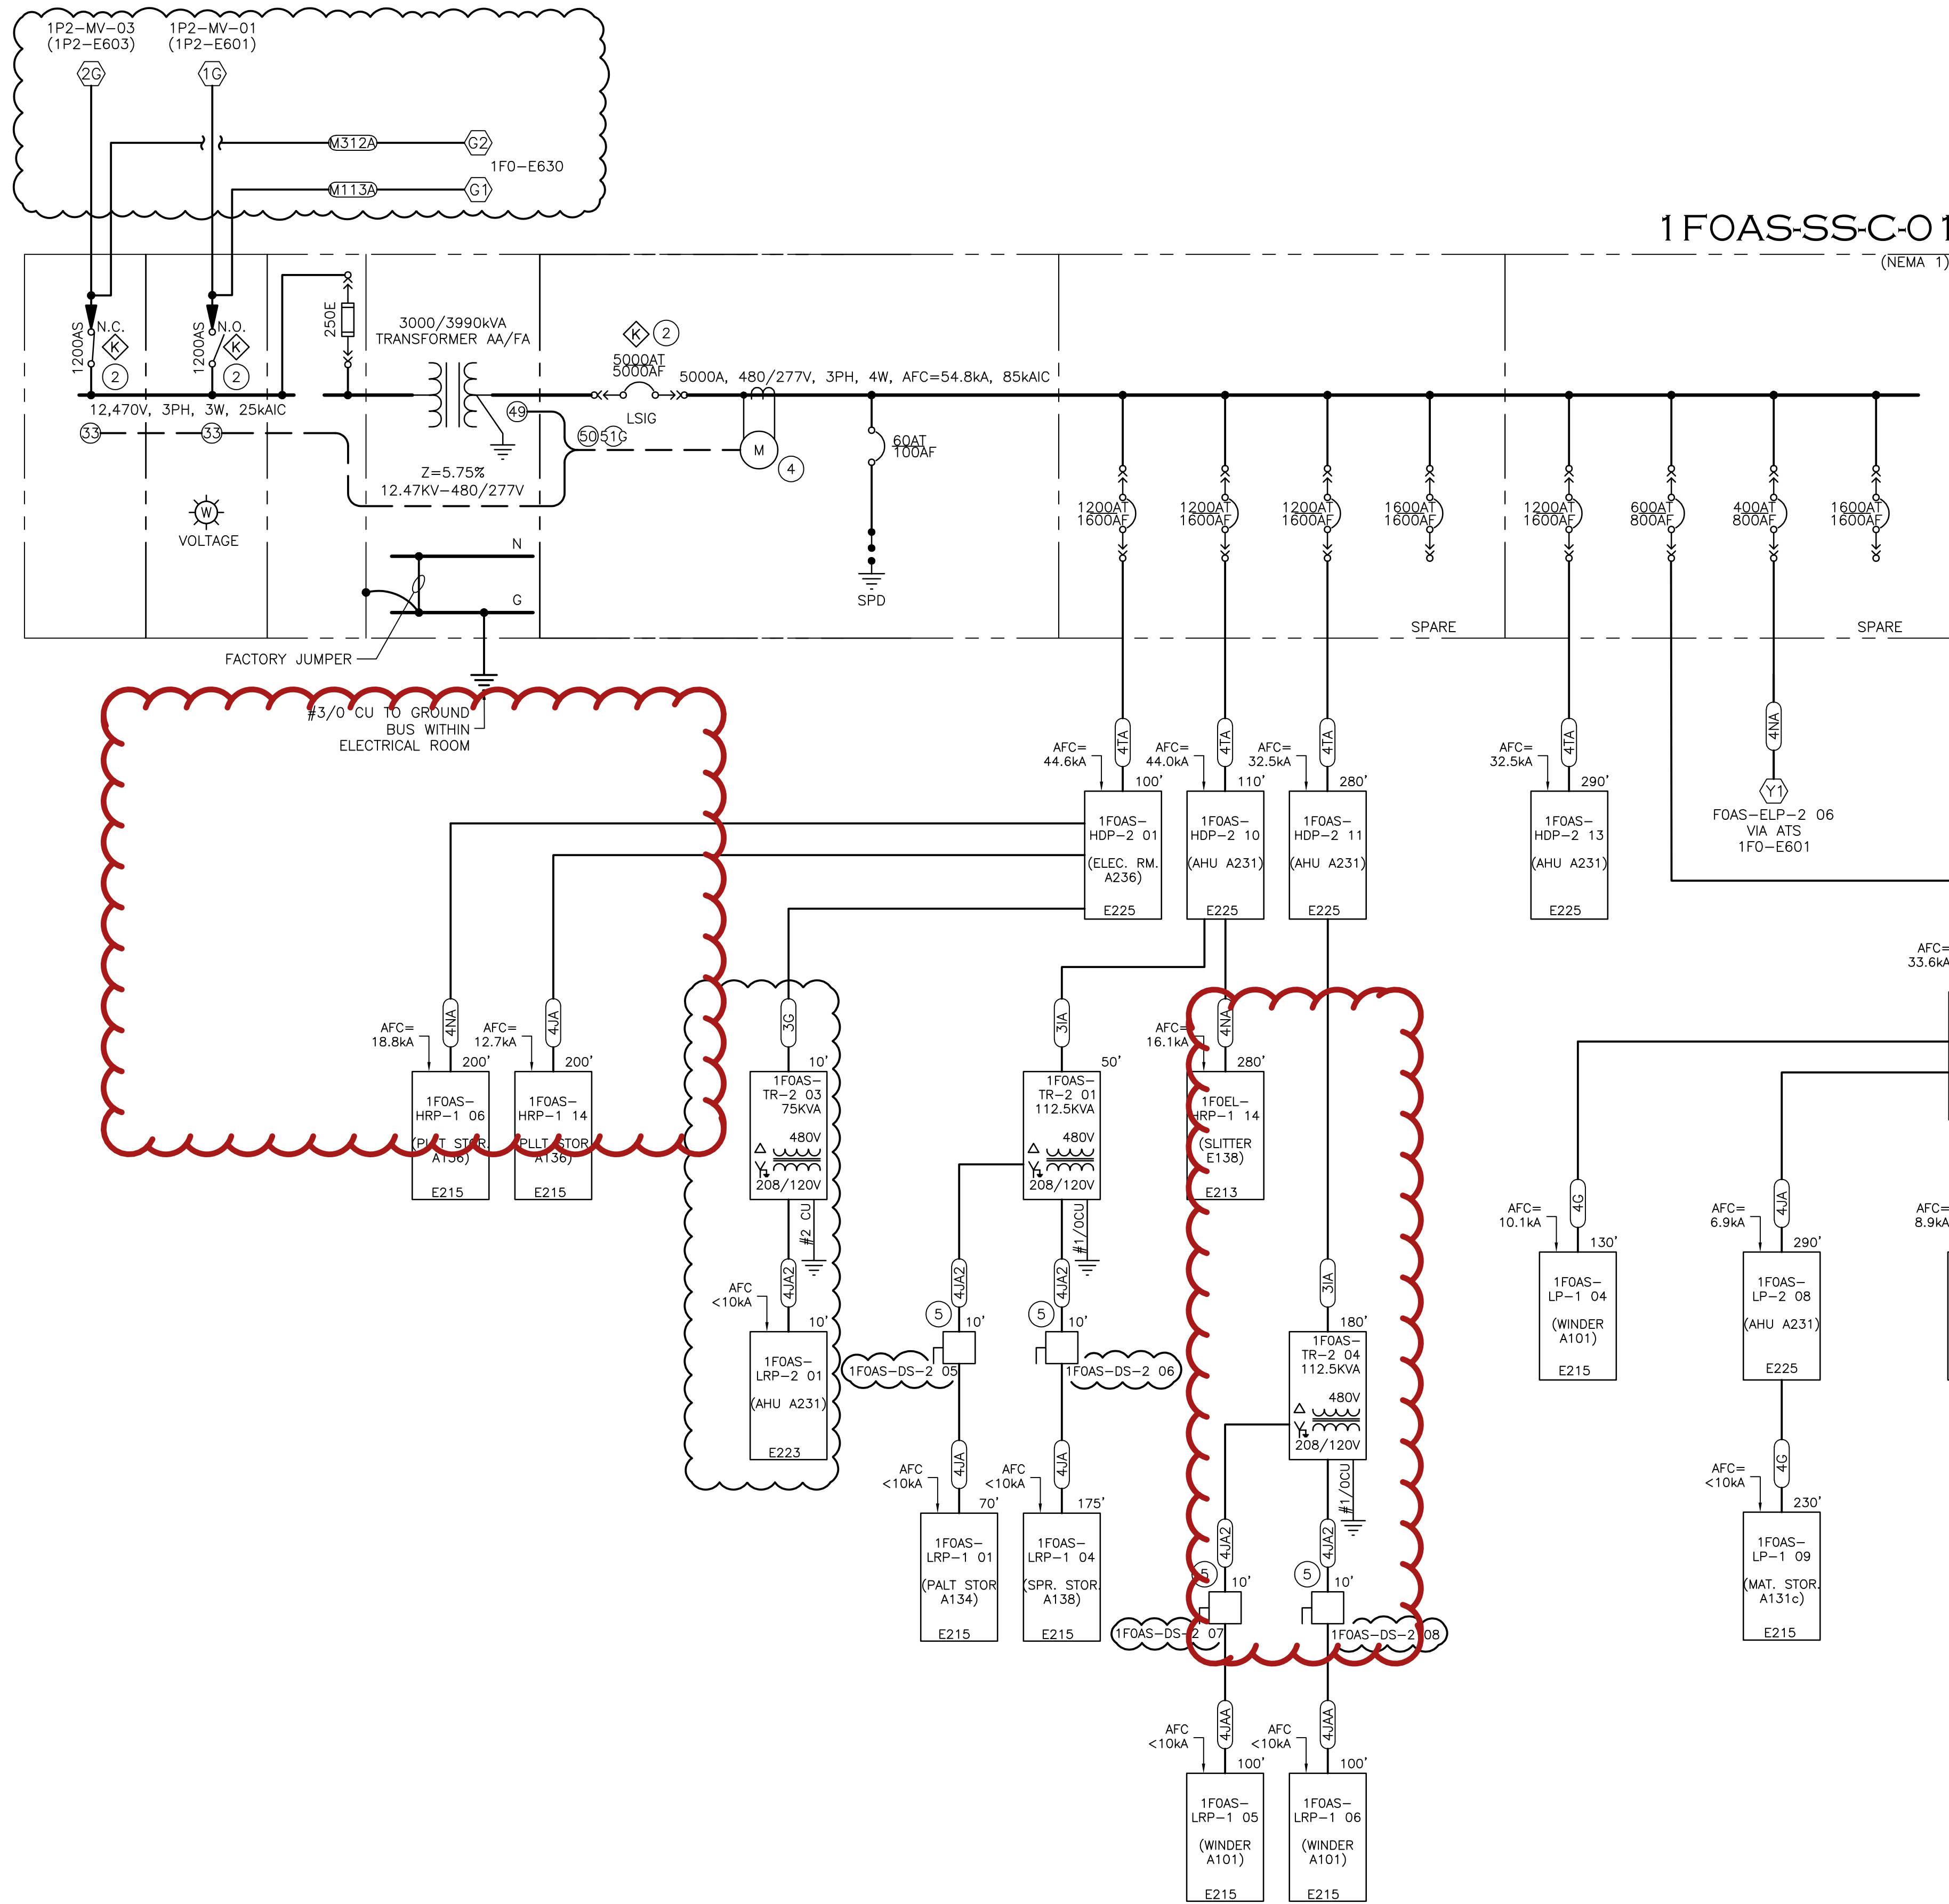

① ONE LINE DIAGRAM - (1FO) ASSEMBLY-2 "C" (PARTIAL)  
NO SCALE

|          |          |            |             |            |                            |     |     |
|----------|----------|------------|-------------|------------|----------------------------|-----|-----|
| INCOMING | INCOMING | TRANSITION | TRANSFORMER | TRANSITION | MAIN<br>CIRCUIT<br>BREAKER | ACB | ACB |
|          |          |            |             |            |                            | ACB | ACB |
|          |          |            |             |            |                            | ACB | ACB |
|          |          |            |             |            |                            | ACB | ACB |

② EQUIPMENT ELEVATION  
NO SCALE

GENERAL NOTES

- REFERENCE FEEDER SCHEDULE, E011
- CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.
- SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.
- UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:
  - PRIMARY SWITCH STATUS (OPEN/CLOSED)
  - TRANSFORMER WINDING TEMPERATURE
  - TRANSFORMER FAN RUN STATUS
  - BREAKER STATUS
  - POWER METER DATA
- ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED, OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

KEYED NOTES

- NOT USED.
- PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
- NOT USED.
- SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
- FOR TRANSFORMER TAPS OVER 10' PROVIDE AND INSTALL CIRCUIT BREAKER DISCONNECT (200A/3P/N1/10KA) WITHIN 10' OF TRANSFORMER SECONDARY.

**WARE MALCOMB**  
ARCHITECTURE CIVIL ENGINEERING  
PLANNING BUILDING INTERIORS  
2777 E Camelback Rd. Suite #205  
Phoenix, AZ 85016  
P 480.907.2288

07/11/2025  
30536  
WILLIAM J. BETHURUM, P.E.  
SEAL EXPIRES: 09/30/26

**VOLTA**  
1730 E. Northern Avenue, Ste. 100, Phoenix, AZ 85020  
Tel: (480) 688-0011 voltaaz.com  
REG 215601 03/11/25

**PROJECT ALPHA**  
1F0 - MAIN MANUFACTURING BUILDING  
EAST PECOS ROAD  
QUEEN CREEK, ARIZONA 85140

| ELECTRICAL ONE LINE DIAGRAM |                                        |
|-----------------------------|----------------------------------------|
| DATE                        | REMARKS                                |
| 06/25/2024                  | 1F0 - 2170 REVISIONS                   |
| 06/25/2024                  | PERMIT RESUBMISSION B25-140            |
| 10/19/2024                  | IDC-074 1F0 CD PROGRESS SET (MEP ONLY) |
| 11/07/2024                  | IDC-074 1F0 FULL CD PACKAGE            |
| 11/07/2024                  | 1F0 CD REVISIONS                       |
| 02/11/2025                  | 1F0 CD REVISIONS                       |
| 03/11/2025                  | 1F0 CD REVISIONS                       |

|           |               |
|-----------|---------------|
| P/APP:    | WB            |
| DRAWN BY: | ETS/AO/AUG    |
| JOB NO.:  | PHX21-5038-00 |

SHEET  
**1F0-E629**  
PLOT DATE: 03/11/2025