


G:\Shared drives\projects\22\151\215101\215101A2_1lines.dwg

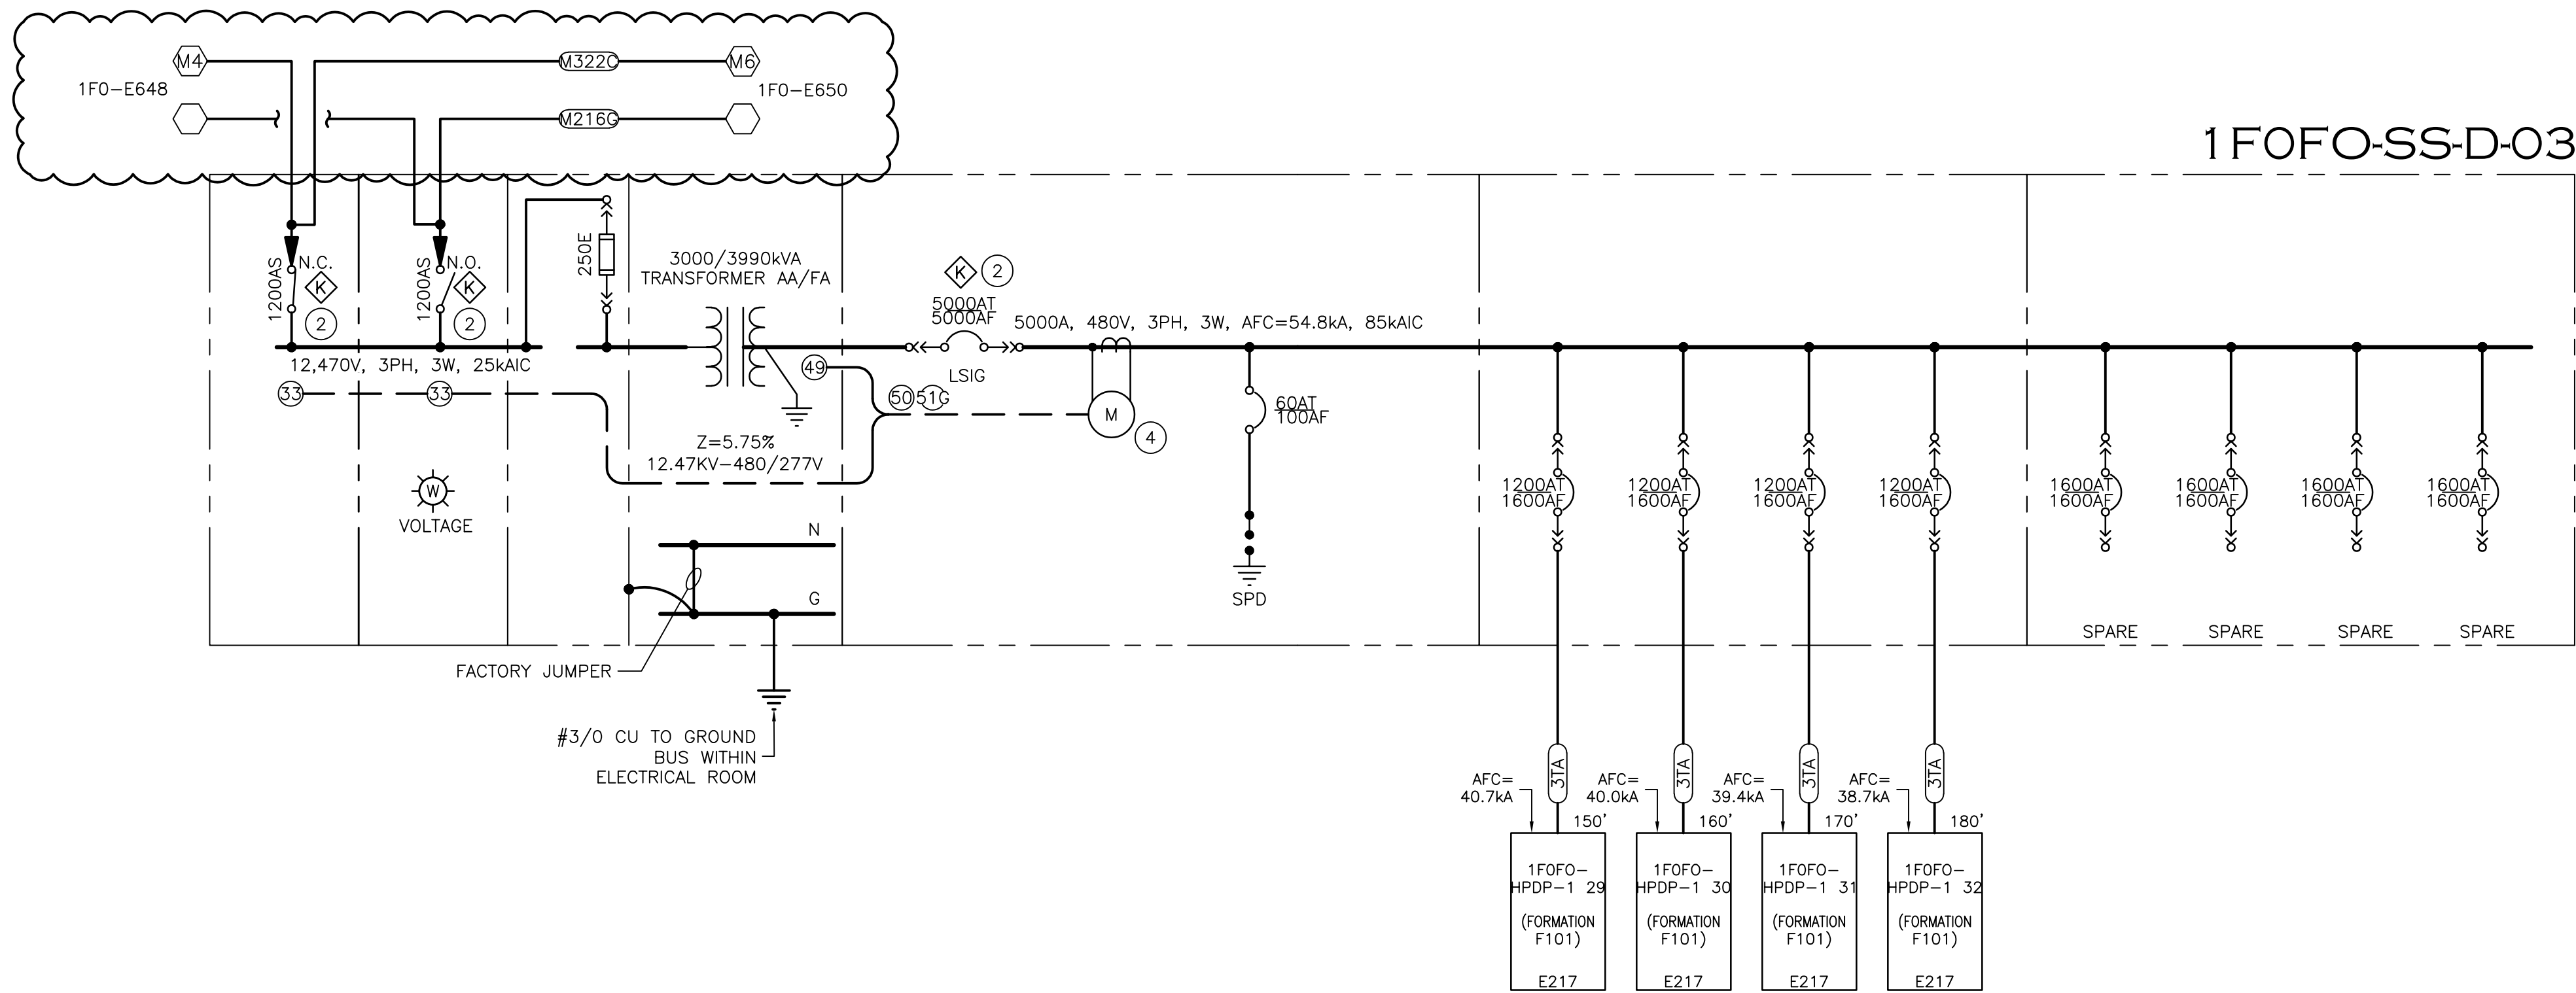

1 ONE LINE DIAGRAM - (1F0) FORMATION-2 "D" (PARTIAL)
NO SCALE

INCOMING	INCOMING	TRANSITION	TRANSFORMER	TRANSITION	MAIN CIRCUIT BREAKER	ACB	ACB
						ACB	ACB
						ACB	ACB
						ACB	ACB

2 EQUIPMENT ELEVATION
NO SCALE

GENERAL NOTES

- A. REFERENCE FEEDER SCHEDULE, E011
- B. CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.
- C. SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.
- D. UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:
- PRIMARY SWITCH STATUS (OPEN/CLOSED)
 - TRANSFORMER WINDING TEMPERATURE (NEMA 1)
 - TRANSFORMER FAN RUN STATUS
 - BREAKER STATUS
 - POWER METER DATA
- E. ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED, OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

KEYED NOTES

1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. NOT USED.
4. SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.



PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

ELECTRICAL ONE LINE DIAGRAM

DATE	REVISIONS
11/01/2024	1F0 FULL CD PACKAGE
12/17/2024	1F0 IDC-074 REVISIONS
02/11/2025	1F0 CD REVISIONS
03/11/2025	1F0 CD REVISIONS

PA/PM:	WB
DRAWN BY:	ETS/AO/IAUG
JOB NO.:	PHX21-5038-00

SHEET
1F0-E649
PLOT DATE: 03/11/2025

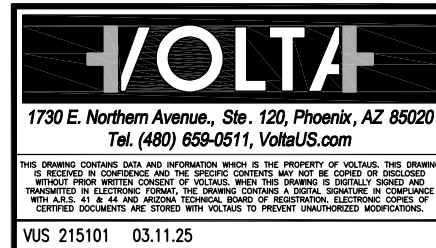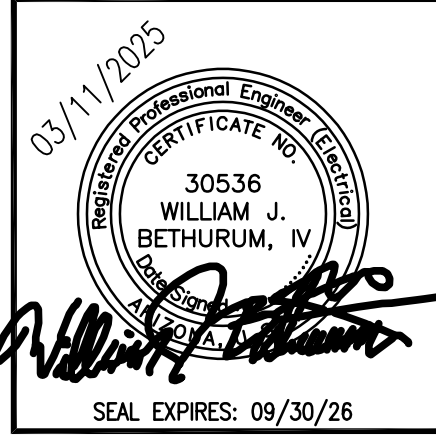

WARE MALCOMB
ARCHITECTURE
PLANNING
INTERIORS
CIVIL ENGINEERING
BRANDING
BUILDING MEASUREMENT
2777 E. Camelback Rd. Suite #205
Phoenix, AZ 85016
P 480.907.2288