


GENERAL NOTES

- A. MAINTAIN WORKING CLEARANCE ABOUT ELECTRICAL EQUIPMENT PER NEC ART. 110, (30" W MIN), DEPTH PER NEC, (36" MIN).
- B. CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.
- C. SEE SHEET 101-E600 FOR FEEDER SCHEDULE.
- D. PROVIDE 10% SPARE BUS PLUGS

KEYED NOTES ☐

- ACTIVATE SHUNT-TRIP WITH IT EQUIPMENT & 911 DISPATCH EMERGENCY SHUT-OFF DISCONNECTING MEANS PER NEC 645.10. FORM C CONTACT IN PUSHBUTTON SHALL APPLY 120VAC TO THE SHUNT-TRIP BREAKERS INDICATED.
EMERGENCY POWER OFF PUSH BUTTON STATION, RED WITH CLEAR COVER AND 'STOPPER SEAL' TO PREVENT ACCIDENTAL OPERATION, (2) FORM C CONTACTS (ONE FOR EQUIPMENT SHUNT-TRIP, ONE FOR HVAC SHUNT-TRIP).
PUSHBUTTON, STI #SS-2002 "EMERGENCY POWER OFF" COVER, STI #STI-6518 SEAL, STI #STI-6515.
- HIGH PERFORMANCE HARMONIC CANCELING TRANSFORMER, K-13 RATED WITH ELECTROSTATIC SHIELD, WITH EFFICIENCY EQUAL TO US DOE CSL-3 AND NO LOAD LOSSES LESS THAN 447W. PROVIDE INTEGRAL METERING WITH CONNECTION TO NETWORK WITH WEBSERVER CAPABILITY. PROVIDE INTEGRATED ROTATABLE IR VIEWING PORT. PROVIDE LUG KIT FOR TRANSFORMERS. POWERSMITHS INTERNATIONAL T1000-C3 SERIES OR EQUAL.

ELECTRICAL EQUIPMENT, SUCH AS SWITCHBOARDS, SWITCHGEAR, PANELBOARDS, INDUSTRIAL CONTROL PANELS, METER SOCKET ENCLOSURES IN OTHER THAN DWELLING UNITS SHALL BE FIELD OR FACTORY MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. NEC 110.16(A). IN ADDITION TO THE REQUIREMENTS OF 110.16(A), A PERMANENT LABEL SHALL BE FIELD OR FACTORY APPLIED TO SERVICE EQUIPMENT RATED 1200 AMPS OR MORE. THE LABELS SHALL MEET THE REQUIREMENTS OF NEC 110.21(B).


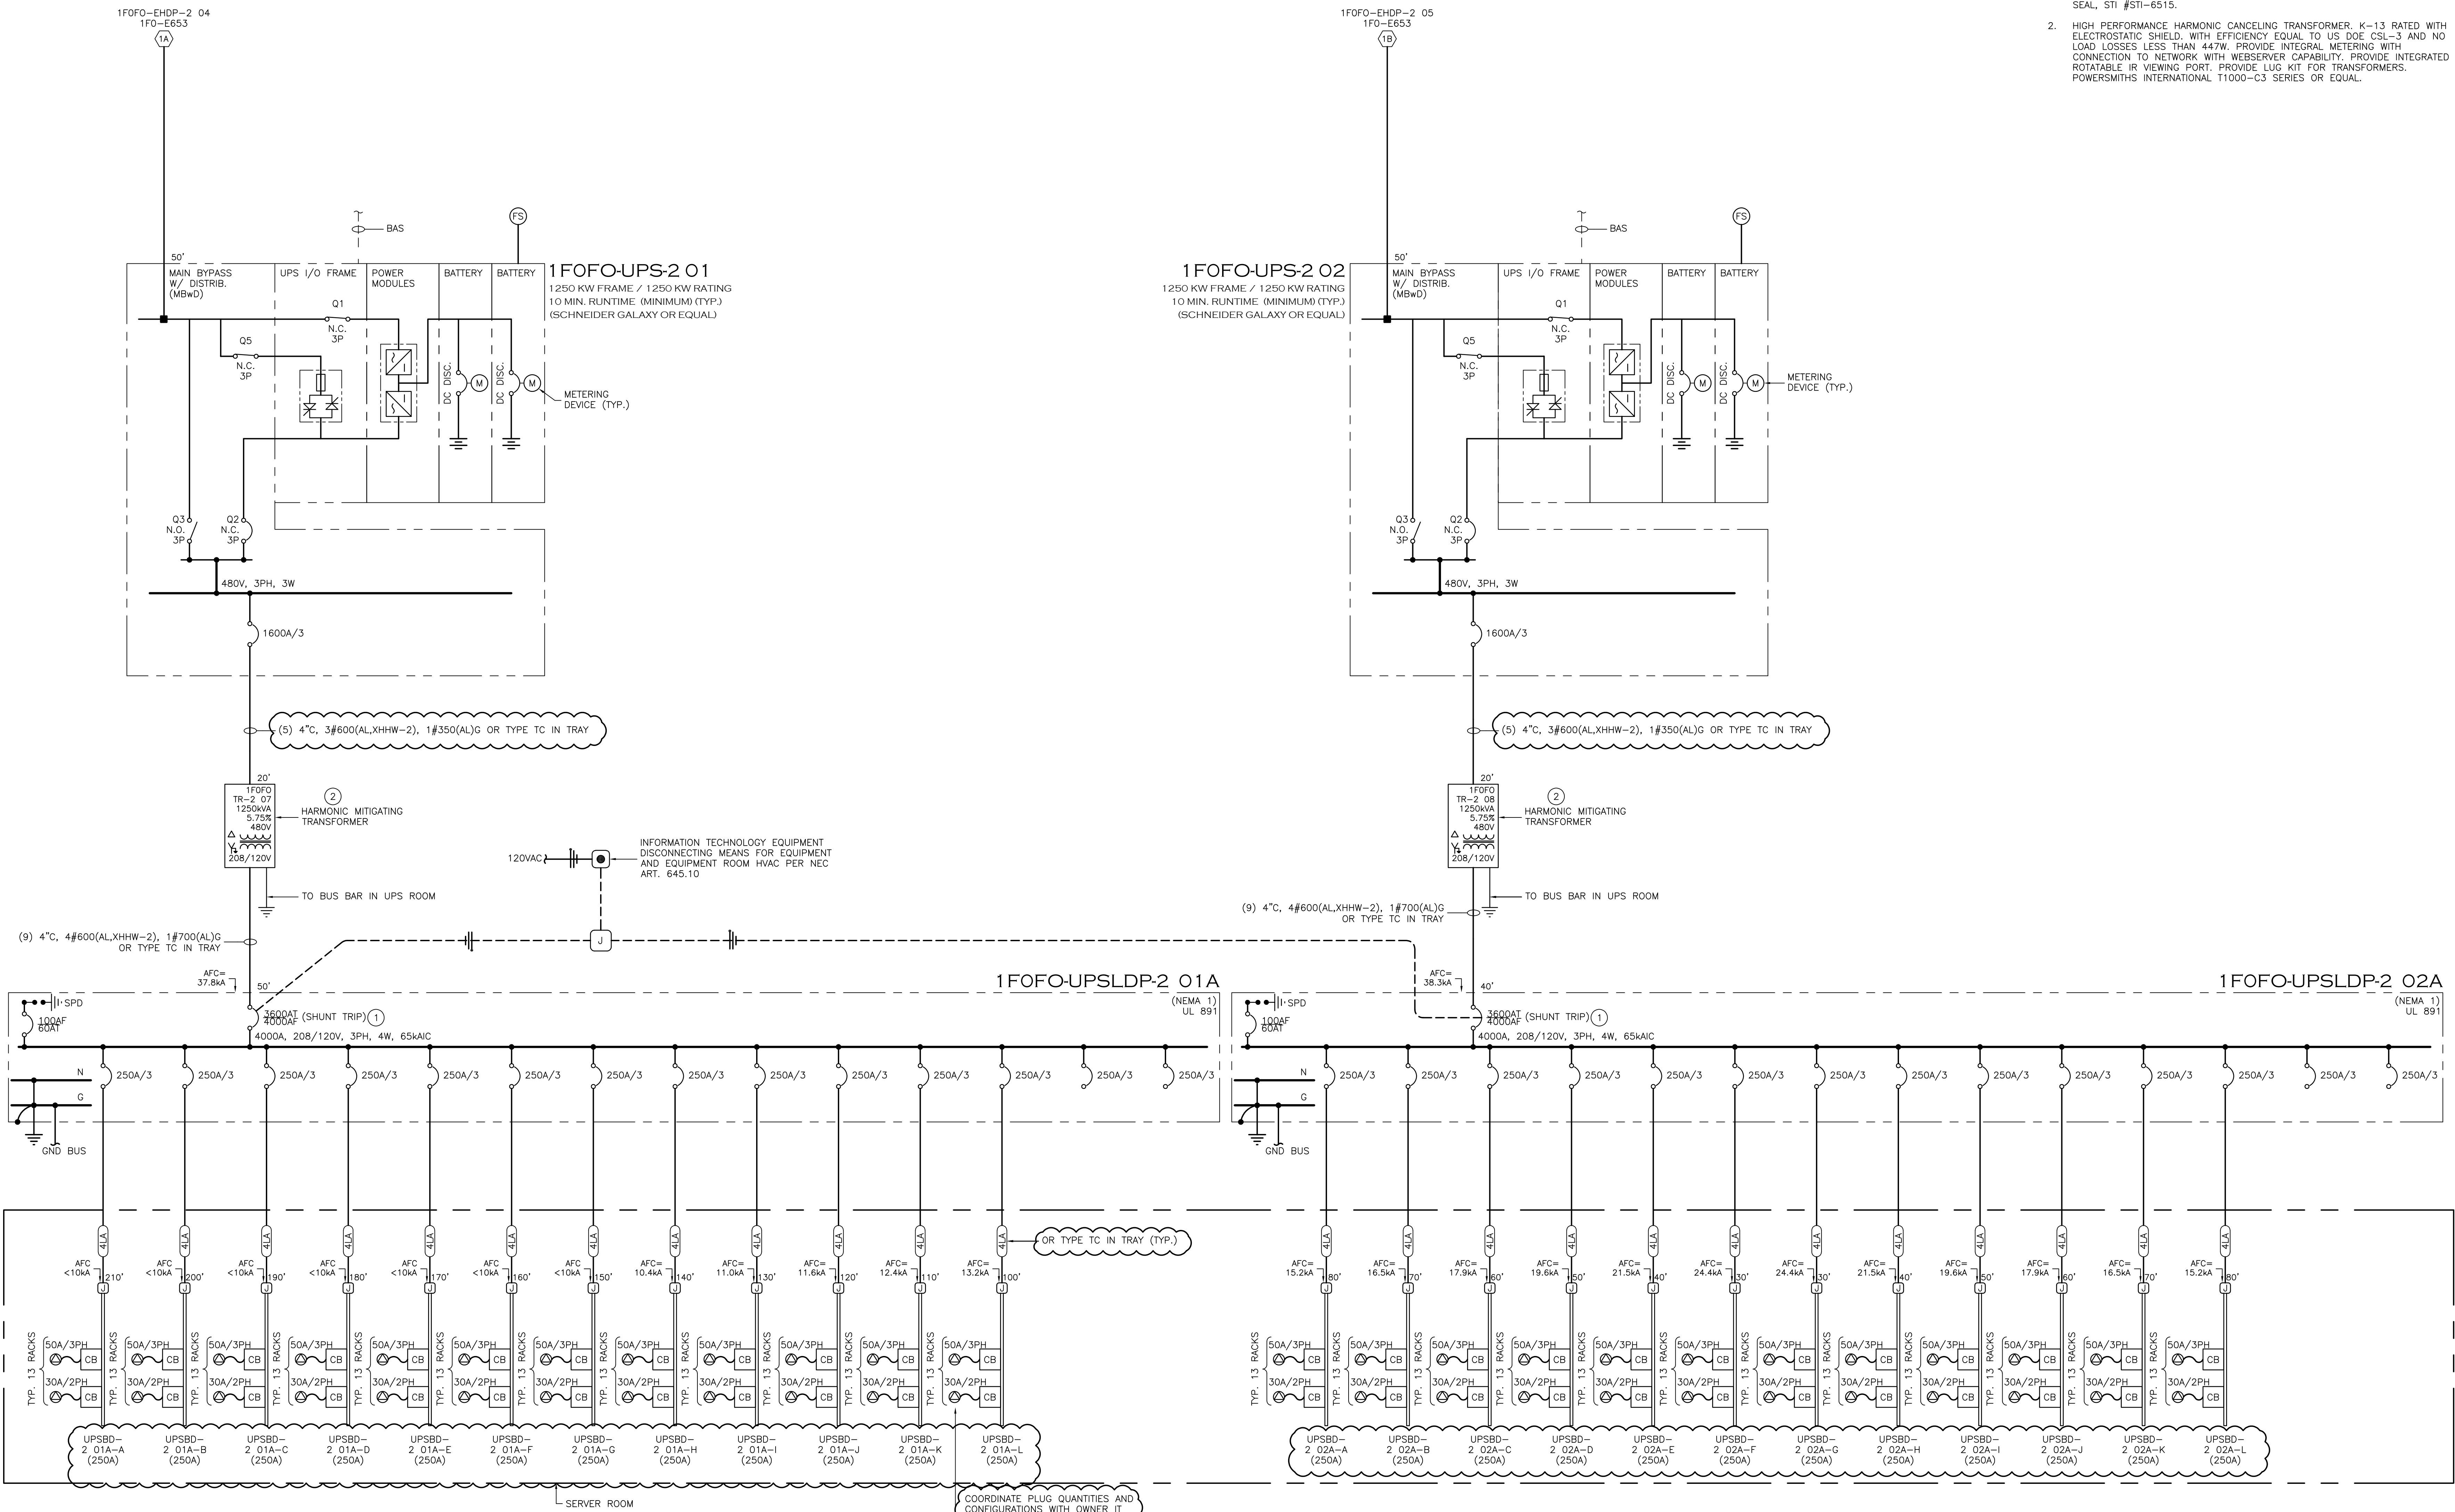


1 ONE LINE DIAGRAM - DATA CENTER UPS ROOM 1
NO SCALE

WARE MALCOMB
2777 E Camelback Rd. Suite #205
Phoenix, AZ 85016
P 480.907.2288

ARCHITECTURE
PLANNING
INTERIORS

CIVIL ENGINEERING
BRANDING
BUILDING MEASUREMENT

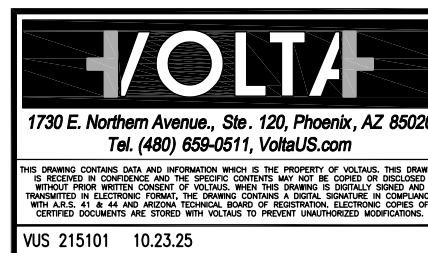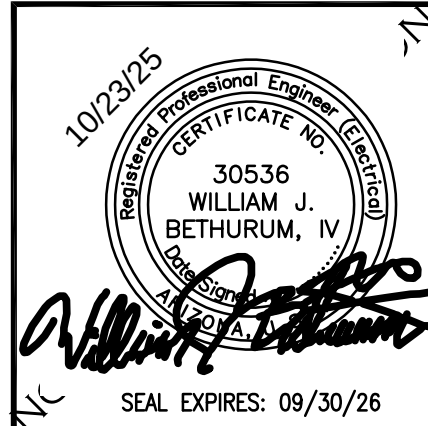

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

DATA CENTER ONE LINE DIAGRAM		
DATE	REVISIONS	REMARKS
10/19/2024	10/19/2024	1F0 CD PROGRESS SET (MEP ONLY)
11/01/2024	11/01/2024	1F0 CD PROGRESS SET (MEP ONLY)
12/17/2024	12/17/2024	1F0 CD PROGRESS SET (MEP ONLY)
02/12/2025	02/12/2025	1F0 CD REVISIONS
06/10/2025	06/10/2025	1F0 CD REVISIONS
10/23/2025	10/23/2025	1F0 BULLETIN #1

PA/PM:	WB
DRAWN BY:	ETS/AO/IAUG
JOB NO.:	PHX21-5038-00

SHEET
1F0-E654