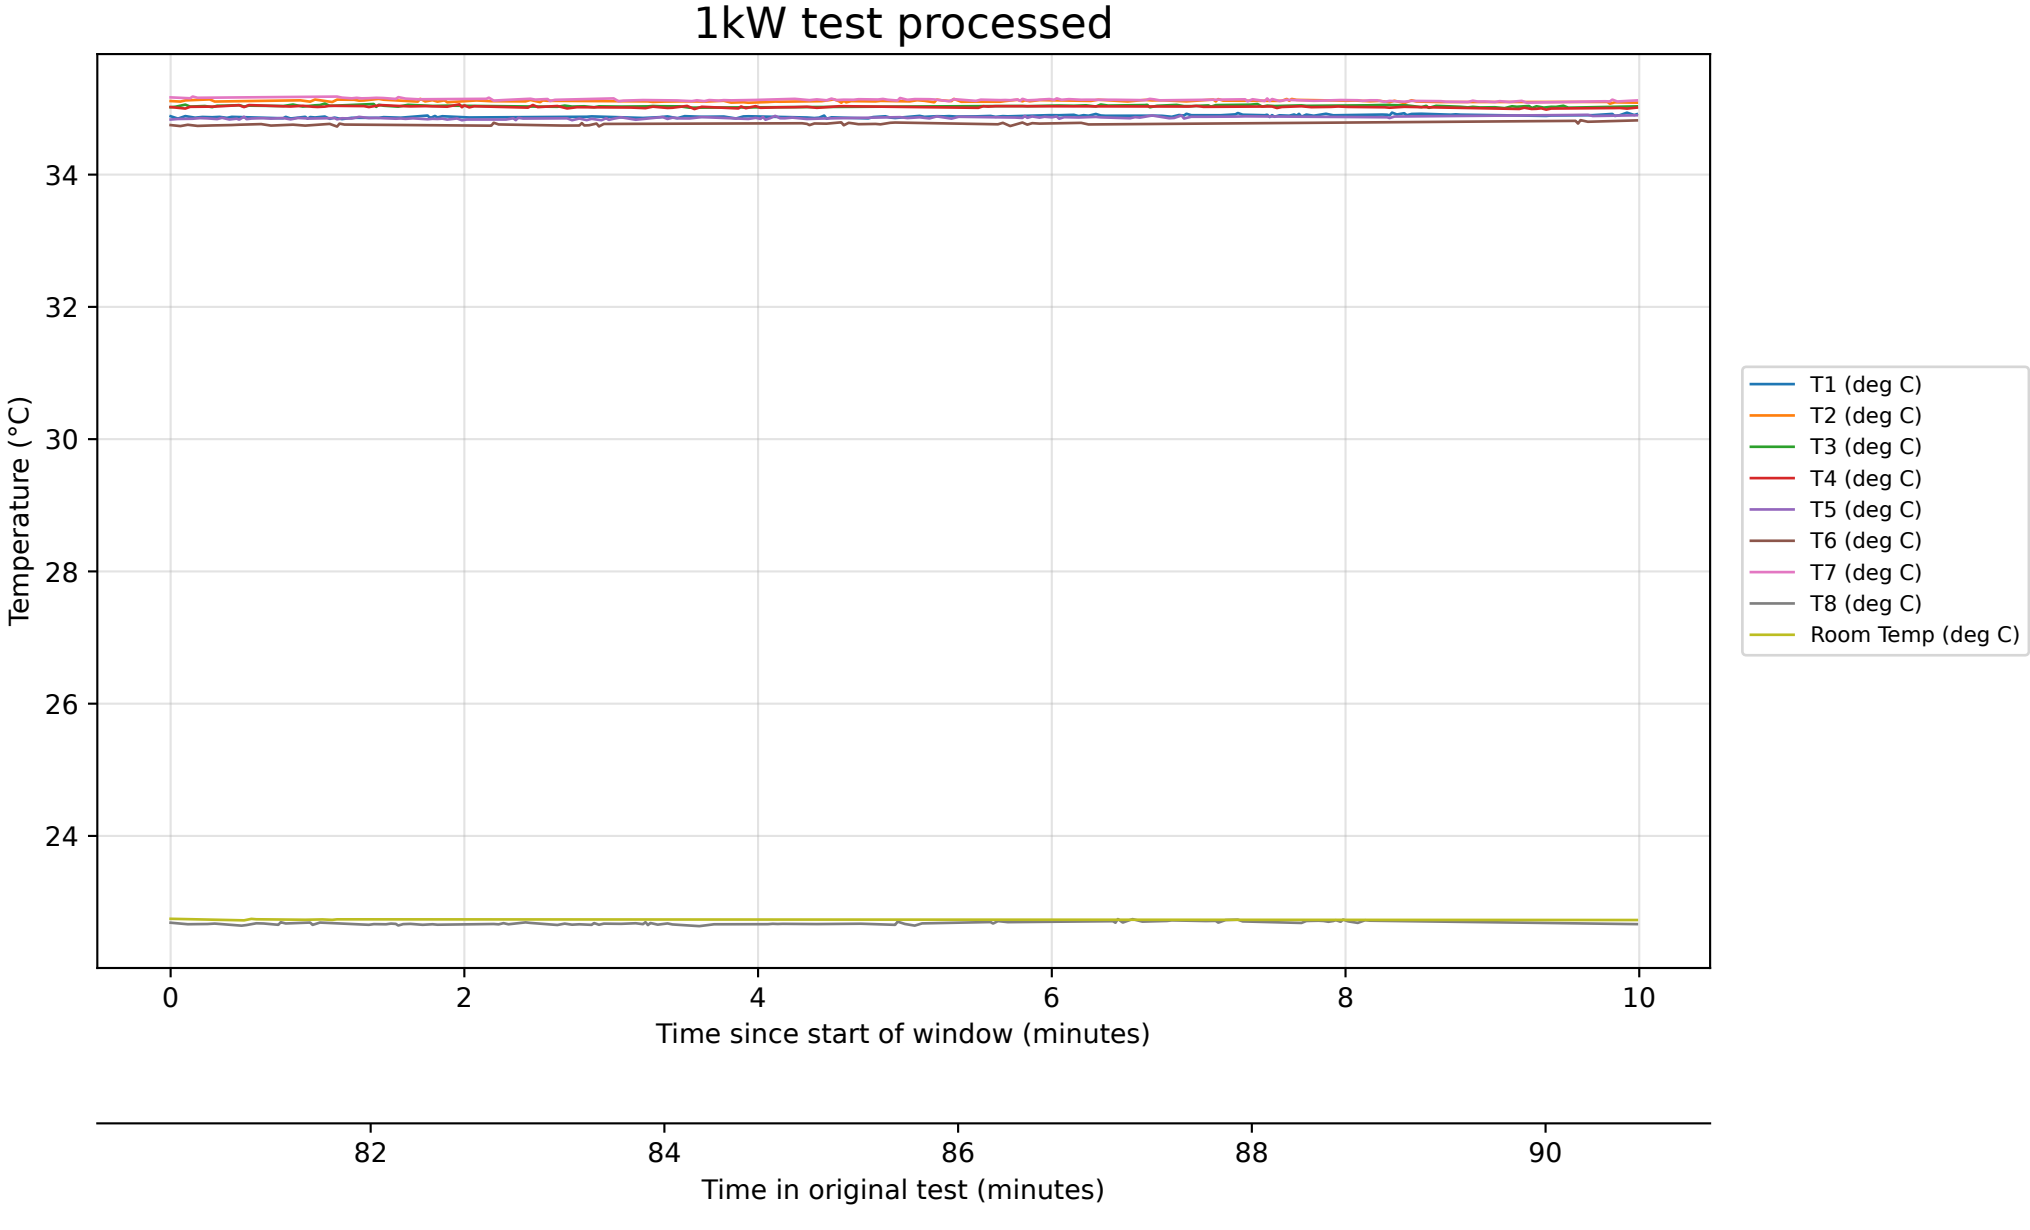
1kW test processed
Temperature (°C)
34
32
30
28
26
24
0
2
4
6
8
10
Time since start of window (minutes)
82
84
86
88
90
Time in original test (minutes)
T1 (deg C)
T2 (deg C)
T3 (deg C)
T4 (deg C)
T5 (deg C)
T6 (deg C)
T7 (deg C)
T8 (deg C)
Room Temp (deg C)