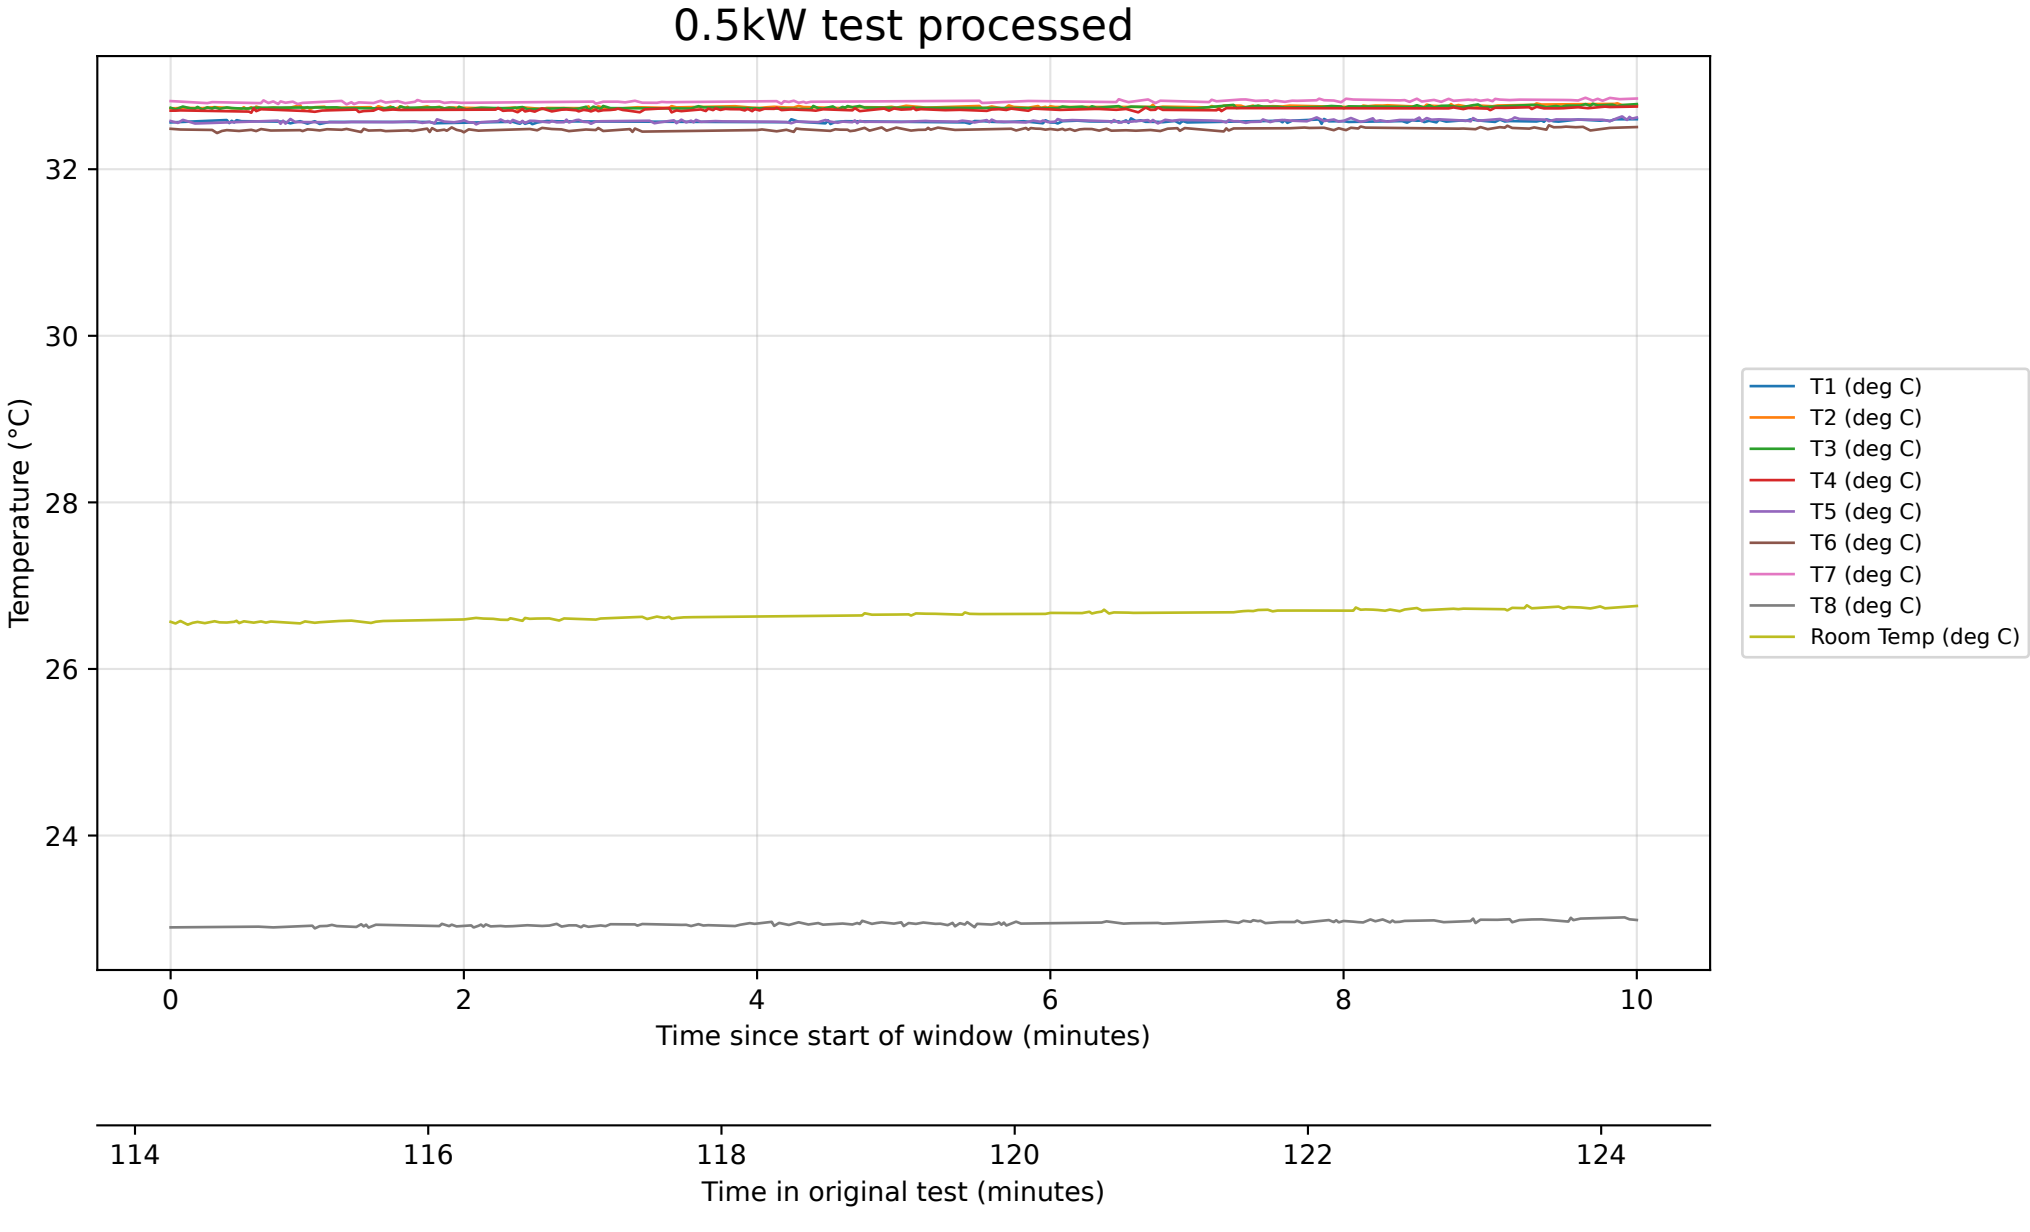
0.5kW test processed
Temperature (°C)
32
30
28
26
24
0
2
4
6
8
10
Time since start of window (minutes)
114
116
118
120
122
124
Time in original test (minutes)
T1 (deg C)
T2 (deg C)
T3 (deg C)
T4 (deg C)
T5 (deg C)
T6 (deg C)
T7 (deg C)
T8 (deg C)
Room Temp (deg C)