

JWS
6-15-20
94-8757

JWS
6-4-20
82999

SPH
5/17/16

WGH
7-29-3013

DFP DMJ
01-02-08


22303
R/P 115kV
A-FRAME, H174,
& H171. I/S WT

22276
WRECK AND
REBUILD SUB

ONE LINE UPDATE:
CHANGE 80472 TO
804R4 & 80471 RATING
TO 75N

ADD NEW COND SCH
ADD (99) TO ONELINE

RELOCATED
RECLOSER TO
OUTSIDE SUB

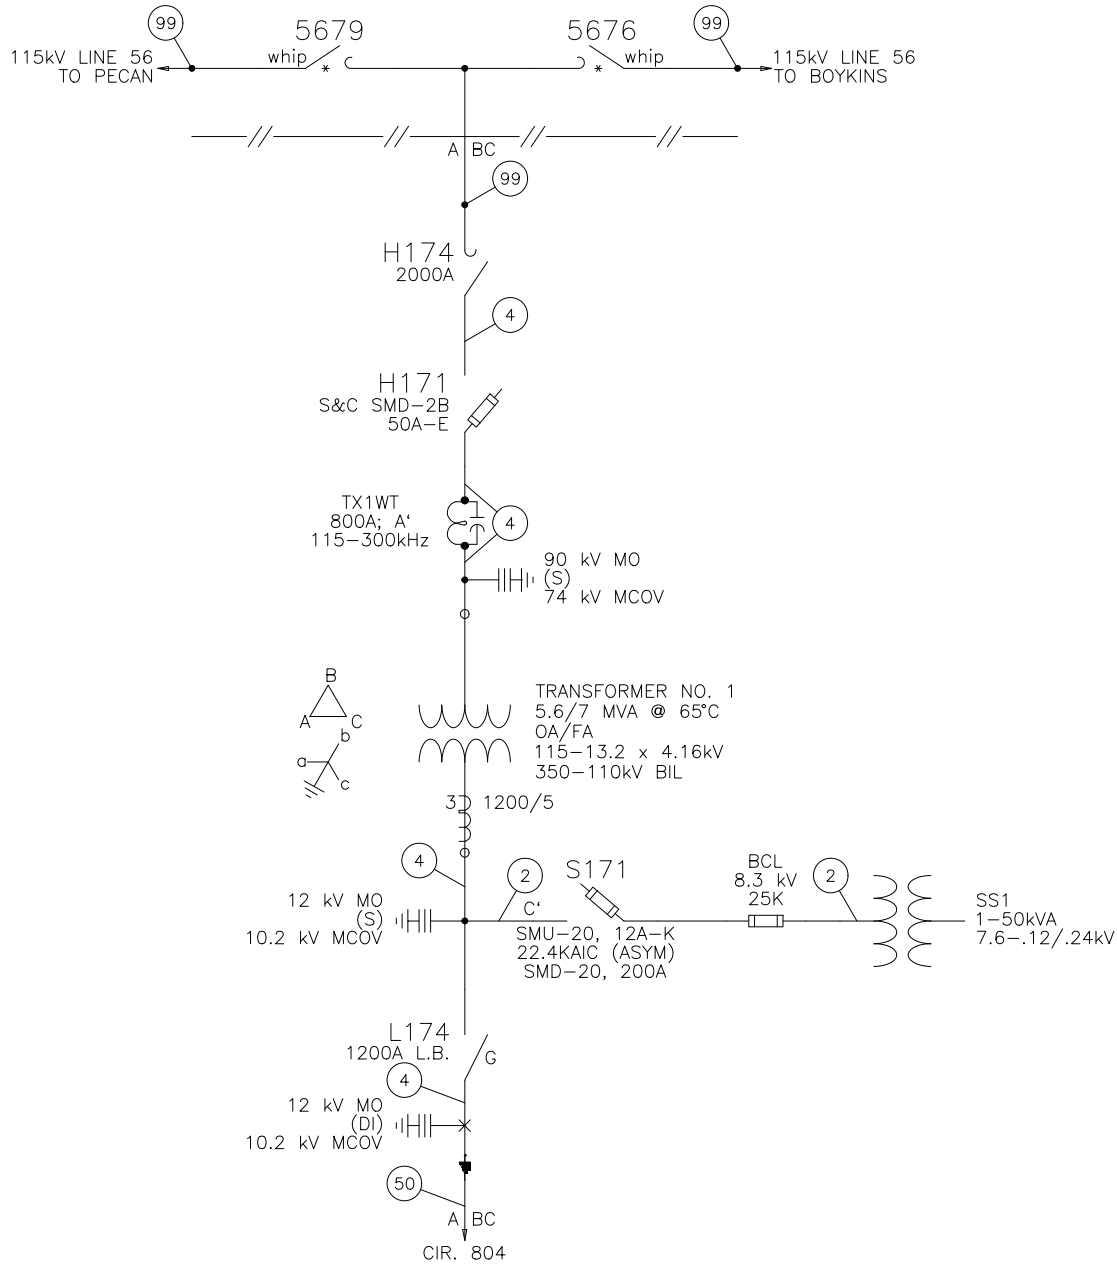

SUBSTATION CONDUCTOR SCHEDULE	
NO	DESCRIPTION
2	1-4/0 AAC - "OXLIP"
4	1-795 AAC - "ARBUTUS"
50	2-1000 ALUMINUM 35kV U.G. (SGL. DUCT)
99	TRANS COND-SEE TRANSMISSION ONELINE

Operating One Line Diagram

RCD

9-9-94

MARGARETTSVILLE

0460000z.dgn