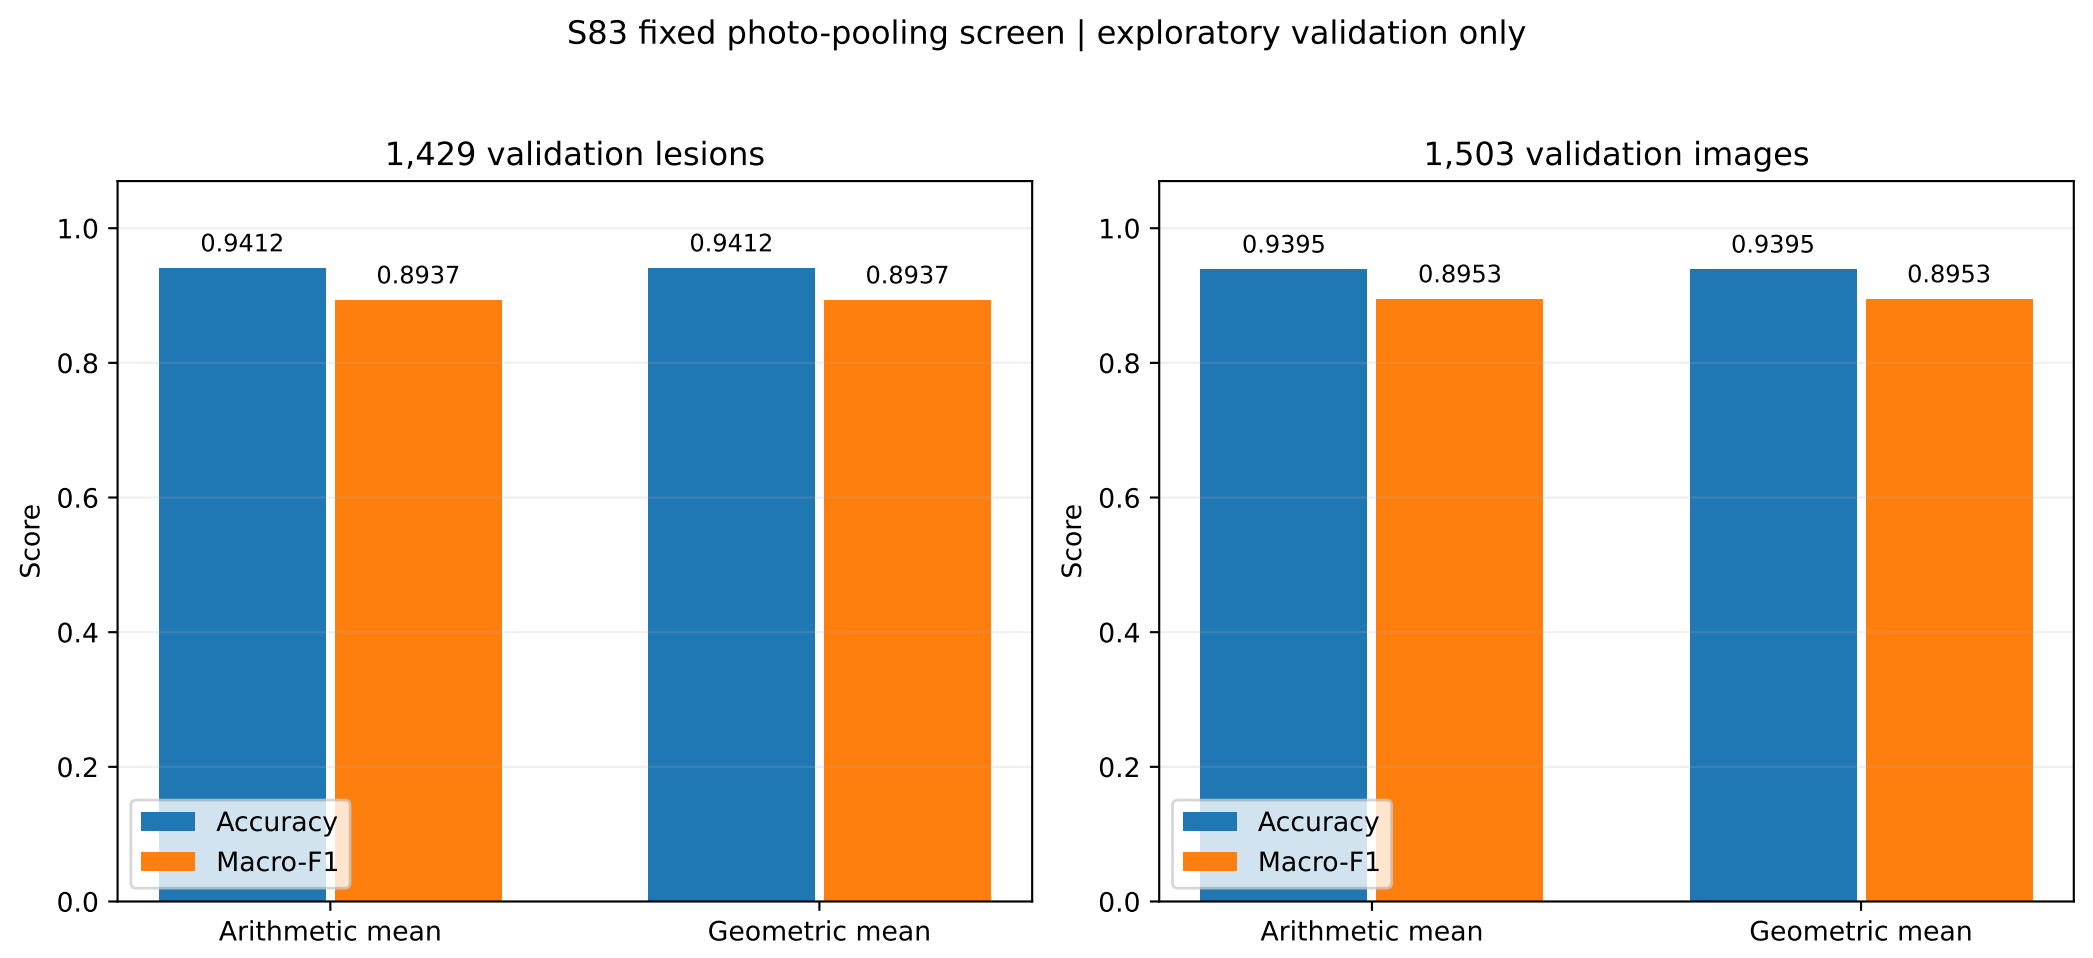
S83 fixed photo-pooling screen | exploratory validation only
1,429 validation lesions
1,503 validation images
Score
1.0
0.8
0.6
0.4
0.2
0.0
0.9412
0.8937
0.9412
0.8937
0.9395
0.8953
0.9395
0.8953
Accuracy
Macro-F1
Arithmetic mean
Geometric mean
Same observations and photographs; no test scoring, training or weight search.