



सेंद्रल ट्रान्समिशन यूटिलिटी ऑफ इंडिया लिमिटेड

(पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड के स्वामित्व में)

(भारत सरकार का उद्यम)

CENTRAL TRANSMISSION UTILITY OF INDIA LTD.

(A wholly owned subsidiary of Power Grid Corporation of India Limited)

(A Government of India Enterprise)

Ref: CTU/N/00/CMETS_NR/38

Date: 30-06-2025

As per distribution list

Subject: 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region-Minutes of Meeting

Dear Sir/Ma'am,

Please find enclosed the minutes of the 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28th May 2025 (Wednesday) through virtual mode.

The minutes are also available at CTU website (www.ctuil.in)

Thanking you,

Yours faithfully,

(Partha Sarathi Das)
Sr. General Manager (CTU)

Distribution List:

Chief Engineer (PSP&A – I) Central Electricity Authority Sewa Bhawan, R.K.Puram, New Delhi-110 066	Member Secretary Northern Regional Power Committee 18A, Shaheed Jeet Singh Sansanwal Marg, Katwaria Sarai, New Delhi – 110 016
Director (Power System) Solar Energy Corporation of India Ltd. D-3, 1 st Floor, A wing, Religare Building, District Centre, Saket, New Delhi-110017	Director Ministry of New and Renewable Energy, Block 14, CGO Complex, Lodhi Road, New Delhi-110003
Director (SO) Grid Controller of India Limited (erstwhile Power System Operation Corporation Ltd.) 9 th Floor, IFCI Towers, 61, Nehru Place, New Delhi-110 016	Executive Director Northern Regional Load Despatch Centre 18-A, Qutab Institutional Area, Shaheed Jeet Singh Sansanwal Marg, Katwaria Sarai, New Delhi– 110 016
Director (P & C) HPPTCL, Headoffice, Himfed Bhawan, Panjari, Shimla-171005 Himachal Pradesh	Director(W&P) UP Power Transmission Company Ltd. Shakti Bhawan Extn, 3rd floor, 14, Ashok Marg, Lucknow-226 001
Director (Technical) Punjab State Transmission Corporation Ltd. Head Office, The Mall, Patiala 147001, Punjab	Director (Projects) Power Transmission Corporation of Uttarakhand Ltd. Vidyut Bhawan, Near ISBT Crossing, Saharanpur Road, Majra, Dehradun.
Development Commissioner (Power) Power Development Department Grid Substation Complex, Janipur, Jammu	Director (Technical) Rajasthan Rajya Vidyut Prasaran Nigam Ltd. Vidyut Bhawan, Jaipur, Rajasthan-302005.
Member (Power) Bhakra Beas Management Board Sector-19 B, Madhya Marg, Chandigarh - 160019	Superintending Engineer (Operation) Electricity Circle, 5 th Floor, UT Secretariat, Sector-9 D, Chandigarh - 161009
Director (Operations) Delhi Transco Ltd. Shakti Sadan, Kotla Road, New Delhi-110 002	Director (Technical) Haryana Vidyut Prasaran Nigam Ltd. Shakti Bhawan, Sector-6, Panchkula-134109, Haryana

Distribution List:

Executive Director (AM) POWERGRID Saudamini, Plot No.2, Power Grid Corporation of India Limited, Near, August Kranti Marg, Sector 29, Gurugram, Haryana 122001	Executive Director (Engg.-S/s) POWERGRID Saudamini, Plot No.2, Power Grid Corporation of India Limited, Near, August Kranti Marg, Sector 29, Gurugram, Haryana 122001
Shri Harshit Gupta Head Regulatory Affairs Hexa Climate Solutions Private Limited 14th Floor, Vatika Business Park, Sohna Road, Gurugram-122018, Haryana Ph.: 9958586072, 8527734155 Email: harshit.gupta@hexaclimate.com ; saurabh.pandey@hexaclimate.com ;	Shri Manoj Kumar Sharma Vice President Azure Power Fifty One Private Limited DSC-304, Second Floor, DLF South Court, Saket District Centre, New Delhi -110017 Ph.: 9999786638, 8288085988 Email: manoj.sharma@azurepower.com ; vishal.kumar@azurepower.com ;
Shri Mohit Jain Authorised Signatory Renew Solar Power Private Limited Renew.Hub, Commercial Block-1, Zone-6, Golf Course Road, DLF City Phase V, Gurugram, Haryana -122009 Ph.: 9873462717, 9542388443 Email: mohit.jain@renew.com ; solarbidding.gm@renew.com ;	Shri Santosh Narayan Group Head Project Development Tata Power Renewable Energy Limited C/o The Tata Power Company Limited, Corporate Center B, 34 Sant Tukaram Road, Carnac Bunder, Mumbai-400009, Maharashtra Ph.: 9223550695, 8005920193 Email: narayans@tatapower.com ; hari.sharma@tatapower.com ;
Shri Neeraj Khandekar Authorized Signatory Apraava Energy Private Limited 7th Floor, Fulcrum, Sahar Road, Andheri East, Mumbai, Maharashtra – 400099 Ph.: 9867868868, 8433723582 Email: neeraj.khandekar@apraava.com gopal.eti@apraava.com	Shri Amrik Singh General Manager Chenab Valley Power Projects Pvt Limited Chenab Jal Shakti Bhawan, Opposite Saraswati Dham, Rail Head Complex, Jammu - 180012, J&K (UT) Ph.: 9560455326, 9419792461 Email: amriksingh@cvppindia.com mohanlal.cvpp@nic.in
Shri Jaydipsinh Udaysinh Chudasama General Manager Torrent Green Energy Private Limited SUGEN Mega Power Project, Torrent Power Ltd. Village:Akhakhol Dist:Surat, Gujarat-394155 Ph: 9227410136, 6353855565 Email: jaydipchudasama@torrentpower.com ; anshunegi@torrentpower.com	Shri Punit Gupta Director Jindal India RE Limited Habitat India, 1st Floor, C-3 Qutub Institutional Area, Katwaria Sarai, New Delhi- 110016 Ph:9717955662, 7861901000 Email: punit_gupta@jindalgroup.com ; reprojects4@jindalgroup.com
Shri Prakash Matai Director JIRE Green Energy Project Two Limited Habitat India, C-3, Block C, Qutab Institutional Area, New Delhi, Delhi-110016 Ph: 7861901000, 9327369209 Email: reprojects4@jirel.com sks.jirel@outlook.com	Shri Ashutosh Kapil Director JIRE Green Energy Project Three Limited Habitat India, 1st Floor, C-3 Qutub Institutional Area, Katwaria Sarai, New Delhi, Delhi - 110016 Ph: 7861901000, 9327369209 Email: reprojects4@jirel.com sks.jirel@outlook.com

Shri Pujan Pankaj Doshi Director Waaree Forever Energies Private Limited 602, Western Edge-1, Off. Western Express Highway, Borivali (East), Mumbai, Maharashtra- 400066 Ph: 9167766799, 8448589217 Email: pujandoshi@waareertl.com soham.sarkar@waaree.com	Shri Dhir Singh Senior Manager Solarcraft Power India 4 Private Limited 109, First Floor, Rishabh IPEX Mall, IP Extension, Patparganj, Delhi - 110092 Ph: 9993846698,9999885815 Email: dhir.singh@blupineenergy.com ashish.agarwal@blupineenergy.com
Shri Pawan Sharma Manager BD and Commercial Green Infra Renewable Energy Farms Private Limited Building 7 A, Level 5, DLF Cybercity, Gurugram, Haryana – 122002 Ph: 9654180697, 9810299682 Email: pawan.sharma@sembcorp.com devi.dutta@sembcorp.com	Shri Hemank Sindhu Director Adyant Enersol Private Limited Plot no-51 & 52, M-Powered Building Phase-IV, Udyog Vihar Near Atlas Chowk, Gurgaon, Haryana Ph: 9896863386, 8158880993 Email: hemank@live.in shubham.roy@dattainfra.com
Shri Naveen Kumar Khandelwal Director BN Peak Power-3 Private Limited Unit 4A, 2nd Floor, Infinity Tower A, DLF Cybercity, Gurugram, Haryana – 122002 Ph: 9971050109, 8884111690 Email: naveen@brightnightpower.com rahul@brightnightpower.com	Shri Pavan Kumar Gupta Authorized Signatory Juniper Green Energy Private Limited, Juniper Green Stellar Private Limited Plot No. 18, 1st Floor, Institutional Area, Sector - 32, Gurgaon, Haryana – 122001 Ph: 9560540654, 9910509744 Email: pavan.gupta@junipergreenenergy.com bd@junipergreenenergy.com
Shri Yogesh Kumar Sanklecha VP ACME Taurus Urja Private Limited, ACME Cleantech Solutions Private Limited, ACME Solar Holdings Limited Plot No. 152, Sector-44, Gurugram, Haryana - 122002, Ph: 8744060601, 9911299514 Email: yogesh@acme.in apradhan@acme.in	Shri Manish Pratap Singh Sr.DEE/TRD/DLI Indian Railways Office of Senior Divisional Electrical Engineer/Traction Distribution in Divisional Railway Manager office complex, State Entry Road, New Delhi Ph: 9717631302, 9717648547 Email: srdeetrddli@gmail.com ctatrdldelhidivision@gmail.com
Shri Aman Gehlot Director Aman Hospitality Private Limited L-4, Green Park Extension, New Delhi-110016 Ph: 9810272255, 8875750551 Email: gehlotaman1986@gmail.com rahul.gupta@raysexperts.com	Shri V. Jayaraman CEO-Power HINDUSTAN ZINC LIMITED Yashad Bhawan, Udaipur, Rajasthan Ph: 9928140302, 9799782777 Email: v.jayaraman@vedanta.co.in vinod.jaroli@vedanta.co.in
Shri Ajitgiri Functional Manager Electrical Vedanta Limited Mangala Processing Terminal, Nagana Village, Near Kawas, NH 112, Barmer, Rajasthan-344035 Ph: 8003490623, 7073464362 Email: electricalmanager@cairnindia.com avishkar.chauhan@cairnindia.com	Shri Alok Kumar Nigam Director Vismaya Four Renewables Private Limited 613, 614A, 614B, 6th Floor, Magnum Global Park, Tower 2, Golf Course Extension Road, Sector 58, Gurugram-122011 Ph: 9717855521, 8800917799 Email: alok.nigam@upcrenewables.in vikram.malkotia@upcrenewables.in

Shri Pramod Singh Chauhan Authorized Signatory Mahanadi Renewable Energy Private Limited, Godavari Green Energy Private Limited, Sabarmati Green Energy Private Limited 2nd Floor, Mira Corporate Suites, Plot No. 1/2, B-Block, Old Ishwar Nagar, New Friends Colony, New Delhi - 110065 Ph: 8003386600, 7304453112 Email: pramod_Chauhan@welspun.com nishant_thakkar@welspun.com	Shri Vaibhav Kapoor Asst Vice President ABREL (RJ) Projects Limited 8th Floor, Parsvnath Capital Tower, Bhai Vir Singh Marg, New Delhi Ph: 9582430361, 9810613998 Email: vaibhav.kapoor@adityabirla.com rajuram.choudhary@adityabirla.com
Shri Mahendra Singh Dabi Manager Adani Renewable Energy Holding Twelve Ltd. 6th floor, CT Tower-1, Inspire Business Park, Opp. Adani Corporate House, Nr. Vaishnodevi Circle, Khodiyar, Ahmedabad, Gujarat-382421 Ph: 7227916165, 9792972884 Email: mahendrasingh.dabi@adani.com, diwakar.kumar@adani.com	Shri Deepak Saigal Cheif Executive Officer Ratle Hydroelectric Power Corporation Ltd. Room No. 8, Block No. 02, NHPC Regional Office, JDA Commercial Complex No. 01, Narwal, Jammu, Jammu & Kashmir-180006 Ph.: 9971206868; 9810575616 Email: ceo.ratle@nhpc.nic.in; vinodsharma@nhpc.nic.in
Shri Vijay Singh Superintending Engineer BBMB Superintending Engineer O&M 400 KV GSS Hansi Road, BBMB Premanagar Bhiwani Haryana Ph: 9466120870, 9582809319 Email: seombwn@bbmb.nic.in xenombwn@bbmb.nic.in xenomhsr@bbmb.nic.in	Shri Shashi Bhardwaj Director RJS Renewables Private Limited 3rd Floor UDB Landmark, Plot No-6, Basant Bahar Colony, Durgapura, Jaipur, Rajasthan 302018 Ph: 7976860944, 9588266119 Email: rjsrenewablesprivtltd@gmail.com karunain2000@yahoo.com
Shri Veerendra Verma Sr.DEE/TRD/PRYJ Indian Railways Sr. Divisional Electrical Engineer (Traction Distribution), DRM Office, Nawab Yusuf Road, Prayagraj, Uttar Pradesh-211001 Ph: 9794837300, 9794868555 Email: srdeetrdald123@gmail.com, abind1453@gmail.com	

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025

A. Application related matters in Northern Region

It was informed that in the 37th CMETS NR meeting held on 27.03.2025, 50 MW connectivity at Bikaner PS was discussed for grant to M/s Hexa Climate. Subsequently, M/s Hexa Climate informed their decision to withdraw their application and accordingly, the application was closed. Therefore, the 50 MW margin at Bikaner PS shall be considered for grant of connectivity for applicants at Bikaner complex in this meeting.

A1. Applications for Connectivity to ISTS under CERC (Connectivity and General Network Access to the inter-State Transmission System) Regulations, 2022 deferred in 37th CMETS NR meeting:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
1.	2200001420 (30.10.2024)	Azure Power Fifty One Private Limited	Jodhpur distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land Route	600	31.12.2029	Bhadla-IV PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 6 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Azure Power Fifty-One Private Limited had applied for connectivity for 600 MW at Bhadla-IV PS. However, with grant of 5825 MW connectivity at Bhadla-IV PS, Bhadla-IV PS is closed for grant of additional connectivity except enhancements (upto 175 MW). Accordingly, it was proposed to grant connectivity at Bhadla-V PS through 400 kV S/c line.

However, M/s Azure Power in the 37th CMETS NR meeting requested CTUIL to grant connectivity of 600 MW at 220 kV level. CTUIL informed that considering the connectivity quantum(600 MW), connectivity at 400 kV is optimal compared to 220 kV level. Therefore, considering the optimal utilization of ISTS system & RoW it was decided to grant connectivity at 400 kV level.

Subsequently, M/s Azure vide letter dated 10.04.2025 informed that they have land in procession for 300 MW in vicinity of Bhadla Complex & further expansion of the land parcel is not feasible due to existing projects in the surrounding area. Therefore, they had planned to procure land for additional 300 MW capacity after finalization of location of Pooling station. In view of the above, M/s Azure again requested to grant connectivity at 220 kV. Considering the above aspects, it was decided to take up the above application by M/s Azure again for discussion in the next CMETS NR meeting.

Matter was again deliberated in the 38th CMETS NR meeting. In the meeting, M/s Azure reiterated their request for grant of connectivity at 220 kV level. Regarding this, CTUIL clarified that M/s Azure has applied for connectivity of 600 MW vide a single application and it is not recommended to split a single application into multiple parts of 300 MW. Therefore, for a single connectivity of 600 MW, connectivity can be granted at a single point, . After deliberations, it was decided that the connectivity to M/s Azure Power shall be granted at 400 kV as agreed earlier in 37th CMETS-NR meeting.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
Details of Transmission system for Connectivity under GNA:										
A. <u>Associated Transmission System (ATS):</u> NIL										
B. <u>Dedicated Transmission System for Connectivity under GNA:</u>										
(i). Azure Power Fifty One Private Limited RE Power Project – Bhadla-V PS 400 kV S/c line on D/c tower (suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end -Under Applicant Scope										
(ii). 1 no of 400 kV bay at Bhadla-V PS is under ISTS										
C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-III										
Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system										

A2. Applications for Connectivity to ISTS under CERC (Connectivity and General Network Access to the inter-State Transmission System) Regulations, 2022 received in Jan'25:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)
1.	2200001629 (06-01-2025)	Jindal India RE Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.09.2027	Bikaner-V PS
2.	2200001550 (10-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LoA or PPA	300	03.03.2027	Barmer ISTS
3.	2200001642 (11-01-2025)	Torrent Green Energy Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	1000 MW (Solar)	Land BG Route	1000	31.12.2029	Bhadla-IV PS
4.	2200001659 (15-01-2025)	JIRE Green Energy Project Two Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.12.2028	Barmer III PS
5.	2200001684 (23-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 70 MW (BESS)	LoA or PPA	200	31.01.2027	Barmer PS
6.	2200001689 (24-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LoA or PPA	300	31.03.2027	Barmer PS

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)
7.	2200001701 (28-01-2025)	Hexa Climate Solutions Private Limited	Nagaur distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 50 MW (BESS)	Land BG Route	300	30.11.2029	Merta III PS
8.	2200001700 (28-01-2025)	Hexa Climate Solutions Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 50 MW (BESS)	Land BG Route	300	30.11.2029	Ramgarh II PS
9.	2200001702 (28-01-2025)	Hexa Climate Solutions Private Limited	Nagaur distt., Rajasthan	Standalone ESS	BESS 300 MW	Land BG Route	300	30.11.2029	Merta III PS
10.	2200001717 (30-01-2025)	JIRE Green Energy Project Three Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 100 MW (BESS)	Land BG Route	200	31.12.2028	Ramgarh II PS
11.	2200001721 (31-01-2025)	Tata Power Renewable Energy Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	31.03.2027	Bikaner V PS
12.	2200001722 (31-01-2025)	Tata Power Renewable Energy Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	31.03.2027	Fatehgarh II PS

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity(As per Application)	Connectivity Location(As per Application)	Conn BGs requirement
1.	2200001629 (06-01-2025)	Jindal India RE Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.09.2027	Bikaner-V PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Jindal India RE Limited has applied for connectivity for 300 MW at Bikaner-V PS. However, there is no margin available at Bikaner-V PS (except for enhancement of 170 MW at 220 kV bay allocated to M/s Juniper Green Energy-130 MW). Accordingly, it was proposed to grant connectivity at the Bikaner-VI PS through a 220 kV S/c line. M/s Jindal agreed for the same.

Applicant was asked to confirm the 220 kV bay scope at Bikaner-VI PS end & DTL tower configuration. M/s Jindal India RE Limited informed that 220 kV bay at Bikaner-VI PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s Jindal India RE Limited was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Jindal agreed for the same.

It was mentioned that with the grant of above connectivity of 300 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. The applicant noted the same.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity(As per Application)	Connectivity Location(As per Application)	Conn BGs requirement
It was also informed that the transmission system for evacuation of power from Bikaner-VI PS is presently under evolution. Upon evolution, the scheme shall be finalized in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. Further, it was also informed that M/s Jindal India RE Limited has requested Start Date of Connectivity under GNA from 30.09.2027. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s Jindal India noted the same. Accordingly, it was agreed to grant connectivity of 300 MW to M/s Jindal India RE Limited at 220 kV Bikaner-VI PS. Details of Transmission system for connectivity of M/s Jindal India RE Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Jindal India RE Limited RE Power Project – Bikaner-VI PS 220 kV S/c line on D/c tower (suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no. of 220 kV bay at Bikaner-VI PS shall be under the scope of ISTS C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-I Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
2.	2200001550 (10-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LoA or PPA	300	03.03.2027	Barmer PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil(Bay in sharing) • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Renew Solar Power Private Limited has applied for connectivity for 300 MW at Barmer PS. However, there is no margin available for grant at Barmer-I PS(except 50 MW enhancement at 220 kV bay), Barmer-II PS & Barmer-III PS(except enhancement margin of 39.5 MW at 220 kV). Further, M/s Renew Solar has filed additional applications for cumulative connectivity quantum of 500 MW at Barmer complex (App. No. 2200001684-200 MW & App. No. 2200001689-300 MW) which were also discussed in the same meeting. Accordingly, it was proposed to grant connectivity at 400 kV Barmer-IV PS through 400 kV S/c line for the										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
										combined capacity of 800 MW (300+200+300). M/s Renew agreed for the same. Applicant was asked to confirm the 400 kV bay scope at Barmer-IV PS end & DTL tower configuration. Further, M/s Renew Solar was also asked to confirm the lead entity among the above applications for DTL ownership & Conn BG-2 submission. M/s Renew Solar informed that 400 kV bay at Barmer-IV end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s Renew Solar was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Renew agreed for the same. Further, M/s Renew vide mail dated 30.05.2025 informed that the among the three applications for connectivity at Barmer-IV PS, App. No. 2200001684(200 MW) may be considered as lead entity. The same was noted. It was informed that M/s Renew Solar has applied for connectivity of 300 MW which is more than the contracted capacity of LoA(150 MW). Regarding the grant of connectivity quantum higher than contracted capacity, there is an ongoing case filed by Axis Energy in Andhra Pradesh high court. Therefore, the connectivity of 300 MW shall be granted to M/s Renew Solar for the present application which shall be subject to outcome of the decision of Andhra Pradesh High Court in this regard. It may be noted that the transmission system for evacuation of power from Barmer-IV is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was also informed that M/s Renew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 03.03.2027. Considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s Renew noted the same. Accordingly, it was agreed to grant connectivity of 300 MW to M/s Renew Solar Power Private Limited at 400 kV Barmer-IV PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System</u> M/s Renew Solar Power Private Limited shall share the dedicated transmission system granted with App. No. 2200001684: (i). Common Pooling Station for Renew Solar Power Private Limited RE Power Projects (App. No. 2200001550-300 MW, App. No. 2200001684-200 MW & App. No. 2200001689-300 MW) – Barmer-IV PS 400 kV S/c line on D/c tower (Suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
(ii). 1 no. of 400 kV bay at Barmer-IV PS end shall be under the scope of ISTS										
C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-II										
Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity(As per Application)	Connectivity Location(As per Application)	Conn BGs requirement
3.	2200001642 (11-01-2025)	Torrent Green Energy Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	1000 MW (Solar)	Land BG Route	1000	31.12.2029	Bhadla-IV PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 6 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Torrent Green Energy Private Limited has applied for connectivity for 1000 MW at Bhadla-IV PS. However, with grant of 5825 MW connectivity at Bhadla-IV PS, Bhadla-IV PS is closed for grant of additional connectivity except enhancements (upto 175 MW). Accordingly, it was proposed to grant connectivity at proposed Bhadla-V PS through 400 kV S/c line. M/s Torrent agreed for the same.

Applicant was asked to confirm the 400 kV bay scope at Bhadla-V PS end & DTL tower configuration. M/s Torrent Green Energy informed that they shall confirm the same vide email. M/s Torrent informed that they shall confirm the same in mail. Subsequently, M/s Torrent Green vide mail dated 16.06.2025 informed that 400 kV bay at Bhadla-V end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted. Further, M/s Torrent Green Energy also submitted necessary undertaking for S/c line on D/c tower configuration.

It was mentioned that the transmission system for evacuation of power from Bhadla-V PS is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s Torrent Green Energy Private Limited has requested Start Date of Connectivity under GNA from 31.12.2029. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 30.09.2031(interim). M/s Torrent Green noted the same.

Accordingly, it was agreed to grant connectivity of 1000 MW to M/s Torrent Green Energy Private Limited at 400 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s Torrent Green Energy Private Limited under GNA is as below:

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity(As per Application)	Connectivity Location(As per Application)	Conn BGs requirement
Details of Transmission system for Connectivity under GNA:										
A. <u>Associated Transmission System (ATS):</u> NIL										
B. <u>Dedicated Transmission System for Connectivity under GNA:</u>										
(i). Torrent Green Energy Private Limited RE Power Project – Bhadla-V PS 400 kV S/c line on D/c tower (suitable to carry minimum 1000 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope										
(ii). 1 no. of 400 kV bay at Bhadla-V PS end shall be under the scope of ISTS										
C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-III										
Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
4.	2200001659 (15-01-2025)	JIRE Green Energy Project Two Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.12.2028	Barmer III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s JIRE Green Energy Project Two Limited has applied for connectivity for 300 MW at Barmer-III PS. However, there is no margin available for grant at Barmer-III PS (except enhancement margin of 39.5 MW at 220 kV). Accordingly, it was proposed to grant connectivity at proposed Barmer-IV PS through 220 kV S/c line. M/s Jire agreed for the same. Applicant was asked to confirm the 220 kV bay scope at Barmer-IV PS end & DTL tower configuration. M/s JIRE Green Energy Project Two Limited informed that 220 kV bay at Barmer-IV PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s JIRE Green Energy Project Two Limited was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s JIRE Green Energy Project Two Limited agreed for the same. It was mentioned that with the grant of connectivity of 300 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. It was mentioned that the transmission system for evacuation of power from Barmer-IV is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	--------------------	------------------------	---------------------------	---	--	----------------------

be informed upon finalization and approval of the scheme.

It was also informed that M/s JIRE Green Energy Project Two Limited has requested Start Date of Connectivity under GNA from 31.12.2028. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). Transmission system for connectivity of M/s JIRE Green Energy Project Two Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA:

- (i). JIRE Green Energy Project Two Limited RE Power Project– Barmer-IV PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – **Under Applicant Scope**
- (ii). 1 no. of 220 kV bay at Barmer-IV PS end shall be under the scope of ISTS.

C. Common Transmission system for Connectivity under GNA: As per Annexure-II

Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
5.	2200001684 (23-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 70 MW (BESS)	LoA or PPA	200	31.01.2027	Barmer PS	- Conn BG1: Rs. 50 Lakh - Conn BG2: Rs. 6 Cr. - Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Renew Solar Power Private Limited has applied for connectivity for 200 MW at Barmer PS. However, there is no margin available for grant at Barmer-I PS(except 50 MW enhancement at 220 kV bay), Barmer-II PS & Barmer-III PS(except enhancement margin of 39.5 MW at 220 kV).

As informed with the previous application of M/s Renew Solar (App. No. 2200001550-300 MW), it was proposed to grant connectivity at 400 kV Barmer-IV PS through 400 kV S/c line for the combined capacity of 800 MW (300+200+300) with App. No. 2200001684(200 MW) as lead generator. M/s Renew agreed for the same.

It was informed that M/s Renew Solar has applied for connectivity of 200 MW which is more than the contracted capacity of LoA(150 MW). Regarding the grant of connectivity quantum higher than contracted capacity, there is an ongoing case filed by Axis Energy in Andhra Pradesh high court. Therefore, the connectivity of 200 MW shall be granted to M/s Renew Solar for the present application which shall be subject to outcome of the decision of Andhra Pradesh High Court in this regard.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
M/s Renew noted for the same. It was mentioned that with the grant of above connectivity of 200 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. M/s Renew noted for the same. It was mentioned that the transmission system for evacuation of power from Barmer-IV is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was also informed that M/s Renew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 31.01.2027. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s Renew noted for the same. Accordingly, it was agreed to grant connectivity of 200 MW to M/s Renew Solar Power Private Limited at 400 kV Barmer-IV PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Common Pooling Station for Renew Solar Power Private Limited RE Power Projects (App. No. 2200001550-300 MW, App. No. 2200001684-200 MW & App. No. 2200001689-300 MW)– Barmer-IV PS 400 kV S/c line (Suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no. of 400 kV bay at Barmer-IV PS end shall be under the scope of ISTS C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-II Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
6.	2200001689 (24-01-2025)	Renew Solar Power Private Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LoA or PPA	300	31.03.2027	Barmer PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil(Bay in sharing) • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Renew Solar Power Private Limited has applied for connectivity for 300 MW at Barmer PS. As informed with the previous applications of M/s Renew Solar (App. No. 2200001550-300 MW & App. No. 2200001684-200 MW), it was proposed to grant connectivity at 400 kV Barmer-IV PS through 400 kV S/c line for the combined capacity of 800 MW (300MW+200MW+300MW) with App. No. 2200001684(200 MW) as lead generator. M/s Renew agreed for the same.

It was mentioned that the transmission system for evacuation of power from Barmer-IV is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s Renew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 31.03.2027. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s Renew noted for the same.

Accordingly, it was agreed to grant connectivity of 300 MW to M/s Renew Solar Power Private Limited at 400 kV Barmer-IV PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA

M/s Renew Solar Power Pvt Ltd shall share the dedicated transmission system granted with App. No. 2200001684 mentioned as below:

- (i). Common Pooling Station for Renew Solar Power Private Limited RE Power Projects (App. No. 2200001550-300 MW, App. No. 2200001684-200 MW & App. No. 2200001689-300 MW)– Barmer-IV PS 400 kV S/c line (Suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end – **Under Applicant Scope**
- (ii). 1 no. of 400 kV bay at Barmer-IV PS end shall be under the scope of ISTS

C. Common Transmission System for Connectivity under GNA:As per Annexure-II

Start Date of Connectivity under GNA: 30.12.2031(Interim). Final date shall be confirmed upon award of the system

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
7.	2200001701 (28-01-2025)	Hexa Climate Solutions Private Limited	Nagaur distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW(Solar) 50 MW (BESS)	Land BG Route	300	30.11.2029	Merta III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: To be decided • Conn BG3: Rs. 2 lakh/MW
It was informed that Hexa Climate Solutions Private Limited has applied for connectivity of 300 MW at Merta-III PS. Further, another application for connectivity of 300 MW (BESS) by M/s Hexa Climate (App no. 2200001702-300 MW) at Merta-III PS is also being discussed in the present meeting. Accordingly, it was proposed to grant connectivity to M/s Hexa Climate at 400 kV Merta-III PS through 400 kV S/c line. Applicant was asked to confirm the 400 kV bay scope at Merta-III PS end & DTL tower configuration. M/s Hexa Climate Solutions Private Limited in the meeting requested to provide connectivity for both applications separately at 220 kV level. CTUIL suggested that for connectivity quantum of 600 MW 400 kV level shall be optimal considering DTL & RoW optimization. After meeting, it was decided that the request for connectivity at 220 kV is to be reviewed. Accordingly, both applications of M/s Hexa Climate at Merta-III PS shall be considered for discussion & grant in the next CMETS NR meeting. In the meantime M/s Hexa Climate may submit the technical justification for connectivity at 220 kV for above applications.										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
8.	2200001700 (28-01-2025)	Hexa Climate Solutions Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 50 MW (BESS)	Land BG Route	300	30.11.2029	Ramgarh II PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Hexa Climate Solutions Private Limited has applied for connectivity for 300 MW at Ramgarh-II PS. However, from the coordinates of the project provided in the application, it is observed that the project is in vicinity of Bhadla complex. Accordingly, it was proposed to grant connectivity at Bhadla-V PS through 220 kV S/c line. Applicant may confirm the scope of 220 kV line bay at Bhadla-V PS end & DTL tower configuration. CTUIL enquired M/s Hexa Climate the reason for mentioning Ramgarh-II PS as the nearest pooling station when their location is near Bhadla complex. Regarding this, M/s Hexa Climate informed that they are willing to get connectivity at Ramgarh-II PS not at Bhadla-IV PS. They have applied for connectivity in Land BG route. As the Ramgarh-II PS location is not yet finalized, the tentative coordinates of the project was mentioned in the application after considering the GIB area. CTUIL clarified that the details of nearest ISTS pooling station is an “optional entry” in the application. In case of wrong/multiple entries made in the details of nearest ISTS pooling station in application, CTUIL based on the project coordinates mentioned in the application shall identify the nearest pooling station for grant. Accordingly,										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
										as the location of coordinates mentioned by M/s Hexa Climate is close to Bhadla complex, it was proposed to grant connectivity at Bhadla-V PS through 220 kV S/c line. CTUIL also clarified that Ramgarh-II PS is currently under Planning shall be implemented in the same vicinity of Ramgarh area. After approval of the scheme, the tentative location of Ramgarh-II PS (~3 km) shall be finalized by the respective BPC during bidding process. Subsequently, the project implementing TSP shall finalize the actual location of Ramgarh-II PS within the boundary of 3 km of tentative location. As the Ramgarh complex is about 160 km from the coordinate mentioned in the application, the connectivity of Hexa Climate is technically not feasible to be granted at Ramgarh-II PS for this application. In case, Hexa Climate intends to obtain connectivity at Ramgarh complex, they may withdraw this application and submit a new application mentioning the location in Ramgarh complex. The same shall be taken up for grant at Ramgarh Complex as per application priority. M/s Hexa Climate informed that they prefer connectivity at Ramgarh-II PS. However, in case Ramgarh-II PS is not feasible due to location, they agreed for grant of connectivity at Bhadla-V PS. M/s Hexa Climate was asked to confirm the 220 kV bay scope at Bhadla-V PS end & DTL tower configuration. M/s Hexa Climate informed that 220 kV bay at Bhadla-V PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s Hexa Climate was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Hexa Climate agreed for the same. It was mentioned that that the transmission system for evacuation of power from Bhadla-V PS is presently under discussion. The scheme is currently tentative, which shall be finalized in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was informed that with the grant of above connectivity of 300 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. It was also informed that M/s Hexa Climate Solutions Private Limited has requested Start Date of Connectivity under GNA from 30.11.2029. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 30.09.2031 (interim). M/s Hexa Climate noted for the same. Accordingly, it was agreed to grant connectivity of 300 MW to M/s Hexa Climate Solutions Private Limited at 400 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s Hexa Climate Solutions Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Hexa Climate Solutions Private Limited RE Power Project– Bhadla-V PS 220 kV S/c line on D/c tower (suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end (ii). 1 no. of 220 kV bay at Bhadla-V PS end shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u>As per Annexure-III Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
9.	2200001717 (30-01-2025)	JIRE Green Energy Project Three Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 100 MW (BESS)	Land BG Route	200	31.12.2028	Ramgarh II PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: in sharing • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s JIRE Green Energy Project Three Limited has applied for connectivity for 200 MW at Ramgarh-II PS. Considering the connectivity quantum, it was proposed to grant connectivity at 220 kV Ramgarh-II PS in sharing with 220 kV bay granted to M/s RJS Renewable (App. No. 2200000782-150 MW). M/s JIRE Green agreed for the same. M/s RJS Renewable in the meeting informed that they have applied for additional connectivity of 150 MW in May'25. Accordingly, M/s RJS Renewable requested CTUIL not to grant the connectivity to JIRE Green in sharing. Regarding this, CTUIL clarified that connectivity is allocated as per application priority. Therefore, application of JIRE Green is having higher priority over the application of RJS Renewable filed in May'25 which is still under scrutiny. Further, considering the fact that the Ramgarh-II PS is on the verge of closure in the same meeting, for optimal utilisation of bays, it was proposed to grant connectivity to JIRE Green Energy in sharing at Ramgarh-II PS. RJS Renewable highlighted that 169 MW margin is still available at Ramgarh-II PS. Regarding this, CTUIL clarified that the 169 MW can be opted by any applicant at Ramgarh complex as per application priority. Therefore, in case the margin remains available for grant at the time of discussion of the new 150 MW application filed by RJS Renewable, then a decision can be taken at that point of time. However, at current stage the margin cannot be kept reserved in 220 kV bay. M/s RJS Renewable noted the same. It was mentioned that the transmission system for evacuation of power from Ramgarh-II PS is presently under discussion. The scheme is currently tentative, which										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
shall be finalized in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was informed that with the grant of above connectivity of 200 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed in such cases. M/s RJS renewable and M/s JIRE Green shall be required to sign sharing agreement within stipulated time in this regard. It was also informed that M/s JIRE Green Energy Project Three Limited has requested Start Date of Connectivity under GNA from 31.12.2028. However, considering the same and expected commissioning date of transmission system (i.e. 31.10.2030), the start date of Connectivity under GNA shall be 31.10.2030 (interim). M/s JIRE Green noted the same. Accordingly, it was agreed to grant connectivity of 200 MW to M/s JIRE Green Energy Project Three Limited at 220 kV Ramgarh-II PS. Details of Transmission system for connectivity of M/s JIRE Green Energy Project Three Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> <u>A. Associated Transmission System (ATS):</u> NIL <u>B. Dedicated Transmission System for Connectivity under GNA:</u> JIRE Green Energy Project Three Limited shall share the dedicated transmission system of M/s RJS Renewable Private Limited for connectivity of 150 MW under App No. 2200000782: (i). M/s RJS Renewable Pvt. Ltd. RE Power Project – Ramgarh-II PS 220 kV S/c line on D/c tower(Suitable to carry minimum 350 MW at nominal voltage) along with associated bay at generation end - Under the scope of M/s RJS Renewable Private Limited (ii). 1 no. of 220 kV bay at Ramgarh-II PS shall be under the scope of ISTS (iii). Infrastructure required for sharing dedicated transmission system – under the scope of M/s JIRE Green Energy Project Three Limited <u>C. Common Transmission system for Connectivity under GNA:</u> As per Annexure-IV Start Date of Connectivity under GNA: 31.10.2030(Interim). Final date shall be confirmed upon award of the system										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
10.	2200001702 (28-01-2025)	Hexa Climate Solutions Private Limited	Nagaur distt., Rajasthan	Standalone ESS	BESS 300 MW	Land BG Route	300 (Max injection:300MW for 4 hrs, Max Drawl: 300 MW for 4 hrs)	30.11.2029	Merta III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: to be decided • Conn BG3: Rs. 2 lakh/MW

It was informed that Hexa Climate Solutions Private Limited has applied for connectivity of its 300 MW BESS project at Merta-III PS. As informed with the previous application of M/s Hexa Climate (App. No. 2200001701), it was proposed to grant connectivity to M/s Hexa Climate at 400 kV Merta-III PS through 400 kV S/c line with App. No. 2200001701 as lead generator.

As deliberated earlier, M/s Hexa Climate Solutions Private Limited in the meeting requested to provide connectivity for both applications separately at 220 kV level of Merta-III PS. CTUIL suggested that for connectivity quantum of 600 MW 400 kV level shall be optimal considering DTL & RoW optimization.

However, after meeting, it was decided that the request for connectivity at 220 kV is to be reviewed. Accordingly, both applications of M/s Hexa Climate at Merta-III PS shall be considered for discussion & grant in the next CMETS NR meeting. In the meantime M/s Hexa Climate may submit the technical justification for connectivity at 220 kV for above applications.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
11.	2200001721 (31-01-2025)	Tata Power Renewable Energy Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	31.03.2027	Bikaner V PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs 3 Cr • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Tata Power Renewable Energy Limited has applied for connectivity for 300 MW at Bikaner-V PS. However, there is no margin available at Bikaner-V PS (except for enhancement of 170 MW at 220 kV bay allocated to M/s Juniper Green Energy-130 MW). Accordingly, it was proposed to grant connectivity at the proposed Bikaner-VI PS through a 220 kV S/c line. M/s Tata power agreed for the same.

M/s Tata Power was asked to confirm the 220 kV bay scope at Bikaner-VI PS end & DTL tower configuration. M/s Tata Power informed that 220 kV bay at Bikaner-VI PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s Tata Power was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Tata Power agreed for the same.

It was mentioned that the transmission system for evacuation of power from Bikaner-V PS is presently under evolution. Upon evolution, the scheme shall be finalized in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
It was also informed that M/s Tata Power Renewable Energy Limited has requested Start Date of Connectivity under GNA from 31.03.2027. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). Transmission system for connectivity of M/s Tata Power Renewable Energy Limited under GNA is as below: Accordingly, it was agreed to grant connectivity of 300 MW to M/s Tata Power Renewable at 220 kV Bikaner-IV PS. Details of Transmission system for connectivity of M/s Tata Power Renewable Energy Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Tata Power Renewable Energy Limited RE Power Project – Bikaner-VI PS 220 kV S/c line on D/c tower (suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end (ii). 1 no. of 220 kV bay at Bikaner-VI PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u>As per Annexure-I Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
12.	2200001722 (31-01-2025)	Tata Power Renewable Energy Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	31.03.2027	Fatehgarh II PS	• Not Applicable

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
It was informed that M/s Tata Power Renewable Energy Limited has applied for connectivity for 300 MW at Fatehgarh-II PS. However, there is no margin available for grant at Fatehgarh-II PS. Further, there is no margin available at any other pooling station in Fatehgarh-Barmer complex except at the proposed Barmer-IV PS. Accordingly, it was proposed to grant connectivity at proposed Barmer-IV PS through 220 kV S/c line. Ms. Tata power in the meeting informed that they wish to withdraw the above application. Subsequently, M/s Tata power vide mail dated 03.06.2025 confirmed their decision to withdraw the above application. Accordingly, it was decided to close the above application as per GNA Regulations.										

A2. Applications for Connectivity to ISTS under CERC (Connectivity and General Network Access to the inter-State Transmission System) Regulations, 2022 received in Feb'25:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)
1.	2200001735 (04-02-2025)	Waaree Forever Energies Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar) 300 MW (Wind)	Land BG Route	600	31-07-2030	Ramgarh Complex Ramgarh-II
2.	2200001749 (10-02-2025)	Solarcraft Power India 4 Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	50 MW (Solar)	Land Route	50	01-09-2028	Bhadla-III PS
3.	2200001762 (13-02-2025)	Green Infra Renewable Energy Farms Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	15-12-2028	Sanchole PS
4.	2200001769 (14-02-2025)	BN Peak Power-3 Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	150 MW (Solar) 200 MW (Wind) 100 MW(BESS)	Land BG Route	350	30-06-2028	Ramgarh PS/ Ramgarh-II PS
5.	2200001771 (14-02-2025)	Green Infra Renewable Energy Farms Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	15-12-2028	Sanchole PS
6.	2200001781 (18-02-2025)	ReNew Solar Power Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 70 MW (BESS)	LOA or PPA	200	31-03-2027	Bhadla-III PS
7.	2200001786 (20-02-2025)	Adyant Enersol Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	150 MW (Solar)	LOA or PPA	150	30-04-2027	Bikaner V PS
8.	2200001797 (27-02-2025)	ACME Taurus Urja Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land Route	300	31/03/2027	Bikaner-V PS
9.	2200001798 (28-02-2025)	Apraava Energy Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	600 MW (Solar)	Land BG Route	600	31-12-2028	Bikaner ISTS Complex

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
1.	2200001735 (04-02-2025)	Waaree Forever Energies Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar) 300 MW (Wind)	Land BG Route	600	31-07-2030	Ramgarh-II PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs 6 Cr • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Waaree Forever Energies Private Limited has applied for connectivity for 600 MW at Ramgarh-II PS. However, it was mentioned that connectivity of about 4347 MW is already granted at Ramgarh-II PS(including the connectivity applications proposed at Ramgarh-II in this meeting). Further, about 884 MW of connectivity at Ramgarh PS is granted with evacuation system of Ramgarh-II HVDC system. Therefore, a total connectivity of about 5231 MW is granted with Ramgarh-II HVDC system against 6000 MW capacity. Therefore, there is margin remaining of about 769 MW at Ramgarh-II PS. Accordingly, considering the connectivity quantum, it was proposed to grant connectivity at proposed Ramgarh-II PS at 400 kV through S/c line. M/s Waaree Forever Energies was asked to confirm the 400 kV bay scope at Ramgarh-II PS end & DTL tower configuration. M/s Waaree Forever Energies informed that 400 kV bay at Ramgarh-II PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s Waaree Forever Energies was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Waaree Forever Energies agreed for the same. It was mentioned that the transmission system for evacuation of power from Ramgarh-II PS is presently under evolution. Upon evolution, the scheme which is currently tentative, shall be discussed and finalized in joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was also informed that M/s Waaree Forever Energies Private Limited has requested Start Date of Connectivity under GNA from 31.07.2030. However, considering the same and expected commissioning date of transmission system (i.e. 31.10.2030), the start date of Connectivity under GNA shall be 31.10.2030 (interim). M/s Waaree Forever Energy noted the same Accordingly, it was agreed to grant connectivity of 600 MW to M/s Waaree Forever Energies at 400 kV Ramgarh-II PS. Details of Transmission system for connectivity of M/s Waaree Forever Energies Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Waaree Forever Energies Private Limited RE Power Project– Ramgarh-II PS 400 kV S/c line on D/c tower (Suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end (ii). 1 no. of 400 kV Bay at Ramgarh-II PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u>As per Annexure-IV										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	--------------------	------------------------	---------------------------	---	--	----------------------

Start Date of Connectivity under GNA: 31.10.2030(Interim). Final date shall be confirmed upon award of the system

It was informed that with this grant of 600 MW to M/s Waaree Forever Energies, total connectivity granted at Ramgarh-II PS is about 4947 MW. Further, considering 884 MW connectivity granted at Ramgarh PS with Ramgarh-II HVDC system, total connectivity granted with Ramgarh HVDC (6000 MW capacity) is about 5831 MW. Therefore, Ramgarh-II PS shall be closed for further grant of connectivity except enhancement upto 169 MW. Subsequent applications received at Ramgarh complex shall be considered for grant at Ramgarh-III PS.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
2.	2200001749 (10-02-2025)	Solarcraft Power India 4 Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	50 MW (Solar)	Land Route	50	01-09-2028	Bhadla-III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil (in sharing) • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Solarcraft Power India 4 Private Limited has applied for connectivity for 50 MW at Bhadla-III PS. There is margin of 50 MW available at Bhadla-III PS at 220 kV bay allocated to M/s Solarcraft Power with already granted connectivity of 160 MW (110+50). Accordingly, it was proposed to grant connectivity at Bhadla-III PS through already allocated 220 kV S/c line. M/s Solarcraft agreed to the same.

It was mentioned that initially 310 MW(150+110+50) of connectivity was granted to M/s Solarcraft at Bhadla-III PS. Subsequently, 150 MW application of M/s Solarcraft (App. No. 2200000152) was shifted to Bhadla-II PS in the reallocation meeting. Accordingly, DTL configuration mentioned in the intimations of 110 MW(App. No. 2200000192) & 50 MW(App. No. 2200000300) are also required to be amended. Accordingly, the above amendments in intimation of M/s Solarcraft shall be issued after the grant of present application.

It was also informed that M/s Solarcraft Power India 4 Private Limited has requested Start Date of Connectivity under GNA from 01.09.2028. However, considering the same and expected commissioning date of transmission system (i.e. 20.07.2029), the start date of Connectivity under GNA shall be 20.07.2029 (interim). Transmission system for connectivity of M/s Solarcraft Power India 4 Private Limited under GNA is as below:

Accordingly, it was agreed to grant connectivity of 50 MW to M/s Solarcraft Power India 4 Private Limited at 400 kV Bhadla-III PS. Details of Transmission system for connectivity of M/s Solarcraft Power India 4 Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	-------------------------	------------------------	---------------------------	---	--	----------------------

B. Dedicated Transmission System for Connectivity under GNA:

M/s Solarcraft Power India 4 Pvt. Ltd. shall share the dedicated transmission system granted for connectivity of M/s Solarcraft Power India 4 Pvt. Ltd under application No. 220000192:

- Common Pooling station of M/s Solarcraft Power India 4 Pvt. Ltd. RE Power Projects (App. No. 2200000192-110 MW, App. No. 2200000300-50 MW & App. No. 2200001749-50 MW) – Bhadla-III PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with the 220 kV bay at generation end as well as Bhadla-III PS end – **Under Applicant Scope**

C. Common Transmission System for Connectivity under GNA: As per Annexure-VI

Start Date of Connectivity under GNA: 20.07.2029 (Interim). Final date shall be confirmed upon award of all elements of system

It was informed that with the grant of 50 MW connectivity to Solarcraft at Bhadla-III PS, total connectivity granted at Bhadla-III PS is 6500 MW. As Bhadla-III PS was planned for evacuation of 6500 MW, Bhadla-III PS shall be closed for further grant including enhancements.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
3.	2200001762 (13-02-2025)	Green Infra Renewable Energy Farms Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	15-12-2028	Sanchoe PS	- Conn BG1: Rs. 50 Lakh - Conn BG2: To be decided - Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Green Infra Renewable Energy Farms Private Limited has applied for connectivity of 300 MW at Sanchoe PS. Further, another application (App. No. 2200001771) for 300 MW by M/s Green Infra Renewable Energy Farms Private Limited for 300 MW is also being taken up for grant in the present meeting. Accordingly, it is proposed to grant connectivity at Sanchoe PS at 400 kV level through 400 kV S/c line for combined capacity of 600 MW considering DTL & RoW optimization.

M/s Green Infra informed that two applications were intentionally submitted for two distinct projects to ensure optimal evacuation sizing and commercial flexibility. Shift to a 400 kV switchyard would increase the levelized cost of electricity, undermining the project competitiveness and M/s Green Infra requested CTUIL to grant connectivity at 220 kV level through 2 nos. separate line bays.

CTUIL enquired M/s Green Infra that the two applications submitted by M/s Green Infra are having same coordinates. Considering that, the connectivity is proposed at 400 kV for the combined capacity of 600 MW. Regarding this, M/s Green Infra informed that the tentative PSS coordinates provided during application were indicative only, as per the land BG route. However, following due diligence, it was found that land in Sanchoe is fragmented and non-contiguous.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
After deliberations, it was decided that the above application & App. No. 2200001771(300 MW) by Green Infra shall be taken up for discussion in the next CMETS NR meeting. However, in the meantime M/s Green Infra was asked to submit technical justification for grant of connectivity at 220 kV level.										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
4.	2200001769 (14-02-2025)	BN Peak Power-3 Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	150 MW (Solar) 200 MW (Wind) 100 MW (BESS)	Land BG Route	350	30-06-2028	Ramgarh PS/ Ramgarh-II PS	•Conn BG1: Rs. 50 Lakh •Conn BG2: Rs 3 cr •Conn BG3: Rs. 2 lakh/MW

It was informed that M/s BN Peak Power-3 Private Limited has applied for connectivity for 350 MW at Ramgarh-II PS. However, it was informed that connectivity of 4947 MW is already granted at Ramgarh-II PS(including the connectivity applications agreed for grant at Ramgarh-II in the present meeting). Further, about 884 MW of connectivity at Ramgarh PS is granted with evacuation system of Ramgarh-II HVDC system. Therefore, a total connectivity of about 5831 MW is granted with Ramgarh-II HVDC system against 6000 MW capacity. Therefore, there is margin remaining of only about 169 MW at Ramgarh-II PS. Accordingly, considering the connectivity quantum of 350 MW, it was proposed to grant connectivity at proposed Ramgarh-III PS at 220 kV through S/c line. M/s BN Peak agreed for the same

M/s BN Peak Power-3 was asked to confirm the 220 kV bay scope at Ramgarh-III PS end & DTL tower configuration. M/s BN Peak Power-3 informed that 220 kV bay at Ramgarh-III PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. Same was noted & M/s BN Peak Power-3 was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s BN Peak Power-3 agreed for the same.

M/s BN Peak Power-3 informed that they had applied for connectivity at Ramgarh-II PS. As they are being granted at Ramgarh-III PS, M/s BN Peak Power-3 enquired whether they can get an opportunity to shift to Ramgarh-II PS in case of any withdrawal or cancellation of connectivity at Ramgarh-II PS. Regarding this, CTUIL informed that in case of withdrawal/relinquishment/revocation, the vacated margin shall be considered for reallocation to applicant/grantees in next pooling station as per application priority. M/s BN Peak Power-3 noted the same.

It was mentioned that the transmission system for evacuation of power from Ramgarh-III PS is presently under evolution. Upon evolution, the scheme which is currently tentative, shall be discussed and finalized in joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was informed that with the grant of above connectivity of 350 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed.

It was also informed M/s BN Peak Power-3 Private Limited has requested Start Date of Connectivity under GNA from 30.06.2028. However, considering the same

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s BN Peak Power-3 Private Limited noted the same. Accordingly, it was agreed to grant connectivity of 350 MW to M/s BN Peak Power-3 Private Limited at 220 kV Ramgarh-III PS. Details of Transmission system for connectivity of M/s BN Peak Power-3 Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> i. BN Peak Power-3 Private Limited RE Power Project– Ramgarh-III PS 220 kV S/c line on D/c tower (Suitable to carry minimum 350 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope ii. 1 no. of 220 kV Bay at Ramgarh-III PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u>As per Annexure-V Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
5.	2200001771 (14-02-2025)	Green Infra Renewable Energy Farms Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land BG Route	300	15-12-2028	Sanchoe PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: To be decided • Conn BG3: Rs. 2 lakh/MW
As decided during the discussion of previous application (App. No. 2200001762(300 MW), both the applications by M/s Green Infra shall be taken up for discussion in the next CMETS NR meeting. However, in the meantime M/s Green Infra was asked to submit technical justification for grant of connectivity at 220 kV level.										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
6.	2200001781 (18-02-2025)	ReNew Solar Power Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	200 MW (Solar) 70 MW (BESS)	LOA or PPA	200	31-03-2027	Bhadla-III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil(Bay in sharing) • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s ReNew Solar Power Private Limited has applied for connectivity for 200 MW at Bhadla-III PS. However, there is no margin of 200 MW at Bhadla-III PS(considering margin of 50 MW proposed to be granted to M/s solarcraft in this meeting). Further, as informed in the 36th CMETS NR meeting, with grant of 5825 MW connectivity at Bhadla-IV PS, Bhadla-IV PS is closed for grant of additional connectivity except enhancements (upto 175 MW).

It was also informed that that M/s Renew has filed additional applications for cumulative connectivity quantum of 600 MW at Bhadla complex(App. No. 2200001864-300 MW & App. No. 2200001865-300 MW) which are also being taken up for discussion in the same meeting. Accordingly, it was proposed to grant connectivity at Bhadla-V PS through 400 kV S/c line for the combined capacity of 800 MW(200MW+300MW+300MW).M/s Renew agreed for the same.

Applicant was asked to confirm the scope of 400 kV line bay at Bhadla-V PS end ,DTL tower configuration & lead application. In this regard, M/s Renew vide mail dated 30.05.2025 informed that the connectivity App. No. 220001865 may be considered as lead generator and also confirmed that 400 kV bay at Bhadla-V PS shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted.

It was mentioned that that M/s Renew Solar has applied for connectivity of 200 MW which is more than the contracted capacity of LoA(150 MW). Regarding the grant of connectivity quantum higher than contracted capacity, there is an ongoing case filed by Axis Energy in Andhra Pradesh high court. Therefore, the connectivity of 200 MW shall be granted to M/s Renew Solar for the present application which shall be subject to outcome of the decision of Andhra Pradesh High Court in this regard. M/s Renew noted the same.

It was also informed that with the grant of above connectivity of 200 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed.

It was mentioned that the transmission system for evacuation of power from Bhadla-V PS is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s ReNew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 31.03.2027. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 30.09.2031(interim). M/s Renew noted the same.

Accordingly, it was agreed to grant connectivity of 200 MW to M/s Renew Solar Power Private Limited at 400 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below:

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
<u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> M/s Renew Solar Power Private Limited shall share the dedicated transmission system granted with App. No. 2200001865: i. Common Pooling Station for ReNew Solar Power Private Limited RE Power Projects(App. No. 2200001781-200 MW, App. No. 2200001864-300 MW & , App. No. 2200001865-300 MW) – Bhadla-V PS 400 kV S/c line on D/c tower (suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end -Under Applicant Scope ii. 1 no of 400 kV bay at Bhadla-V PS is under ISTS C. <u>Common Transmission system for Connectivity under GNA:</u> As per Annexure-III										
Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity location(As per Application)	Conn BGs requirement
7.	2200001786 (20-02-2025)	Adyant Enersol Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	150 MW (Solar)	LOA or PPA	150	30-04-2027	Bikaner V PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil(Bay in sharing) • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Adyant Enersol Private Limited has applied for connectivity for 150 MW at Bikaner-V PS. There is margin available at Bikaner-V PS at 220 kV bay allocated to M/s Juniper Green Energy (App. No. 2200001210 – 130 MW). Accordingly, it was proposed to grant connectivity to M/s Adyant Enersol at 220 kV Bikaner-V PS in sharing with M/s Juniper Green Energy(App. No. 2200001210-130 MW). M/s Adyant Enersol agreed for the same. It was mentioned that the transmission system for evacuation of power from Bikaner-V PS is presently under discussion. The scheme is currently tentative, which shall be finalized in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. M/s Adyant and M/s Juniper Green shall be required to sign sharing agreement within stipulated time in this regard. M/s Adyant Enersol Private Limited noted the same.										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity location(As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	--------------------	------------------------	---------------------------	---	---	----------------------

It was also informed that M/s Adyant Enersol Private Limited has requested Start Date of Connectivity under GNA from 30.04.2027. However, considering the same and expected commissioning date of transmission system (i.e. 31.10.2030), the start date of Connectivity under GNA shall be 31.10.2030 (interim). M/s Adyant Enersol Private Limited noted the same.

Accordingly, it was agreed to grant connectivity of 150 MW to M/s Adyant Enersol Private Limited at 220 kV Bikaner-V PS in sharing. Details of Transmission system for connectivity of M/s Adyant Enersol Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA:

M/s Adyant Enersol Private Limited shall share the dedicated transmission of for connectivity granted to M/s Juniper Green Energy Pvt. Ltd. under App. No. App. No. 2200001210 – 130 MW:

- (i). M/s Juniper Green Energy Pvt. Ltd RE Power Project(App. No. 2200001210-130 MW) – Bikaner-V PS 220 kV S/c line on D/c tower(Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – **Under the scope of M/s Juniper Green Energy Limited**
- (ii). 1 no. of 220 kV bay at Bikaner-V PS under ISTS
- (iii). Infrastructure required for sharing dedicated transmission system – **Under the scope of M/s Adyant Enersol Private Limited**

C. Common Transmission System for Connectivity under GNA: As per Annexure-VIII

Start Date of Connectivity under GNA: 31.10.2030(Interim). Final date shall be confirmed upon award of the system.

It was informed that with this grant of 150 MW to M/s Adyant Enersol, total connectivity granted at Bikaner-V PS shall be 5980 MW. As Bikaner-V PS is being planned for evacuation of 6000 MW through HVDC, Bikaner-V PS shall be closed for further grant except enhancements (upto 20 MW).

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
8.	2200001797 (27-02-2025)	ACME Taurus Urja Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	Land Route	300	31-03-2027	Bikaner-V PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: As per bay scope • Conn BG3: Rs. 2 lakh/MW

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
M/s ACME Taurus Urja Private Limited has applied for connectivity for 300 MW at Bikaner-V PS. However, as discussed earlier, Bikaner-V PS is already closed for grant of connectivity (after proposed grant of M/s Adyant: 150MW). Accordingly, the application shall be considered for grant at Bikaner-VI PS. However, it was informed that the total potential declared by MNRE in Bikaner complex is about 26.8 GW. Considering the connectivity granted at Bikaner Complex, the subject application is beyond the 26.8 GW potential. A feedback from MNRE is being sought w.r.t. max potential to be considered in the area. In the 29th NCT meeting held on 16.04.2025 wherein after deliberations, it was decided that the transmission schemes for the quantum beyond the potential already declared by MNRE/SECI will be taken up for approval only after assessment and declaration of such additional potential by MNRE. Therefore, the above application for connectivity shall be considered for grant after assessment and declaration of such additional potential by MNRE at Bikaner Complex.										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity location (As per Application)	Conn BGs requirement
9.	2200001798 (28-02-2025)	Apraava Energy Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	600 MW (Solar)	Land BG Route	600	31-12-2028	Bikaner ISTS Complex	• Conn BG1: Rs. 50 Lakh • Conn BG2: As per bay scope • Conn BG3: Rs. 2 lakh/MW
M/s Apraava Energy Private Limited has applied for connectivity for 600 MW at Bikaner-V PS. However, Bikaner-V PS is already closed for grant of connectivity. Accordingly, the application shall be considered for grant at Bikaner-VI PS. However, it was informed that the total potential declared by MNRE in Bikaner complex is about 26.8 GW. Considering the connectivity granted at Bikaner Complex, the subject application is beyond the 26.8 GW potential. A feedback from MNRE is to be sought w.r.t. max potential to be considered in the area. In the 29th NCT meeting held on 16.04.2025 wherein after deliberations, it was decided that the transmission schemes for the quantum beyond the potential already declared by MNRE/SECI will be taken up for approval only after assessment and declaration of such additional potential by MNRE. Therefore, the above application for connectivity shall be considered for grant after assessment and declaration of such additional potential by MNRE at Bikaner Complex.										

A3. Applications for Addition of Generation Capacity within the Quantum of Connectivity Granted under Regulation 5.2 in Jan'25

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
1.	2200001677 (21.01.2025)	Juniper Green Stellar Private Limited	Barmer distt., Rajasthan	Generator (Hybrid)	0412100009 (150 MW)	Fatehgarh-IV PS (Sec-I)	127.5 MW Solar: 50 MW, Wind: 50 MW, ESS: 27.5 MW	30.04.2026

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
2.	2200001678 (21.01.2025)	Juniper Green Stellar Private Limited	Barmer distt., Rajasthan	Generator (Hybrid)	0412100010 (150 MW)	Fatehgarh-IV PS (Sec-I)	97.5 MW Solar: 50 MW Wind: 20 MW ESS: 27.5 MW	30.04.2026

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
1.	2200001677 (21.01.2025)	Juniper Green Stellar Private Limited	Barmer distt., Rajasthan	Generator (Hybrid)	0412100009 (150 MW)	Fatehgarh-IV PS (Sec-I)	127.5 MW (Solar: 50 MW, Wind: 50 MW, ESS: 27.5 MW)	30.04.2026

It was informed that M/s Juniper Green Stellar Private Limited (JGSPL) has applied for addition of generation capacity (127.5 MW(50 MW Solar, 50 MW Wind & 27.5 MW ESS)) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Fatehgarh-IV PS(Sec-I) under App. Nos. 0412100009(150 MW). M/s Juniper may provide information regarding ESS rating in terms of energy capacity (MWh).

As per GNA Regulations, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (Appl. No. 0412100009(150 MW). Further, M/s JGSPL (Appl. No. 0412100009) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances at the earliest so as to provide sufficient time for ensuring necessary compliances. M/s Juniper noted the same.

Further, M/s JGSPL has requested Start Date of additional generation capacity from 30.04.2026. Considering the same, it was agreed to grant the above addition of capacity within the same connectivity quantum under regulation 5.2 of GNA Regulations with start date of 30.04.2026 as requested. However, it may be noted that the start date shall be subject to availability of Transmission system for connectivity granted to Appl. No. 0412100009(150 MW).

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
2.	2200001678 (21.01.2025)	Juniper Green Stellar Private Limited	Barmer distt., Rajasthan	Generator (Hybrid)	0412100010 (150 MW)	Fatehgarh-IV PS (Sec-I)	97.5 MW (Solar: 50 MW Wind: 20 MW, ESS: 27.5 MW)	30.04.2026

It was informed that M/s Juniper Green Stellar Private Limited(JGSPL) has applied for addition of generation capacity(97.5 MW(50 MW Solar, 20 MW Wind & 27.5 MW ESS)) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Fatehgarh-IV PS(Sec-I) under App. No. 0412100010(150 MW) M/s Juniper may provide information regarding ESS rating in terms of energy capacity (MWh).

M/s JGSPL shall note that as per GNA Regulations, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (App. No. 0412100010(150 MW). Further, M/s JGSPL (App. No. 0412100010) shall be responsible for compliance with the Grid

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances at the earliest so as to provide sufficient time for ensuring necessary compliances. Further, M/s JGSPL has requested Start Date of additional generation capacity from 30.04.2026. Considering the same, it was agreed to grant the above addition of capacity within the same connectivity quantum under regulation 5.2 of GNA Regulations with start date of 30.04.2026 as requested. However, it is to note that the start date shall be subject to availability of Transmission system for connectivity granted to App. No. 0412100010(150 MW).								

A4. Application for grant of GNA_{RE} received in the month of Jan'25

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA _{RE} within Region (MW)	GNA _{RE} outside Region (MW)	Total GNA _{RE} Required (MW)	Start date of GNA _{RE}	End date of GNA _{RE}
1.	2200001714 (31-01-2025)	Aman Hospitality Private Limited	Drawee entity connected to Intra State Transmission System	2.5	0	2.5	01.04.2025	31.03.2050

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA _{RE} within Region (MW)	GNA _{RE} outside Region (MW)	Total GNA _{RE} Required (MW)	Start date of GNA _{RE}	End date of GNA _{RE}
1.	2200001714 (31-01-2025)	Aman Hospitality Private Limited	Drawee entity connected to Intra State Transmission System	2.5	0	2.5	01.04.2025	31.03.2050

It was informed that M/s Aman Hospitality Private Limited has applied for GNA_{RE} of 2.5 MW (Outside the region) as a drawee entity connected to Intra State Transmission System of Delhi Transco Limited(DTL) at 33kV level of BSES Yamuna Karkardooma S/s. M/s Aman Hospitality has also submitted necessary NoC from DTL(STU) for grant of GNA_{RE}. Accordingly, it was proposed to grant 2.5 MW of GNA_{RE} (outside the region) to Aman Hospitality Private Limited.

It was also informed that Aman Hospitality has requested for Start date from 01.04.2025. However, as the date has already passed and considered the time required for issuance of minutes of meeting and intimation, it is requested from M/s Aman Hospitality to suggest a new Start Date for GNA_{RE}.

M/s Aman hospitality in the meeting requested to revise the start date of GNA_{RE} to 15th Oct'2025. Same was confirmed by applicant through mail vide dated 05.06.25. Accordingly, it was agreed to grant GNA_{RE} to M/s Aman Hospitality with Start Date from 15.10.2025 as requested.

A5. Application for grant of GNA received in the month of Jan'25

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
1.	2200001663 (16.01.2025)	Indian Railways	Drawee entity connected to Intra State Transmission System	0	5	5	01.03.2025	30.09.2049
2.	2200001656 (27.01.2025)	Indian Railways	Bulk consumer seeking to connect to ISTS directly	0	50	50	01.02.2025	31.01.2055
3.	2200001695 (27.01.2025)	Vedanta Limited	Bulk consumer seeking to connect to ISTS directly	0	100	100	31.12.2027	31.12.2052

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
1.	2200001663 (16.01.2025)	Indian Railways	Drawee entity connected to Intra State Transmission System	0	5	5	01.03.2025	30.09.2049

It was informed that M/s Indian Railways has applied for GNA of 5 MW (Outside the region) as a drawee entity connected to Intra State Transmission System of Delhi Transco Limited(DTL) at 12 drawl points with voltage level 66kV and 11kV. M/s Indian Railways has also submitted necessary NoC from DTL(STU) for grant of GNA_{RE}. Accordingly,, it was proposed to grant 5 MW of GNA (outside the region) to Indian Railways.

Further, M/s Indian Railways has requested for Start date from 01.03.2025. However, as the date has already passed and considered the time required for issuance of minutes of meeting and intimation, it was requested from M/s Indian Railways to suggest a new Start Date for GNA. M/s Indian railways suggested the start date from 15.06.2025. Accordingly, it was agreed to grant GNA_{RE} to M/s Indian Railways tentatively with Start Date from 15.06.2025 as requested or the earliest applicable start date on processing completion

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
2.	2200001656 (27.01.2025)	Indian Railways	Bulk consumer seeking to connect to ISTS directly	0	50	50	01.02.2025	31.01.2055

It was informed that M/s Indian Railways has applied for GNA of 50 MW (Outside the region) as a Bulk consumer seeking to connect to ISTS. As per 18.1 of GNA Regulations 2022, Indian Railways(Railways-NR-ISTS-UP) is granted GNA of 130 MW for ISTS drawl at ISTS interface at Auraiya and Dadri. Subsequently, CERC in its suo motto order dated 01.10.2023 on petition no. 15/SM/2023 has clarified that Railways shall be allowed to utilize its GNA quantum of 130 MW for cumulative drawl at Dadri, Auraiya, Naini & Abdullapur. Further, in case it needs additional GNA, it may apply for such quantum under the GNA Regulations.

Now Indian railways had applied for additional GNA of 50 MW as a Bulk consumer for drawl from Naini(Allahabad). However, there are constraints in 400/220 kV ICTs at Allahabad(PG) S/s for drawl of power. The ICTs at Allahabad (PG) are currently N-1 non-compliant which is also highlighted by Grid India in Operational feedback reports. To address the N-1 non-compliance of Allahabad(PG) ICTs, the augmentation of 1x500 MVA(4th) ICT at Allahabad (PG) S/s is already awarded to Powergrid

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
by CTUIL. As per the latest JCC meeting, Allahabad ICT is expected to be commissioned by 30.06.2025. Powergrid in the meeting informed that the ICT at Allahabad is under implementation and is expected to be commissioned on 30.09.2025. Accordingly, 50 MW of GNA(outside the region) to Indian Railways for drawl of power from ISTS network can be granted with the above augmentation of ICT at Allahabad(PG) S/s. Indian Railways in the application has requested for Start date of GNA from 01.02.2025. However, considering the expected commissioning date of ICT(4th) at Allahabad (i.e. 30.09.2025), it was proposed to grant GNA with Start date from 30.09.2025(subject to commissioning of Allahabad ICT). M/s Indian railways agreed for the same. It was also informed that, as per 22.2(b-i) of GNA Regulations, following Conn BGs are to be submitted by M/s Indian Railways within 30 days of issuance of intimation by CTUIL. • Conn BG1: Rs. 50 lakh • Conn BG3: Rs. 2 lakh/MW M/s Indian Railways noted the same. Accordingly, it was agreed to grant 50 MW GNA to M/s Indian Railways with Start Date from 30.09.2025 (subject to commissioning of Augmentation of ICT at Allahabad(PG)).								

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
3.	2200001695 (27.01.2025)	Vedanta Limited	Bulk consumer seeking to connect to ISTS directly	0	100	100	31.12.2027	31.12.2052
It was informed that Vedanta Limited has applied for GNA of 100 MW(Outside the Region) for its Mangala Processing Terminal(MPT) which is presently connected to intra-state Barmer S/s(RVPN) through S/c line. As the project is already connected to STU network, considering the fact that there is no provision of dual connectivity to Bulk consumer under extant regulations, it is necessary to submit NoC from STU for disconnection from the state network for grant of GNA with connection to ISTS grid. M/s Vedanta in the letter submitted with the application has informed that <i>“As per the current plans, Vedanta intends to surrender the existing connection with the Rajasthan State Transmission Utility (STU) and transit the load to the Central Transmission Utility (CTU). The 100MW Grant of Connectivity (GNA) application pertains to the same unit currently connected to the Rajasthan STU. The present plant load is 84MW. With the addition of upcoming loads, the total power requirement is</i>								

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA within Region (MW)	GNA outside Region (MW)	Total GNA Required (MW)	Start date of GNA	End date of GNA
<i>expected to increase to approximately 120MW. Hence this 100MW requirement is over & above the existing approved GNA_{RE} of 25MW under application Id: 2200001265”.</i> Regarding this, CTUIL clarified that 25 MW of GNA_{RE} is granted to Vedanta under App. No. 1200001265 as a drawee entity connected to intra state transmission system (entity under 17.1(ii)). If M/s Vedanta intends to disconnect from intra state network for the purpose of direct interconnection with ISTS, then the 25 MW GNA_{RE} granted to M/s Vedanta as a drawee entity connected to intra state network need to be relinquished first and apply fresh GNA/GNA_{RE} application as a Bulk Consumer seeking direct ISTS connection (entity under 17.1(iii)). Further, it is to mention that 25 MW of GNA_{RE} is already granted to Vedanta for the same unit (MPT). As per 20.5 & 20.6 of GNA Regulations, same entity cannot be granted both GNA & GNA_{RE}. Accordingly, this application for 100 MW GNA by M/s Vedanta Ltd. cannot be considered for grant at this stage when the 25 MW GNA_{RE} granted to M/s Vedanta Ltd. for same unit is currently effective. M/s Vedanta in the meeting informed that they shall withdraw this application and the same shall be confirmed in mail. M/s Vednata also informed that they shall relinquish the GNA_{RE} already granted as an intra state entity and apply for the entire quantum of GNA. However, no communication has been received from M/s Vedanta in this regard. Accordingly, it was decided to take up the matter for discussion again in the next CMETS NR meeting.								

A6. Application for grant of GNA_{RE} received in the month of Feb’25

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA _{RE} within Region (MW)	GNA _{RE} outside Region (MW)	Total GNA _{RE} Required (MW)	Start date of GNA _{RE}	End date of GNA _{RE}
1.	2200001595 (06-02-2025)	Hindustan Zinc Limited	Bulk consumer seeking to connect to ISTS directly	5.0	215.0	220	30- 06- 2027	30- 06- 2052
It was informed that Hindustan Zinc has applied for grant of 220 MW GNA_{RE} as a Bulk consumer seeking to connect to ISTS directly for its Debari plant. Plant is currently connected to intra state network 220kV/132kV Debari GSS of Ajmer Vidyuth Vitran Nigam Limited(AVVNL).HZL has informed that they have requested for NOC from AVVNL for disconnection from intra state network. HZL Debari plant is about ~45 km from 765/400 kV Chittorgarh(PG) S/s & about 60 km from 400/220 kV Kankroli S/s. For grant of GNA_{RE}, various alternatives are being explored based on the GNA_{RE} quantum and location of the HZL plant(Debari). The studies are under progress. Further, space confirmation from Powergrid is awaited regarding this. Accordingly, it was informed that this above application shall be taken up for grant in the next CMETS NR meeting.								

A7. Applications for Connectivity to ISTS under CERC (Connectivity and General Network Access to the inter-State Transmission System) Regulations, 2022 received in Mar'25:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)
1.	2200001807 (01.03.2025)	Mahanadi Renewable Energy Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	280 MW (Solar) 280 MW(BESS)	Land BG Route	280	30.06.2030	Ramgarh-II PS
2.	2200001810 (03.03.2025)	Godavari Green Energy Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 250 MW(BESS)	Land BG Route	250	30.06.2030	Sanchoore PS
3.	2200001827 (07-03-2025)	Vismaya Four Renewables Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 60 MW(BESS)	Land BG Route	300	01.10.2031	Bhadla IV PS
4.	2200001862 (20.03.2025)	Sabarmati Green Energy Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 250 MW(BESS)	Land BG Route	250	30.09.2030	Jalore PS
5.	2200001864 (20.03.2025)	Renew Solar Power Private Limited	Jodhpur distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Bhadla-III PS
6.	2200001866 (20.03.2025)	Renew Solar Power Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Pali PS
7.	2200001865 (20.03.2025)	Renew Solar Power Private Limited	Jodhpur distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Bhadla-III PS
8.	2200001900 (31.03.2025)	Waaree Forever Energies Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 125 MW (BESS)	Land BG Route	250	31.07.2031	Bikaner-V PS
9.	2200001901 (31.03.2025)	Waaree Forever Energies Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	31.10.2031	Sanchoore PS
10.	2200001903 (31.03.2025)	Waaree Forever Energies Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	31.03.2032	Pali PS
11.	2200001904 (31.03.2025)	Waaree Forever Energies Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.09.2032	Pali PS
12.	2200001907 (31.03.2025)	Adani Renewable Energy Holding Twelve Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	520(Solar)	LOA or PPA	520	31.12.2026	Barmer IV PS
13.	2200001908 (31.03.2025)	Adani Renewable Energy Holding Twelve Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS through a lead generator	303.33(Solar)	LOA or PPA	303.33	31.12.2026	Barmer IV PS

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
1.	2200001807 (01.03.2025)	Mahanadi Renewable Energy Private Limited	Jaisalmer distt., Rajasthan	Generating station(s), including REGS(s), with ESS	280 MW (Solar) 280 MW (BESS)	Land BG Route	280	30.06.2030	Ramgarh-II PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Mahanadi Renewable Energy Private Limited has applied for connectivity for 280 MW at Ramgarh-II PS. However, after grant of connectivity to Waaree Forever(600 MW) Ramgarh-II PS is already closed for fresh grant except for enhancement upto 169 MW. Accordingly, it was proposed to grant connectivity at proposed Ramgarh-III PS at 220 kV through S/c line. M/s Mahanadi agreed for the same. Applicant was asked to confirm the scope of 220 kV line bay at Ramgarh-III PS end & DTL tower configuration. In this regard, M/s Mahanadi Renewable informed that the 220 kV bay at Ramgarh-III PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted. It was mentioned that the transmission system for evacuation of power from Ramgarh-III PS is presently under evolution. Upon evolution, the scheme which is currently tentative, shall be discussed and finalized in joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was informed that with the grant of above connectivity of 280 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. It was also informed that M/s Mahanadi Renewable Energy Private Limited has requested Start Date of Connectivity under GNA from 30.06.2030. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031 (interim). M/s Mahanadi Renewable Energy Private Limited noted the same. Accordingly, it was agreed to grant connectivity of 280 MW to M/s Mahanadi Renewable Energy Private at 220 kV Ramgarh-III PS. Details of Transmission system for connectivity of M/s Mahanadi Renewable Energy Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Mahanadi Renewable Energy Private Limited RE Power Project– Ramgarh-III PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no of 220 kV bay at Ramgarh-III PS shall be under the scope of ISTS										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	--------------------	------------------------	---------------------------	---	--	----------------------

C. Common Transmission System for Connectivity under GNA: As per Annexure-V

Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
2.	2200001810 (03.03.2025)	Godavari Green Energy Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 250 MW(BESS)	Land BG Route	250	30.06.2030	Sanchore PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Godavari Green Energy Private Limited has applied for connectivity of 250 MW at Sanchore PS. Accordingly, it was proposed to grant connectivity at Sanchore PS at 220 kV through 1 no. of 220 kV line bay. Applicant was asked to confirm the 220 kV bay scope at Sanchore PS end and the tower configuration. In this regard, M/s Godavari Green informed that the 220 kV bay at Sanchore PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted.

It was mentioned that the transmission system for evacuation of power from Sirohi, Jalore & Sanchore complexes through Sirohi(HVDC) is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was informed that with the grant of above connectivity of 250 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed.

It was also informed that M/s Godavari Green Energy Private Limited has requested Start Date of Connectivity under GNA from 30.06.2030. However, considering the same and expected commissioning date of transmission system (i.e. 30.06.2031), the start date of Connectivity under GNA shall be 30.06.2031 (interim). M/s Godavari Green Energy Private Limited noted the same.

Accordingly, it was agreed to grant connectivity of 250 MW to M/s Godavari Green Energy Private Limited at 220 kV Sanchore PS. Details of Transmission system for connectivity of M/s Godavari Green Energy Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Godavari Green Energy Private Limited RE Power Project – Sanchore PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no of 220 kV bay at Sanchore PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u> As per Annexure-VII Start Date of Connectivity under GNA: 30.06.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
3.	2200001827 (07-03-2025)	Vismaya Four Renewables Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 60 MW (BESS)	Land BG Route	300	01.10.2031	Bhadla IV PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Vismaya Four Renewables Private Limited has applied for connectivity for 300 MW at Bhadla-IV PS. However, as informed in the 36th CMETS NR meeting, with grant of 5825 MW connectivity at Bhadla-IV PS, Bhadla-IV PS is closed for grant of additional connectivity except enhancements (upto 175 MW). Accordingly, it was proposed to grant connectivity at Bhadla-V PS through 220 kV S/c line. M/s Vismaya agreed for the same.

Applicant was asked to confirm the 220 kV bay scope at Bhadla-V PS end and the tower configuration. In this regard, M/s Vismaya Four informed that the 220 kV bay at Bhadla-V PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted.

It was informed that the transmission system for evacuation of power from Bhadla-V PS is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was mentioned that with the grant of above connectivity of 300 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	-------------------------	------------------------	---------------------------	---	--	----------------------

It was also informed that M/s Vismaya Four Renewables Private Limited has requested Start Date of Connectivity under GNA from 01.10.2031. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 01.10.2031(interim). M/s Vismaya Four Renewables Private Limited noted the same.

Accordingly, it was agreed to grant connectivity of 300 MW to M/s Vismaya Four Renewables Private Limited at 220 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s Vismaya Four Renewables Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA:

- (i). Vismaya Four Renewables Private Limited RE Power Project – Bhadla-V PS 220 kV S/c line on D/c tower (suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – **Under Applicant Scope**
- (ii). 1 no of 220 kV bay at Bhadla-V PS shall be under the scope of ISTS

C. Common Transmission System for Connectivity under GNA: As per Annexure-III

Start Date of Connectivity under GNA: 01.10.2031(Interim). Final date shall be confirmed upon award of the system

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
4.	2200001862 (20.03.2025)	Sabarmati Green Energy Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 250 MW(BESS)	Land BG Route	250	30.09.2030	Jalore PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Sabarmati Green Energy Private Limited has applied for connectivity of 250 MW at Jalore PS. Accordingly, it was proposed to grant connectivity at Jalore PS at 220 kV through 1 no. of 220 kV line bay. M/s Sabarmati Green for the same.

Applicant was asked to confirm the 220 kV bay scope at Jalore PS end and the tower configuration. In this regard, M/s Sabarmati Green Energy informed that the 220 kV bay at Jalore PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
It was mentioned that the transmission system for evacuation of power from Sirohi, Jalore & Sanchores complexes through Sirohi(HVDC) is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was informed that with the grant of above connectivity of 250 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. It was also informed that M/s Sabarmati Green Energy Private Limited has requested Start Date of Connectivity under GNA from 30.09.2030. However, considering the same and expected commissioning date of transmission system (i.e. 30.06.2031), the start date of Connectivity under GNA shall be 30.06.2031 (interim). M/s Sabarmati Green Energy Private noted the same. Accordingly, it was agreed to grant connectivity of 250 MW to M/s Sabarmati Green Energy Private at 220 kV Jalore PS. Details of Transmission system for connectivity of M/s Sabarmati Green Energy Private under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Sabarmati Green Energy Private Limited RE Power Project – Jalore PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no of 220 kV bay at Jalore PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u> As per Annexure-IX Start Date of Connectivity under GNA: 30.06.2031(Interim). Final date shall be confirmed upon award of the system										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
5.	2200001864 (20.03.2025)	Renew Solar Power Private Limited	Jodhpur distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Bhadla-III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil(Bay in sharing) • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s ReNew Solar Power Private Limited has applied for connectivity for 300 MW at Bhadla-III PS. As informed with the previous application of M/s Renew Solar at Bhadla complex(App. No. 2200001781-200 MW), it was proposed to grant connectivity at Bhadla-V PS through 400 kV S/c line for the combined capacity of 800 MW(200MW+300MW+300MW) with App. No. 2200001865(300 MW) as lead generator.

It was mentioned that the transmission system for evacuation of power from Bhadla-V PS is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s ReNew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 30.04.2027. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 30.09.2031(interim). M/s Renew noted the same.

Accordingly, it was agreed to grant connectivity of 300 MW to M/s Renew Solar Power Private Limited at 400 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System

M/s Renew Solar Power Private Limited shall share the dedicated transmission system granted with App. No. 2200001865:

- (i). Common Pooling Station for ReNew Solar Power Private Limited RE Power Projects (App. No. 2200001781-200 MW, App. No. 2200001864-300 MW & , App. No. 2200001865-300 MW) – Bhadla-V PS 400 kV S/c line on D/c tower(suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end - **– Under Applicant Scope**
- (ii). 1 no of 400 kV bay at Bhadla-V PS shall be under the scope of ISTS

C. Common Transmission system for Connectivity under GNA: As per Annexure-III

Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
6.	2200001866 (20.03.2025)	Renew Solar Power Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Pali PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Renew Solar Power Private Limited has applied for connectivity of 300 MW at Pali PS. Accordingly, it was proposed to grant connectivity at Pali PS at 220 kV level through 220 kV S/c line. Applicant was asked to confirm the 220 kV bay scope at Pali PS end & DTL tower configuration. M/s Renew Solar informed that 220 kV bay at Pali PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted & M/s Renew Solar was asked to submit necessary undertaking for S/c line on D/c tower configuration. M/s Renew Solar agreed for the same. It was mentioned that the transmission system for evacuation of power from Nagaur(Merta) & Pali complexes through Beawar(HVDC) is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was also informed that M/s Renew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 30.04.2027, However, considering the same and expected commissioning date of transmission system (i.e. 30.06.2031), the start date of Connectivity under GNA shall be 30.06.2031(interim). M/s Renew Solar noted the same. Accordingly, it was agreed to grant connectivity of 300 MW to M/s Renew Solar Power Private Limited at 220 kV Pali PS. Details of Transmission system for connectivity of M/s Renew Solar Power Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). M/s Renew Solar Power Private Limited Solar Power Project – Pali PS 220 kV S/c line on D/c tower (suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no. of 220 kV bay at Pali PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u> As per Annexure-X										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
Start Date of Connectivity under GNA: 30.06.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
7.	2200001865 (20.03.2025)	Renew Solar Power Private Limited	Jodhpur distt., Rajasthan	Generating station(s), including REGS(s), without ESS	300 MW (Solar)	LOA or PPA	300	30.04.2027	Bhadla-III PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 6 Cr. • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s ReNew Solar Power Private Limited has applied for connectivity for 300 MW at Bhadla-III PS. As informed with the previous applications of M/s Renew Solar at Bhadla complex(App. No. 2200001781-200 MW & App. No. 2200001864-300 MW), it was proposed to grant connectivity at Bhadla-V PS through 400 kV S/c line for the combined capacity of 800 MW(200MW+300MW+300MW) with App. No. 2200001865(300 MW) as lead generator. M/s Renew agreed for the same.

It was mentioned that the transmission system for evacuation of power from Bhadla-V PS is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s ReNew Solar Power Private Limited has requested Start Date of Connectivity under GNA from 30.04.2027. However, considering the same and expected commissioning date of transmission system (i.e. 30.09.2031), the start date of Connectivity under GNA shall be 30.09.2031(interim). M/s Renew noted the same.

Accordingly, it was agreed to grant connectivity of 300 MW to M/s Renew Solar Power Private Limited at 400 kV Bhadla-V PS. Details of Transmission system for connectivity of M/s ReNew Solar Power Private Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA:

- (i). Common Pooling Station for ReNew Solar Power Private Limited RE Power Projects(App. No. 2200001781-200 MW, App. No. 2200001864-300 MW & , App. No. 2200001865-300 MW) – Bhadla-V PS 400 kV S/c line on D/c(suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end -**Under Applicant Scope**

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity (MW)	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
(ii). 1 no of 400 kV bay at Bhadla-V PS shall be under the scope of ISTS										
C. <u>Common Transmission System for Connectivity under GNA:</u> As per Annexure-III										
Start Date of Connectivity under GNA: 30.09.2031(Interim). Final date shall be confirmed upon award of the system										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
8.	2200001900 (31.03.2025)	Waaree Forever Energies Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), with ESS	250 MW (Solar) 125 MW (BESS)	Land BG Route	250	31.07.2031	Bikaner-V PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: As per bay scope • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Waaree Forever Energies Private Limited has applied for connectivity for 250 MW at Bikaner-V PS. However, there is no margin available at Bikaner-V PS. Accordingly, it was proposed to grant connectivity at the proposed Bikaner-VI PS.										
However, it was informed that the total potential declared by MNRE in Bikaner complex is about 26.8 GW. Considering the connectivity granted at Bikaner Complex the subject application is beyond the 26.8 GW potential. Since the subject applications are beyond RE potential at Bikaner complex, feedback from MNRE is to be sought w.r.t. max potential to be considered in the area. In the 29th NCT meeting held on 16.04.2025 wherein after deliberations, it was decided that the transmission schemes for the quantum beyond the potential already declared by MNRE/SECI will be taken up for approval only after assessment and declaration of such additional potential by MNRE. Therefore, the above application for connectivity shall be considered for grant after assessment and declaration of such additional potential by MNRE at Bikaner Complex.										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
9.	2200001901 (31.03.2025)	Waaree Forever Energies Private Limited	Jalore distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	31.10.2031	Sanchoe PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 3 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Waaree Forever Energies Private Limited has applied for connectivity of 300 MW at Sanchoe PS. Accordingly, it was proposed to grant connectivity at Sanchoe PS at 220 kV through 1 no. of 220 kV line bay. Applicant was asked to confirm the 220 kV bay scope at Sanchoe PS end and the tower										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
configuration. In this regard, M/s Waaree Forever informed that the 220 kV bay at Sanchore PS end shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted. It was mentioned that the transmission system for evacuation of power from Sirohi, Jalore & Sanchore complexes through Sirohi(HVDC) is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was informed that with the grant of above connectivity of 300 MW, the applicant shall be eligible only for injection of power into ISTS & shall not be eligible for drawl of power from the grid. Accordingly, the BESS associated with REGS shall be eligible to draw power only from the co located REGS & no drawl of power from the ISTS grid shall be allowed. It was also informed that M/s Waaree Forever Energies Private Limited has requested Start Date of Connectivity under GNA from 31.10.2031. Considering the same and expected commissioning date of transmission system (i.e. 30.06.2031), the start date of Connectivity under GNA shall be 31.10.2031 (interim) as requested. M/s Waaree Forever noted the same. Accordingly, it was agreed to grant connectivity of 300 MW to M/s Waaree Forever Energies Private Limited at 220 kV Sanchore PS. Details of Transmission system for connectivity of M/s Waaree Forever Energies Private Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Waaree Forever Energies Private Limited RE Power Project – Sanchore PS 220 kV S/c line on D/c tower (Suitable to carry minimum 300 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no. of 220 kV bay at Sanchore PS shall be under the scope of ISTS C. <u>Common Transmission System for Connectivity under GNA:</u> As per Annexure-VII Start Date of Connectivity under GNA: 31.10.2031(Interim). Final date shall be confirmed upon award of the system										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
10.	2200001903 (31.03.2025)	Waaree Forever Energies Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	31.03.2032	Pali PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: To be decided • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Waaree Forever Energies Private Limited has applied for connectivity of 300 MW at Pali PS. Further, another application (App. No. 2200001904) for 300 MW by M/s Waaree Forever Energies for 300 MW is also being taken up for grant in the present meeting. Accordingly, it is proposed to grant connectivity at Pali PS at 400 kV level through 400 kV S/c line for combined capacity of 600 MW. Applicant was asked to confirm the 400 kV bay scope at Pali PS end and the tower configuration. M/s Waaree Forever Energies Private Limited in the meeting requested to provide connectivity for both applications separately at 220 kV level. CTUIL suggested that for connectivity quantum of 600 MW, 400 kV level shall be optimal considering DTL & RoW optimization.

However, subsequently it was decided that the request for connectivity at 220 kV is to be reviewed. Accordingly, both the applications shall be considered for discussion & grant in the next CMETS NR meeting. In the meantime M/s Waaree Forever may submit the technical justification for connectivity at 220 kV for above applications.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
11.	2200001904 (31.03.2025)	Waaree Forever Energies Private Limited	Pali distt., Rajasthan	Generating station(s), including REGS(s), with ESS	300 MW (Solar) 150 MW (BESS)	Land BG Route	300	30.09.2032	Pali PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: To be decided • Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Waaree Forever Energies Private Limited has applied for connectivity of 300 MW at Pali PS. As informed with the previous application for M/s Waaree Forever (App. No. 2200001903), it was proposed to grant connectivity at Pali PS at 400 kV level through 400 kV S/c line for combined capacity of 600 MW with App. No. 2200001904 as lead generator.

However, subsequently it was decided that the request for connectivity at 220 kV is to be reviewed. Accordingly, both the applications of M/s Waaree Energies at Pali PS (300 +300) shall be considered for discussion & grant in the next CMETS NR meeting. In the meantime, M/s Waaree Forever may submit the technical justification for connectivity at 220 kV for above applications.

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
12.	2200001907 (31.03.2025)	Adani Renewable Energy Holding Twelve Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS	520(Solar)	LOA or PPA	520	31.12.2026	Barmer IV PS	• Conn BG1: Rs. 50 Lakh • Conn BG2: Rs. 6 Cr. • Conn BG3: Rs. 2 lakh/MW
It was informed that M/s Adani Renewable Energy Holding Twelve Limited has applied for connectivity of 520 MW at Barmer-IV PS. Further, another application (App. No. 2200001908) for 303.33 MW by M/s Adani Renewable Energy Holding Twelve Limited with App. No. 2200001907 as lead generator is also being taken up for grant in the present meeting. Accordingly, it was proposed to grant connectivity at Barmer-IV PS at 400 kV level through S/c line for combined capacity of 823.33(520+303.33) MW. Applicant was asked to confirm the 400kV bay scope at Barmer-IV PS & DTL tower configuration. Regarding this, M/s Adani Renewable Energy in the meeting informed that the 400 kV Bay at Barmer-IV PS shall be under ISTS & DTL tower configuration shall be S/c line on D/c tower. The same was noted. It was mentioned that the transmission system for evacuation of power from Barmer-IV PS through HVDC is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme. It was also informed that M/s Adani Renewable Energy Holding Twelve Limited has requested Start Date of Connectivity under GNA from 31.12.2026. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031(interim) as requested. M/s Adani noted the same. Accordingly, it was agreed to grant connectivity of 520 MW to M/s Adani Renewable Energy Holding Twelve Limited at 400 kV Barmer-IV PS. Details of Transmission system for connectivity of M/s Adani Renewable Energy Holding Twelve Limited under GNA is as below: <u>Details of Transmission system for Connectivity under GNA:</u> A. <u>Associated Transmission System (ATS):</u> NIL B. <u>Dedicated Transmission System for Connectivity under GNA:</u> (i). Common Pooling Station for M/s Adani Renewable Energy Holding Twelve Limited RE Power Projects (App. No. 2200001907 :520 MW & App. No. 2200001908 :303.33 MW) – Barmer-IV PS 400 kV S/c line on D/c tower (suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no of 400 kV bay at Barmer-IV PS shall be under the scope of ISTS										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
---------	------------------------	-----------	------------------	---------------------	--------------------	------------------------	---------------------------	---	--	----------------------

C. Common Transmission System for Connectivity under GNA: As per Annexure-II

Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
13.	2200001908 (31.03.2025)	Adani Renewable Energy Holding Twelve Limited	Barmer distt., Rajasthan	Generating station(s), including REGS(s), without ESS through a lead generator	303.33 (Solar)	LOA or PPA	303.33	31.12.2026	Barmer IV PS	- Conn BG1: Rs. 50 Lakh - Conn BG2: Nil(Bay in sharing) - Conn BG3: Rs. 2 lakh/MW

It was informed that M/s Adani Renewable Energy Holding Twelve Limited has applied for connectivity of 303.33 MW at Barmer-IV PS with App. No. 2200001907 as lead generator. As informed with the previous application for M/s Adani Renewable Energy Holding Twelve Limited (App. No. 2200001907), it was proposed to grant connectivity at Barmer-IV PS at 400 kV in sharing with the App. No. 2200001907 as lead generator.

It was mentioned that the transmission system for evacuation of power from Barmer-IV PS through HVDC is presently under evolution. Upon evolution, the scheme shall be discussed in a separate joint study meeting among CEA, CTUIL, Grid India & Stakeholders followed by the subsequent CMETS meeting. The detailed transmission system shall be informed upon finalization and approval of the scheme.

It was also informed that M/s Adani Renewable Energy Holding Twelve Limited has requested Start Date of Connectivity under GNA from 31.12.2026. However, considering the same and expected commissioning date of transmission system (i.e. 31.12.2031), the start date of Connectivity under GNA shall be 31.12.2031(interim) as requested. Transmission system for connectivity of M/s Adani Renewable Energy Holding Twelve Limited under GNA is as below:

Accordingly, it was agreed to grant connectivity of 303.33 MW to M/s ani Renewable Energy Holding Twelve Limited at 400 kV Barmer-IV PS. Details of Transmission system for connectivity of M/s ani Renewable Energy Holding Twelve Limited under GNA is as below:

Details of Transmission system for Connectivity under GNA:

A. Associated Transmission System (ATS): NIL

B. Dedicated Transmission System for Connectivity under GNA:

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
M/s Adani Renewable Energy Holding Twelve Limited shall share the dedicated transmission system granted with App. No. 2200001907: (i). Common Pooling Station for M/s Adani Renewable Energy Holding Twelve Limited RE Power Projects (App. No. 2200001907 :520 MW & App. No. 2200001908 :303.33 MW) – Barmer-IV PS 400 kV S/c line (suitable to carry minimum 900 MW at nominal voltage) along with associated bay at generation end – Under Applicant Scope (ii). 1 no of 400 kV bay at Barmer-IV PS shall be under the scope of ISTS C. Common Transmission System for Connectivity under GNA: As per Annexure-II Start Date of Connectivity under GNA: 31.12.2031(Interim). Final date shall be confirmed upon award of the system										

A8. Application for Addition of Generation Capacity within the Quantum of Connectivity Granted under Regulation 5.2 in March'25

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
1.	2200001828 (09.03.2025)	ABREL (RJ) Projects Limited	Jaisalmer distt., Rajasthan	Captive generating plant	2200000140	Fatehgarh-III PS(Sec-II)	52.7 MW: Wind	31-05-2025
2.	2200001843 (13.03.2025)	ACME Solar Holdings Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	1200003683	Bikaner-II PS	300 MW (BESS)	31-03-2027
3.	2200001851 (18.03.2025)	ACME Cleantech Solutions Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	2200000008	Bikaner-III PS	300 MW (BESS)	31-03-2027

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
1.	2200001828 (09.03.2025)	ABREL (RJ) Projects Limited	Jaisalmer distt., Rajasthan	Captive generating plant	2200000140	Fatehgarh-III PS(Sec-II)	52.7 MW: Wind	31-05-2025
It was informed that M/s ABREL(RJ) Projects Ltd. (ABRELRJPL) has applied for addition of generation capacity (52.7 MW Wind) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Fatehgarh-III PS(Sec-II)under App. No. 2200000140(260 MW). M/s ABRELRJPL shall note that as per GNA Regulations, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s ABRELRJPL (Appl. No. 2200000140 for 260 MW. Further, M/s ABRELRJPL (Appl. No. 2200000140) shall be responsible for								

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s ABRELRJPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances at the earliest so as to provide sufficient time for ensuring necessary compliances. M/s ABRELRJPL has requested Start Date of additional generation capacity from 31.05.2025. However, start date of connectivity for original connectivity application (App. no. 2200000140) is 22.08.2026. Accordingly, it was proposed to grant the above capacity addition under regulation 5.2 of GNA Regulations with start date of 22.08.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000140(260 MW).								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
1.	2200001843 (13.03.2025)	ACME Solar Holdings Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	1200003683	Bikaner-II PS	300 MW (BESS)	31-03-2027
It was informed that M/s ACME Solar Holdings Ltd. (ASHL) has applied for addition of generation capacity (300 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bikaner-II PS under App. No. 1200003683(300 MW). However, it was mentioned that in terms of the order dated 25.11.2024 on Petition No.326/MP/2024, having failed to achieve the commissioning of the above Project of ACME Solar Holdings Limited(under St-II App. No. 1200003683(300 MW) & LTA App. No. 1200003829(300 MW)), CTUIL has revoked the connectivity granted to the M/s ACME.M/s ACME has filed petition(Petition (Diary) No.207/2025 along with IA (Diary) No.208/2025) with CERC seeking extension of time in complying with the directions stipulated under order dated 25.11.2024 in Petition No. 326/MP/2024.As per the RoP of the above Petition (Diary) No.207/2025 along with IA (Diary) No.208/2025 dated 24.04.2025, the revocation of the connectivity is kept in abeyance till the next date of hearing. Since the processing of above application under 5.2 is dependent on the status of connectivity of 300 MW granted to M/s ACME Solar Holdings Limited at Bikaner-II PS& the matter is currently sub-judice. Therefore, the above application for grant of additional capacity under 5.2 cannot be considered at this stage. Accordingly,, it was decided to defer the above application under 5.2. It was also informed that the above application may be taken up for grant at a later stage depending upon status of connectivity of M/s ACME at Bikaner-II PS after the CERC order on above petition by ACME.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
2.	2200001851 (18.03.2025)	ACME Cleantech Solutions Private Limited	Bikaner distt., Rajasthan	Generating station(s), including REGS(s), without ESS	2200000008	Bikaner-III PS	300 MW (BESS)	31-03-2027

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. of already granted Connectivity	Connectivity Location	Planned additional capacity (MW)	Date from which additional generation capacity will be added
It was informed that M/s ACME Cleantech Solutions Private Limited. (ACSPL) has applied for addition of generation capacity (300 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum granted at Bikaner-III PS under App. No. 2200000008(300 MW). M/s ACME Cleantech in the meeting informed that they are in the process of re-evaluating the said application and accordingly shall confirm their decision to accept or withdraw the said application by next day. Subsequently, M/s ACME vide letter dated 30.05.2025 informed their decision to withdraw the above application. Accordingly, it was decided to close the above application as per GNA Regulations 2022.								

A9. Application for Connectivity of Solar plants of BBMB at 400/220/132kV Bhiwani(BBMB)(10 MW) & 220/132/33 kV Hissar(BBMB)(1.5 MW)

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
1.	2200001987 (29.04.2025)	BBMB	Bhiwani distt. Haryana	Generating station(s), including REGS(s), without ESS	10 MW (Solar)	Land Route	10	30.06.2025	400/220/132 kV Bhiwani(BBMB)	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil (Bay under applicant scope) • Conn BG3: Rs. 2 lakh/MW
It was informed that CERC vide RoP dated 17.04.2025(on hearing of Petition No. 395/MP/2025 by BBMB) had directed BBMB to apply to CTUIL seeking connectivity for its solar projects of 10 MW (at Bhiwani S/s) and 1.5 MW (at Hissar S/s), through separate applications. In the same RoP, CERC had also directed CTUIL to process the same expeditiously keeping in view the SCOD on 28.4.2025. Subsequently, BBMB applied for connectivity of 10 MW at Bhiwani (BBMB) vide above application dated 29.04.2025. Accordingly, in line with the CERC direction, considering the SCOD of the project, the above connectivity application was taken up for discussion & grant in the present meeting. The 10 MW solar plant by BBMB is proposed to be interconnected at 132 kV level at Bhiwani (BBMB) S/s for which the 132 kV bay at Bhiwani (BBMB) S/s is under implementation by Applicant (BBMB). Studies were carried out in the Grid India file in Solar Max scenario of Jun'25. From the studies, it was observed that the power flow is in order. Accordingly, it was proposed to grant connectivity to BBMB through existing system beyond Bhiwani (BBMB) S/s. In the meeting, HVPNL raised their concern regarding the grant of connectivity to BBMB. HVPNL informed that even though the connectivity is being granted at BBMB station, the power is getting evacuated through HVPNL lines. Considering the concerns raised by HVPNL in the CMETS NR meeting, it was decided that a separate meeting will be held in VC mode with HVPNL, BBMB, CEA, Grid India & CTUIL to discuss the issues raised by HVPNL. Subsequently, a joint meeting was held on 04.06.2025 with CEA, Grid India & HVPNL to discuss the issues raised by HVPNL. Subsequently, the matter was deliberated in the joint meeting with CTUIL, Grid India, CEA, BBMB & HVPNL held on 04.06.2025. In the joint meeting, it was decided to										

Minutes of 38th Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 28-05-2025.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
grant connectivity to 10 MW BBMB Solar Plant at 132 kV Bhiwani(BBMB) S/s. Further, it was decided that HVPNL may take up their issues with CERC as HVPNL was one of the respondents in above petition (Petition No. 395/MP/2025) by BBMB. (Minutes of Joint meeting with CTUIL, Grid India, CEA, BBMB & HVPN is enclosed at Annexure-XI)										

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	Installed Capacity	Criterion for applying	Connectivity Quantum (MW)	Start Date of Connectivity (As per Application)	Connectivity Location (As per Application)	Conn BGs requirement
2.	2200001993 (29.04.2025)	BBMB	Hissar distt., Haryana	Generating station(s), including REGS(s), without ESS	1.5 MW (Solar)	Land Route	1.5	30.06.2025	220/132/33 kV Hissar (BBMB)	• Conn BG1: Rs. 50 Lakh • Conn BG2: Nil (Bay under applicant scope) • Conn BG3: Rs. 2 lakh/MW
It was informed that CERC vide RoP dated 17.04.2025(on hearing of Petition No. 395/MP/2025 by BBMB) had directed BBMB to apply to CTUIL seeking connectivity for its solar projects of 10 MW (at Bhiwani S/s) and 1.5 MW (at Hissar S/s), through separate applications. In the same RoP, CERC had also directed CTUIL to process the same expeditiously keeping in view the SCOD on 28.4.2025. Subsequently, BBMB applied for connectivity of 1.5 MW at Hissar (BBMB) vide above application dated 29.04.2025. Accordingly, in line with the CERC direction, considering the SCOD of the project, the above connectivity application is being taken up for discussion & grant. The 1.5 MW solar plant by BBMB is proposed to be interconnected at 33 kV level at Hissar (BBMB) S/s for which the 33 kV bay at Hissar (BBMB) S/s is under implementation by Applicant (BBMB). Studies were carried out in the Grid India file for present timeframe in Solar Max scenario of Jun'25. From the studies, it was observed that the power flow in 132 kV & 220 kV system beyond Hissar is in order. Accordingly, it was proposed to grant connectivity to BBMB through existing system beyond Hissar (BBMB) S/s. In the meeting, HVPNL raised their concern regarding the grant of connectivity to BBMB. HVPN informed that even though the connectivity is being granted at BBMB station, the power is getting evacuated through HVPN lines. Considering the concerns raised by HVPNL in the CMETS NR meeting, it was decided that a separate meeting will be held in VC mode with HVPNL, BBMB, CEA, Grid India & CTUIL to discuss the issues raised by HVPNL. Subsequently, a joint meeting was held on 04.06.2025 with CEA, Grid India & HVPN to discuss the issues raised by HVPNL. Subsequently, the matter was deliberated in the joint meeting with CTUIL, Grid India, CEA, BBMB & HVPN held on 04.06.2025. In the joint meeting, it was decided to grant connectivity to 1.5 MW BBMB Solar Plant at 33 kV Hissar(BBMB) S/s. Further, it was decided that HVPNL may take up their issues with CERC as HVPNL was one of the respondents in above petition (Petition No. 395/MP/2025) by BBMB. (Minutes of Joint meeting with CTUIL, Grid India, CEA, BBMB & HVPN is enclosed at Annexure-XI)										

B. Network Expansion scheme

B1. Requirement of 2 nos. 220KV line Bays at 400/220kV Samba (PG) Substation.

It was stated that JKPTCL vide letter dated 23.04.2025 emphasized the requirement of 02 No. 220KV Line Bays at 400/220KV Samba Substation . In this letter JKPTCL mentioned that requirement of additional 400/220/33KV, 500 MVA, ICT at Samba (PG) Substation along with 04 No. Bays (01 No. 400kV and 03 No. 220kV) was discussed and deliberated in 220th OCC meeting keeping in view following:

1. 364 MW industrial load in New 220/66kV Substation Kathua
2. 120 MW Load expected in case tripping of 220kV Jammu Salal

JKPTCL mentioned that requirement of above ICT and bays was deliberated in 220th OCC and subsequent NRPC Meetings but approval was provided for only 220kV ICT Bay and not line bays and same are direly required by JKPTCL at the earliest. In view of above, JKPTCL requested to take up the execution of 2 nos. 220KV line bays along with above ICT package at Samba S/s of POWERGRID.

Further in 220th OCC meeting held on 19.06.2024, agenda for JKPTCL for construction of 320MVA, 220/66 KV, Grid Sub-Station, Bhagthalli Kathua was deliberated. In the meeting it was stated that JKPTCL vide letter dated 06.06.2024 has informed that under the industrial policy in UT of J&K, Industrial Estate Bhagthall is being proposed to be set up in Jammu region. For this, requirement of 320MVA (07x 53.33MVA single phase units), 220/66 KV, Grid Sub-Station along with feeding 220 KV transmission lines to meet the load requirement is proposed (New Load Expected: 226.29 MW Industrial Load plus provision for 10-20% for future growth).

In view of the above and keeping in view future industrial growth at Bhagthalli and adjoining areas, JKPTCL suggested for installation of 320MVA (07 x 53.33MVA single phase units) ,220/66 KV, Grid Sub-station along with 45Kms (approx.) feeding 220 KV D/c Transmission line from Samba (PG) along with LILO of existing 220kV Sarnba - Hiranagar Transmission Line at Bhagthalli (to meet N-1 compliance) with the commissioning target of 18 Months. In the OCC meeting, forum stated that this being non-ISTS network, MS, NRPC asked JKPTCL to approach CEA on the cited matter. JKPTCL may provide status of implementation of 220/66 KV Bhagthalli GSS along with 220kV Bhagthali- Samba(PG) D/c line. CEA may provide status of approval of above intra state proposal.

Augmentation of 400/220kV, 1x500MVA ICT (4th) at Samba(PG) S/s is under implementation by POWERGRID with commissioning schedule of Apr'26. POWERGRID vide mail dated 05.05.2025 confirmed space availability for Implementation of 2 nos. of 220kV line bays at 400/220kV Samba (PG) S/s.

In the meeting, JKPTCL stated that implementation schedule of 220/66 kV Bhagthalli Kathua S/s along with 220kV Bhagthalli – Samba (PG) D/c is considered 18 months from award. The scheme is being implemented in TBCB mode and at present reply of bidder's query is ongoing. CTU stated that bay implementation may take minimum 18 months from allocation to TSP. Considering compressed timeline, JKPTCL may inform the expected award date as well as firm date for implementation of 220kV bays at Samba S/s well in advance, so that bay implementation shall be taken up in ISTS in matching timeframe of associated intra state scheme i.e. 220/66 kV Bhagthalli Kathua S/s & 220kV Bhagthalli – Samba (PG) D/c line. JKPTCL agreed for the same. No other observations received in meeting.

Regarding CTU query for any unutilized bay at Samba S/s, Powergrid confirmed that at present there are no 220kV bays available for interconnection of 220/66 kV Bhagthalli Kathua S/s to Samba (PG) (AIS) S/s.

JKPTCL stated that reconductoring of 220kV Samba - Hiranagar Transmission Line (proposed to be LILOed at 220kV Bhagthalli S/s) is also required as this line will also feed power to Bhagthalli S/s. CTU stated that JKPTCL may send detailed proposal to CEA/CTU to analyse the reconductoring of above line and for taken up in next CMETS-NR meeting. JKPTCL agreed for the same.

JKPTCL to provide transmission lines with OPGW based communication as per CEA (Technical Standards for Construction of Electrical Plants and Electric Lines) Regulations, 2022.

In view of above deliberations, following scheme is agreed in ISTS:

- A. Implementation of 2 nos. of 220kV line bays at 400/220kV Samba (PG) S/s for the termination of 220kV D/c line from 220/66 kV Bhagthalli Kathua S/s to Samba (PG) S/s.

B2. Augmentation with 400/220 kV 1x500 MVA (4th) ICT at Sikar (PG) S/s to meet N-1 compliance

It was stated that in the 38th CMETS-NR meeting held on 27.03.25 agenda for Augmentation with 400/220 kV 1x500 MVA (4th) ICT at Sikar (PG) S/s to meet N-1 compliance was deliberated. In the meeting RVPN stated that at present, no additional interconnections are planned at Sikar (PG) S/s for drawl of power and RVPN already planned Beri Bajranggarh S/s to divert partial load of about 125MW from Sikar (PG) S/s to their Beri Bajranggarh S/s which is ultimately fed through Ratangarh S/s. The scheme is already awarded with implementation schedule of 24 months.

RVPN stated that they will carry out detailed analysis for the requirement of ICT augmentation at Sikar (PG) S/s based on under implementation and planned intra state system envisaged in next 2-3 years. RVPN requested forum to take up the agenda in next CMETS-NR meeting.

In the meeting, Grid-India stated that as discussed in OCC/NRPC meeting as well as highlighted in operational feedback, there is augmentation requirement at Sikar(PG) S/s considering n-1 non-compliance issue.

At present, 400/220kV Sikar (PG) Substation has total transformation capacity of 1130 MVA (1x500MVA+2x315MVA). From the loading pattern of Sikar ICTs (1x500 MVA+2x315MVA), it is observed that cumulative maximum loading on 400/220 kV ICTs is about 974 MW. From the analysis, it emerged that loading is breaching N-1 limit (820 MW) in summer season (Jun'24-Jul'24) and during winter season (Nov'25-Mar'25) for sufficient duration of time. The loading pattern of Sikar ICTs for past one year is as below :

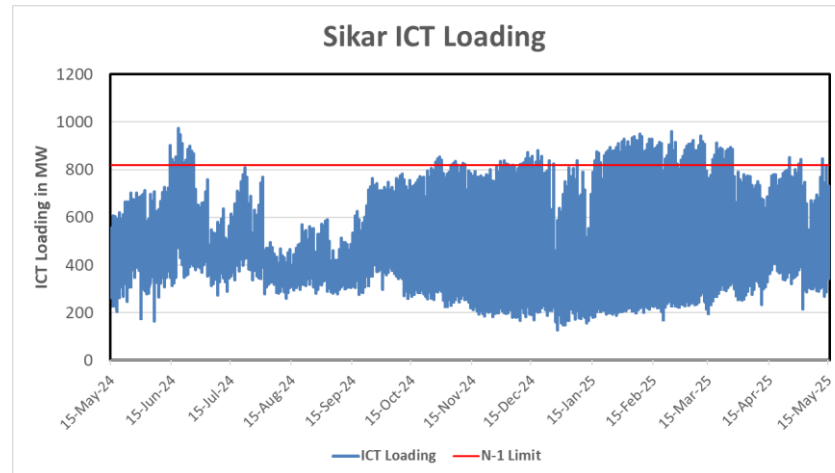


Fig : Loading of Sikar ICTs of Past one year (Source: Grid-India)

POWERGRID vide mail dated 15.01.2025 confirmed space availability for Augmentation of 400/220 kV transformer (4th, 500MVA) along with transformer bays (with 220kV side connection with cable) at 400/220kV Sikar (PG) S/s.

In present meeting RVPN stated that implementation of planned intra state scheme may take some time which may relieve the loading of ICT to some extent, however considering the future load in above area as well as N-1 non-compliance issue in Sikar ICT, augmentation of 400/220 kV ,1x500 MVA (4th) ICT at 400/220kV Sikar (PG) S/s is required. No other comments are received in the meeting.

In view of above deliberations, following ICT augmentation scheme is agreed in ISTS:

- Augmentation of 400/220 kV ,1x500 MVA (4th) ICT at 400/220kV Sikar (PG) S/s along with transformer bays (with 220kV side connection with cable

B3. Transmission scheme for evacuation of power from Ratle HEP & Kiru HEP

It was stated that in 26th CMETS-NR meeting held on 01.12.2023 & 31st CMETS-NR meeting held on 27.06.2024, connectivity application of M/s Ratle HEP and M/s Kiru HEP was agreed for grant under GNA with following transmission system:

Common Transmission System for Connectivity under GNA for Ratle HEP:

1. 400 kV Kishenpur-Samba D/c line (Quad) (2nd)

2. Bypassing of 400kV Kishtwar – Kishenpur line (Quad) (Under implementation as part of Pakaldul transmission scheme) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400kV D/c line(Quad), thus forming 400kV KishtwarSamba (Quad) direct line (one ckt)
3. Termination of another circuit of 400 kV Kishenpur-Samba D/c line (Quad) at Kishenpur at 400kV bay vacated at Kishenpur (After bypassing of one ckt of 400 kV Kishtwar-Kishenpur at Kishenpur)
4. Bypassing both ckts of 400kV Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin) at Samba and connecting them together to form Kishenpur– Jalandhar D/c direct line (Twin)
5. 400kV Samba- Jalandhar D/c line (Quad) (only one circuit is to be terminated at Jalandhar while second circuit would be connected to bypassed circuit of Jalandhar –Nakodar 400kV D/c line)
6. Bypassing 400kV Jalandhar – Nakodar line (Quad) at Jalandhar and connecting it with one of the circuit of Samba-Jalandhar 400kV D/c line (Quad Moose), thus forming Samba –Nakodar line
7. Termination of another circuit of 400 kV Samba -Jalandhar D/c line (Quad) at Jalandhar at bay vacated at Jalandhar (After bypassing of one ckt of 400 kV Jalandhar - Nakodar at Jalandhar)
8. LILO of 400 kV Kishenpur- Dulhasti line (Twin Zebra) at Kishtwar S/s (one ckt already LILOed as part of Pakaldul transmission system)
9. Reconductoring of 400 kV Kishenpur-Kishtwar line* (Twin HTLS) (minimum 2100 MVA capacity) (formed after LILO of KishenpurDulhasti line at Kishtwar S/s) along with bay upgradation works (2000A to 3150A) at Kishenpur end for above line

Common Transmission system for Connectivity under GNA for Kiru HEP :

1. LILO of 400 kV Kishenpur- Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s
2. Reconductoring of 400 kV Kishenpur-Kishtwar section with Twin HTLS (minimum 2100 MVA capacity) (formed after LILO of Kishenpur-Dulhasti line at Kishtwar S/s) along with bay upgradation works (2000A to 3150A) at Kishenpur end for above line.
3. 400 kV Kishenpur-Samba D/c line (Quad)
(only one circuit is to be terminated at Kishenpur utilizing 1 no. of 400kV vacated line bay at Kishenur S/s (formed with bypassing of one ckt of 400kV Kishtwar – Kishenpur Prayagraj – Sohawal 400 kV D/c line (Quad))
4. Bypassing of one ckt of 400kV Kishtwar – Kishenpur 400kV D/c line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400kV D/c line (Quad), thus forming 400kV Kishtwar - Samba (Quad) direct line (one ckt)
5. 1x80 MVar Switchable line reactor at Samba end of 400kV Kishtwar-Samba 400kV line-165km (Quad) [formed after bypassing of 400kV Kishtwar – Kishenpur line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400kV D/c line (Quad))
6. Bypassing both ckts of 400kV Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin) at Samba and connecting them together to form 400kV Kishenpur– Jalandhar D/c direct line (Twin)
(4 nos. of vacated 400kV line bays at Samba S/s will be utilized for 400 kV Kishenpur-Samba D/c line (Quad) & 400kV Samba- Jalandhar D/c line (Quad))

7. Bays upgradation works (2000A to 3150A) at Samba end (4 nos. bays vacated after bypassing of Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin))
8. 1x63 MVar Switchable line reactor on each ckt at Jalandhar end of Kishenpur– Jalandhar D/c direct line (Twin) (formed after bypassing both ckts of 400kV Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin) at Samba and connecting them together to form Kishenpur– Jalandhar D/c direct line (Twin))
9. 400kV Samba- Jalandhar D/c line (Quad)
(only one circuit is to be terminated at Jalandhar utilizing 1 no. of 400kV vacated line bay at Jalandhar S/s (formed with bypassing of 400kV Jalandhar – Nakodar line (Quad) at Jalandhar) while second circuit would be connected to bypassed circuit of Jalandhar –Nakodar 400kV line (Quad))
10. 1x80 MVar Switchable line reactor at Samba end of Samba –Nakodar direct line (Quad) formed after bypassing of 400kV Jalandhar – Nakodar line (Quad) at Jalandhar and connecting it with one of the circuit of Samba-Jalandhar 400kV D/c line (Quad Moose), thus forming Samba – Nakodar line (Quad)
11. Bypassing 400kV Jalandhar – Nakodar line (Quad) at Jalandhar and connecting it with one of the circuit of Samba-Jalandhar 400kV D/c line (Quad Moose), thus forming 400kV Samba –Nakodar (Quad) direct line
12. Augmentation of 500 MVA ICT (4th) at Jalandhar (PG) S/s along with associated transformer bays
13. Augmentation of 500 MVA ICT (4th) ICT at Samba (PG) S/s along with associated transformer bays

Further Transmission scheme for evacuation of power from Ratle HEP & Kiru HEP was discussed and approved in 20th NCT meeting held on 25.06.2024. The scheme is under implementation with commissioning schedule of Mar'27. Based on above revised ISTS transmission system for connectivity of Ratle HEP and M/s Kiru HEP under GNA is as under:

Transmission system for Connectivity under GNA:

A. Transmission scheme for evacuation of power from Ratle HEP (850MW) & Kiru HEP (624 MW): Part-A

1. LILO of 400 kV Kishenpur- Dulhasti line (Twin) at Kishtwar S/s along with associated bays at Kishtwar S/s
2. 400 kV Kishenpur-Samba D/c line (Quad)
(only one circuit is to be terminated at Kishenpur utilizing 1 No. of 400 kV vacated line bay at Kishenpur S/s (formed with bypassing of one ckt of 400 kV Kishtwar – Kishenpur 400 kV D/c line (Quad) at Kishenpur) while second circuit would be connected to bypassed circuit of 400 kV Kishtwar – Kishenpur line (Quad))
3. Bypassing of one ckt of 400kV Kishtwar – Kishenpur 400kV D/c line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400kV D/c line (Quad), thus forming 400kV Kishtwar - Samba (Quad) direct line (one ckt)
4. 1x80 MVar Switchable line reactor at Samba end of 400kV Kishtwar-Samba 400kV line (Quad) [formed after bypassing of 400kV Kishtwar – Kishenpur line (Quad) at Kishenpur and connecting it with one of the circuit of Kishenpur-Samba 400kV D/c line (Quad))

5. 1x63 MVar Switchable line reactor on each ckt at Jalandhar end of Kishenpur– Jalandhar D/c direct line (Twin) (formed after bypassing both ckts of 400kV Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin) at Samba and connecting them together to form Kishenpur– Jalandhar D/c direct line (Twin))
6. 400kV Samba- Jalandhar D/c line (Quad)
(only one circuit is to be terminated at Jalandhar utilizing 1 no. of 400kV vacated line bay at Jalandhar S/s (formed with bypassing of 400kV Jalandhar – Nakodar line (Quad) at Jalandhar) while second circuit would be connected to bypassed circuit of Jalandhar –Nakodar 400kV line (Quad))
7. 1x80 MVar Switchable line reactor at Samba end of Samba –Nakodar direct line (Quad) formed after bypassing of 400kV Jalandhar – Nakodar line (Quad) at Jalandhar and connecting it with one of the circuit of Samba-Jalandhar 400kV D/c line (Quad Moose), thus forming Samba – Nakodar line (Quad)
8. Bypassing 400kV Jalandhar – Nakodar line (Quad) at Jalandhar and connecting it with one of the circuit of Samba-Jalandhar 400kV D/c line (Quad Moose), thus forming 400kV Samba –Nakodar (Quad) direct line

B. Transmission scheme for evacuation of power from Ratle HEP (850MW) & Kiru HEP (624 MW): Part-B

9. Reconductoring of 400 kV Kishenpur-Kishtwar section (up to LILO point) with Twin HTLS (minimum 2100 MVA capacity) (formed after LILO of Kishenpur-Dulhasti line at Kishtwar S/s) along with bay upgradation works (2000A to 3150A) at Kishenpur end for above line.
10. Bypassing both ckts of 400kV Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin) at Samba and connecting them together to form 400kV Kishenpur– Jalandhar D/c direct line (Twin)
(4 nos. of vacated 400kV line bays at Samba S/s will be utilized for 400 kV Kishenpur-Samba D/c line (Quad) & 400kV Samba- Jalandhar D/c line (Quad))
11. Bays upgradation works (2000A to 3150A) at Samba end (4 nos. bays vacated after bypassing of Kishenpur – Samba D/c line (Twin) & 400 kV Samba – Jalandhar D/c line (Twin))

The dedicated transmission system for Ratle HEP (850MW) & Kiru HEP (624 MW) would remain the same as indicated in in-principal grant of intimation.

B4. Revision in timeline of Augmentation of 400/220 kV, 1x315 MVA (3rd) ICT at 400/220kV New Wanpoh substation

It was stated that in 21st CMETS-NR meeting, based on the request of JKPTCL to meet the growing demand of power in J&K, as well as to fulfill the N-1 criteria of ICTs in future, proposal to implement one no. of 400/220kV, 315 MVA ICT (3rd) at New Wanpoh (PG) S/s under ISTS was agreed. Further, JKPTCL vide mail dated 01.02.24 mentioned the firm schedule to be considered as 31.12.25 for above ICT augmentation. Subsequently, as per CTU OM 22.03.24, CTU approved the implementation of the transmission scheme “Augmentation of Transmission Capacity at 400/220kV New Wanpoh (PG)

S/s in Jammu and Kashmir by 400/220kV, 1x315 MVA ICT(3rd)” by the implementing agency “Power Grid Corporation of India Ltd.” with timeline of 31.12.25

Subsequently, POWERGRID vide letter dated 24.12.24 informed that several challenges are being faced in awarding the contract execution of substation extension work at New-Wanpoh Substation with a completion schedule of 21 months i.e., Dec'25 based on CTUIL OM dated 22.03.24. POWERGRID also mentioned that the NIT had been issued in July'24 for the subjected work with a completion schedule up to Dec'25 and already 17 extensions have been given to bidders for submission of bids but not even a single response has been received till date. The bidders had not shown any interest in the above project due to a very challenging terrain as well as non-standard rating of transformer. Bidders had shown their apprehension for supply of transformer rating of 3x105MVA single phase units (315MVA) at higher altitude and it is learnt from their pre-bid meetings that supply of this type of transformer itself will take 21 months and further require considerable time for execution. Considering the above challenges POWERGRID requested CTUIL to consider revising schedule with a fresh schedule project to 30 months from revised CTUIL OM.

Accordingly, proposal was deliberated in 36th CMETS-NR meeting held on 15.01.25. In the meeting JKPTCL stated that Mirbazar capacity augmentation (475VA to 630MVA) will likely to come up by Mar'26. In addition Salal S/s is being implemented in TBCB with commissioning schedule of Mar'27, however ICT augmentation may be required by Mar'26 and POWERGRID can avail that time for ICT augmentation.

POWERGRID stated that they would require at least 30 months (24 months for supply and 6 months for execution) from revised OM date. POWERGRID stated that present bid will be annulled and now in new bid, transformer supply and execution packages kept separately. CTU stated that with present bid status, it is envisaged that ICT would not be available before Aug'27. JKPTCL stated that with increased load of Mirbazar S/s, New Wanpoh ICTs may cater the load, however with their proposed Salal S/s, ICT augmentation is required with best effort schedule of Mar'27. CEA requested POWERGRID to expedite the implementation for reliable dispersal of power in J&K.

CTU stated that recently lot of developments & infrastructure activities were carried out in J&K and with above developments in roads, tunnels, bridges, there may be feasibility of transportation of 315MVA unit rather than 105MVA (Single phase) unit. POWERGRID stated that Mar'27 implementation schedule is not feasible due to 3 months non working period in winters and therefore it is suggested that Jun'27 schedule may be kept for ICT augmentation.

POWERGRID emphasized that single phase configuration may be considered at present as no three phase transformer yet transported through new infrastructure. CTU stated that there is issue in supply and delivery of single phase 105MVA units due to non standard size, therefore to expedite the implementation possibility of 315MVA transformer transportation on new infrastructure (tunnel/road/bridges) may be explored by POWERGRID and inform it within 1 month. JKPTCL stated that they also faced issue of 3 months non working season in winters and therefore based on tendering issues in 105MVA unit as well as POWERGRID request for extension of commissioning of ICT augmentation, it was agreed that Jun'27 schedule may be kept for New Wanpoh ICT augmentation.

Further, POWERGRID vide mail 28.03.25 informed that as there is Tunnel height restriction of 4.8m, which some Transformer manufacturer may be able to meet, it is requested to consider both the options of 105MVA (Single phase) units of 400/220kV ICT and 315MVA (Three phase) 400/220kV ICT for New Wanpoh Substation.

Considering above both the options of 105MVA (Single phase) units of 400/220kV ICT and 315MVA (Three phase) 400/220kV ICT for New Wanpoh Substation are considered for implementation with revised timeline of Jun'27.

In the meeting, Powergrid informed that apart from tunnel height restriction, there is bridge limitation also, which may restrict transportation of 315MVA 3 phase ICT. Powergrid further stated that road near Ramban is recently damaged and there are so many constraints in transportation of 3-Ph ICT. CTU stated based on Powergrid inputs, both the options of 105MVA (Single phase) units of 400/220kV ICT and 315MVA (Three phase) 400/220kV ICT for New Wanpoh Substation were considered.

CTU enquired Powergrd that is there any issue in bidding of 315MVA (3X105MVA) ICT. Powergrd stated that earlier bid was called for 1-Ph configuration, however transportation of 3-Ph ICT is technically more feasible, and it is recommended that 1-Ph ICT configuration may be considered in present proposal. CTU informed that Powergrid may provide the mail in this regard so that ICT augmentation (3-Ph or 1-Ph) may be taken up on urgent basis with Jun'27 time schedule.

Annexure-I

Transmission system for Connectivity under GNA at Bikaner-VI PS(Tentative)

1. Establishment of 2x1500 MVA 765/400 kV Pooling Station at suitable location near Bikaner (Bikaner-VI PS) along with 2x330 MVar & 2x125 MVar bus reactors
2. LILO of both ckts of 400kV Bikaner-II PS- Khetri D/c line (2nd) at Bikaner-VI PS
3. 400 kV Bikaner-V – Bikaner-VI D/c line(Quad)
4. 765 kV Bhadla-V – Bikaner-VI D/c line
5. Establishment of 6000 MW, Bikaner-VI(HVDC) terminal station (4x1500 MW) at a suitable location near Bikaner-VI PS
6. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
7. HVDC line between Bikaner-VI (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
8. Establishment of 765/400kV, 2x1500 MVA S/s substation station at suitable location in WR/ER/SR along with 2x125 MVar & 2x240 MVar bus reactor
9. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power
10. 2x[+]300/(-)200MVar Synchronous condenser at 400kV level of Bikaner-VI PS

Additional system for connectivity at 220kV level only of Bikaner-VI PS

1. 400/220kV, 5x500 MVA ICTs at Bikaner-VI PS

Annexure-II

Transmission system for Connectivity under GNA at Barmer-IV PS(Tentative)

1. Establishment of 400kV pooling station at suitable location near Barmer(Barmer-IV PS) along with 2x125 MVar bus reactor
2. 400kV Barmer-III PS – Barmer-IV PS D/c line (Quad)
3. 400kV Barmer-II PS – Barmer-IV PS D/c line (Quad)
4. 400kV Sanchoe PS – Barmer-IV PS D/c line (Quad)
5. Establishment of 6000 MW, ± 800 kV Barmer-IV(HVDC) terminal station (4x1500 MW) at suitable location near Barmer
6. Establishment of 6000 MW, ± 800 kV terminal station (4x1500 MW) at suitable location in WR/ER/SR
7. ± 800 kV HVDC line between Barmer-IV (HVDC) & Suitable location in WR/ER/SR (with Dedicated Metallic Return)
8. Establishment of 765/400kV, 2x1500 MVA S/s substation station at suitable location in WR/ER/SR along with 2x125 MVar & 2x240 MVar bus reactor
9. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power
10. 2x[+]300/(-)200MVar Synchronous condenser at 400kV level of Barmer-IV PS

Additional system for connectivity at 220kV level only of Barmer-IV PS

1. 400/220kV, 5x500 MVA ICTs at Barmer-IV PS

Annexure-III

Transmission system for Connectivity under GNA at Bhadla-V PS(Tentative)

1. Establishment of 765/400kV, 2x1500 MVA pooling station at suitable location near Bhadla (Bhadla-V PS) along with 2x125 MVar & 2x240 MVar bus reactor
2. Bhadla-IV PS – Bhadla-V PS 400kV D/c line (Quad)
3. 765kV Bhadla-V PS – Bikaner-VI PS D/c line
4. Establishment of 6000 MW, ± 800 kV Bhadla-V (HVDC) terminal station (4x1500 MW) at suitable location near Bhadla
5. Establishment of 6000 MW, ± 800 kV terminal station (4x1500 MW) at suitable location in WR/ER/SR
6. ± 800 kV HVDC line between Bhadla-V (HVDC) & Suitable location in WR/ER (with Dedicated Metallic Return)
7. Establishment of 765/400kV, 2x1500 MVA S/s substation station at suitable location in WR/ER/SR along with 2x125 MVar & 2x240 MVar bus reactor
8. Associated transmission system in WR/ER for onwards dispersal of power

Additional system for connectivity at 220kV level only of Bhadla-V PS

1. 400/220kV, 2x500 MVA ICTs at Bhadla-V PS

Annexure-IV

Transmission system for Connectivity under GNA at Ramgarh-II PS (Tentative)

1. Establishment of 2x1500 MVA, 765/400 kV Ramgarh-II Pooling Station at a suitable location near Ramgarh along with 2x125 MVar & 2x240 MVar bus reactor
2. Ramgarh-II PS – Bhadla-IV PS 765 kV D/c line along with 240 MVar switchable line reactor for each circuit at Ramgarh-II PS end
3. Ramgarh PS – Ramgarh-II PS 400 kV D/c line (Quad)
4. LILO of both ckts of 765kV Ramgarh PS – Bhadla-III PS D/c line at Ramgarh-II PS along with 240 MVar switchable line reactor for each circuit at Ramgarh-II PS end
5. Establishment of 6000 MW, Ramgarh(HVDC) terminal station (4x1500 MW) at a suitable location near Ramgarh-II substation
6. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
7. HVDC line between Ramgarh (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
8. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power
9. 2x[+/-]300/(-)200MVar Synchronous condenser at 400kV level of Ramgarh-II PS

Additional system for connectivity at 220kV level only of Ramgarh-II PS

1. 400/220kV, 5x500 MVA ICTs at Ramgarh-II PS

Annexure-V

Transmission system for Connectivity under GNA at Ramgarh-III PS (Tentative)

1. Establishment of 2x1500 MVA, 765/400 kV Ramgarh-III Pooling Station at a suitable location near Ramgarh along with 2x125 MVar & 2x240 MVar bus reactor
2. 765 kV Bhadla-V PS – Ramgarh-III PS D/c line along with 240 MVar switchable line reactor for each circuit at Ramgarh-III PS end
3. LILO of Ramgarh PS – Ramgarh-II PS 400kV D/c line (Quad) at Ramgarh-III PS
4. LILO of both ckts of 765kV Ramgarh-II PS – Bhadla-IV PS D/c line at Ramgarh-III PS along with 240 MVar switchable line reactor for each circuit at Ramgarh-III PS end
5. Establishment of 6000 MW, Ramgarh-III(HVDC) terminal station (4x1500 MW) at a suitable location near Ramgarh-III substation
6. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
7. HVDC line between Ramgarh (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
8. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power
9. 2x[+]300/(-)200MVar Synchronous condenser at 400kV level of Ramgarh-III PS

Additional system for connectivity at 220kV level only of Ramgarh-III PS

1. 400/220kV, 5x500 MVA ICTs at Ramgarh-III PS

Annexure-VI

Transmission system for Connectivity under GNA at Bhadla-III PS

1. Augmentation of 2x500 MVA (8th & 9th), 400/220 kV ICT at Bhadla-III PS
2. Augmentation of 2x1500 MVA (3rd & 4th), 765/400kV ICT at Bhadla-III PS
3. 765 kV Bhadla-III – Bikaner-III D/c line along with 240 MVA_r switchable line reactor for each circuit at Bhadla-III end
4. Bhadla-III – Sikar-II 765 kV D/c line along with 330 MVA_r Switchable line reactor for each circuit at each end of Bhadla-III – Sikar-II 765 kV D/c line
5. Fatehgarh-III – Bhadla-III 400kV D/c line (Quad) along with 63 MVA_r Switchable line reactor for each circuit at both ends of Fatehgarh-III – Bhadla-III 400kV D/c line
6. Establishment of 6000 MW, $\pm$ 800 kV Bhadla (HVDC) [LCC] terminal station (4x1500 MW) at a suitable location near Bhadla-III substation
7. Establishment of 6000 MW, $\pm$ 800 kV Fatehpur (HVDC) [LCC] terminal station (4x1500 MW) at suitable location near Fatehpur (UP)
8. Bhadla-III – Bhadla (HVDC) 400 kV 2xD/c quad moose line along with the line bays at both substations
9. $\pm$ 800 kV HVDC line between Bhadla (HVDC) & Fatehpur (HVDC) (with Dedicated Metallic Return)
10. Augmentation of 5x1500 MVA (1st to 5th), 765/400 kV ICTs at Fatehpur (HVDC) along with 2x330 MVA_r (765kV) bus reactor
11. LILO of both ckts of 765 kV Varanasi – Kanpur (GIS) D/c line at Fatehpur
12. Augmentation by 1x1500 MVA ICT at 765/400kV Kanpur (GIS) substation

Annexure-VII

Transmission system for Connectivity under GNA at Sanchore PS:

1. Establishment of 400 kV Sirohi(HVDC) PS at a suitable location near Sirohi
2. Establishment of 400 kV Sanchore PS at a suitable location near Sanchore
3. Sirohi(HVDC) PS – Sirohi PS 400 kV D/c line(Quad)
4. Sirohi(HVDC) PS – Bhinmal(PG) 400 kV D/c line(Quad)
5. Sanchore PS – Sirohi (HVDC) PS 400 kV D/c line(Quad)
6. Establishment of 6000 MW, Sirohi(HVDC) terminal station (4x1500 MW) at a suitable location near Sirohi(HVDC) PS
7. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
8. HVDC line between Sirohi (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
9. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power

Additional system for connectivity at 220kV level only of Sanchore PS

1. 2x500 MVA, 400/220kV ICTs at Sanchore PS

Annexure-VIII

Transmission system for Connectivity under GNA at Bikaner-V PS(Tentative)

1. Establishment of 765/400kV, 4x1500 MVA pooling station at suitable location near Bikaner (Bikaner-V PS) along with 2x125 MVar & 2x240 MVar bus reactor
2. LILO of both ckts of 400kV Bikaner-II PS- Khetri D/c line at Bikaner-V PS
3. 765kV Bhadla-IV PS – Bikaner-V PS D/c line
4. Establishment of 6000 MW, ± 800 kV Bikaner-V (HVDC) terminal station (4x1500 MW) at suitable location near Bikaner
5. Establishment of 6000 MW, ± 800 kV Begunia (HVDC) terminal station (4x1500 MW) at Begunia (Distt. Khordha), Orissa (ER)
6. ± 800 kV HVDC line between Bikaner-V (HVDC) & Begunia (HVDC) (with Dedicated Metallic Return)
7. Establishment of 765/400kV, 5x1500 MVA S/s substation station at Begunia along with 2x125 MVar & 2x240 MVar bus reactor
8. Begunia – Paradeep (ISTS) 765kV D/c line along with associated bays at both ends
9. Begunia – Gopalpur (ISTS) 765kV D/c line along with associated bays at both ends along with 240MVar switchable line reactor for each circuit at Begunia end of Begunia –Gopalpur (ISTS) 765kV D/c line
10. Begunia – Khuntuni (OPTCL) 765kV D/c line

Additional system for connectivity at 220kV level only of Bikaner-V PS

1. 8x500 MVA, 400/220kV ICTs at Bikaner-V PS

Annexure-IX

Transmission system for Connectivity under GNA at Jalore PS:

1. Establishment of 400 kV Sirohi(HVDC) PS at a suitable location near Sirohi
2. Establishment of 400 kV Jalore PS at a suitable location near Jalore
3. Sirohi(HVDC) PS – Sirohi PS 400 kV D/c line(Quad)
4. Sirohi(HVDC) PS – Bhinmal(PG) 400 kV D/c line(Quad)
5. Jalore PS – Merta-II PS 400 kV D/c line(Quad)
6. Jalore PS – Sirohi(HVDC) PS 400 kV 2xD/c line(Quad)
7. Establishment of 6000 MW, Sirohi(HVDC) terminal station (4x1500 MW) at a suitable location near Sirohi(HVDC) substation
8. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
9. HVDC line between Sirohi (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
10. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power

Additional system for connectivity at 220kV level only of Jalore PS

1. 5x500 MVA, 400/220kV ICTs at Jalore PS

Annexure-X

Transmission system for Connectivity under GNA at Pali PS (tentative):

1. Establishment of 400kV at suitable location near Pali (Pali PS) along with 2x125 MVar bus reactor
2. Pali PS – Beawar (HVDC) S/s 400 kV D/c line(Quad)
3. Establishment of 400 kV Beawar (HVDC) S/s at a suitable location near Beawar
4. Beawar(HVDC) PS – Beawar 400 kV D/c line(Quad)
5. Establishment of 6000 MW, Beawar (HVDC) terminal station (4x1500 MW) at a suitable location near Beawar (HVDC) substation
6. Establishment of 6000 MW, HVDC terminal station (4x1500 MW) at suitable location in WR/SR/ER
7. HVDC line between Beawar (HVDC) & HVDC terminal station in WR/SR/ER (with Dedicated Metallic Return)
8. Associated EHVAC system strengthening in WR/SR/ER for onwards dispersal of power

Additional system for connectivity at 220kV level only of Pali PS

1. 4x500 MVA, 400/220kV ICTs at Pali PS



सेंद्रल ट्रान्समिशन यूलिटी ऑफ इंडिया लिमिटेड

(पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड के स्वामित्व में)

(भारत सरकार का उद्यम)

CENTRAL TRANSMISSION UTILITY OF INDIA LTD.

(A wholly owned subsidiary of Power Grid Corporation of India Limited)

(A Government of India Enterprise)

Ref:CTU/N/BBMB/1

Date:26-06-2025

As per distribution list

Subject: Meeting regarding grant of connectivity of 10 MW & 1.5 MW to BBMB at Bhiwani (BBMB) S/s & Hisar (BBMB) S/s respectively

Dear Sir/Ma'am,

Please find enclosed the minutes of joint meeting among CEA, Grid India, CTUIL, BBMB and HVPNL held on 04-06-2025 in virtual mode regarding grant of connectivity of 10 MW & 1.5 MW to BBMB at Bhiwani (BBMB) S/s & Hisar (BBMB) S/s respectively.

Thanking you,

Yours faithfully,

(Partha Sarathi Das)
Sr. General Manager (CTU)

Distribution List:

Chief Engineer (PSP&A – I) Central Electricity Authority Sewa Bhawan, R.K.Puram, New Delhi-110 066	Director (SO) Grid Controller of India Limited (erstwhile Power System Operation Corporation Ltd.) 9 th Floor, IFCI Towers, 61, Nehru Place, New Delhi-110 016
Executive Director Northern Regional Load Despatch Centre 18-A, Qutab Institutional Area, Shaheed Jeet Singh Sansanwal Marg, Katwaria Sarai, New Delhi– 110 016	Member (Power) Bhakra Beas Management Board Sector-19 B, Madhya Marg, Chandigarh - 160019
Director (Technical) Haryana Vidyut Prasaran Nigam Ltd. Shakti Bhawan, Sector-6, Panchkula-134109, Haryana	

Minutes of Meeting held through virtual mode on 04.06.2025 regarding the issues raised by HVPNL on grant of connectivity of 10 MW & 1.5 MW to BBMB at Bhiwani(BBMB) & Hissar(BBMB) respectively

Background:

CERC vide RoP dated 17.04.2025(on hearing of Petition No. 395/MP/2025 by BBMB) had directed BBMB to apply to CTUIL seeking connectivity for its solar projects of 10 MW (at Bhiwani BBMB S/s) and 1.5 MW (at Hissar BBMB S/s), through separate applications. In the same RoP, CERC had also directed CTUIL to process the same expeditiously keeping in view the SCOD on 28.4.2025.

Subsequently, BBMB applied for connectivity of 10 MW at Bhiwani (BBMB) vide above application dated 29.04.2025. Accordingly, in line with the CERC direction, considering the SCOD of the project, the above connectivity application were taken up for discussion & grant in the 38th CMETS NR meeting held on 28.05.2025.

In the 38th CMETS NR meeting, HVPNL raised their concern regarding the grant of connectivity to BBMB. Considering the concerns raised by HVPNL in the CMETS NR meeting, it was decided that a separate meeting will be held in VC mode with HVPNL, BBMB, CEA, Grid India & CTUIL to discuss the issues raised by HVPNL.

Subsequently, a meeting was held on 04.06.2025 to discuss the issues raised by HVPNL.

Deliberations in the meeting:

In the meeting CTUIL informed that BBMB has applied for connectivity of 1.5 MW for their proposed Solar Project which is being interconnected at 33kV Bus of Hissar (BBMB) S/s.

BBMB informed that the 33kV Bus is owned and maintained by BBMB, therefore as per the CERC orders, the 33 kV Bus is an ISTS element. Accordingly, they have proposed to interconnect their solar plant at 33 kV Bus.

HVPNL in the meeting enquired about the metering arrangement of the solar plant. Regarding this, BBMB informed that they have received approval for metering arrangement from Grid India. Grid India confirmed that the BBMB has already discussed the metering arrangement them & the same has been finalized. Accordingly, drawl and injection shall be accounted for by the interface meter as per the approved metering arrangement.

CTUIL informed that as metering arrangement is approved by Grid India, connectivity of 1.5 MW at Hissar (BBMB) S/s can be agreed with the approved metering arrangement being put in place, as there is no technical & commercial issue. HVPNL agreed for the same.

Regarding the connectivity of 10 MW at Bhiwani (BBMB) S/s, CTUIL informed that BBMB has proposed to interconnect the 10 MW solar project at 132 kV Bus at Bhiwani(BBMB) S/s.

BBMB informed that the 132 kV Bus at Bhiwani(BBMB) S/s is owned & maintained by BBMB. Therefore, the same is part of ISTS system as per CERC orders. They are interconnecting their solar project with the same bus. Two no. of 132 kV lines of HVPN towards Hansi & Bhiwani are also interconnected at the same 132 kV bus at Bhiwani(BBMB) S/s.

HVPN informed that 132 kV bus at Bhiwnai(BBMB) is not connected with 220 kV or 400 kV system of Bhiwani(BBMB) S/s. The entire 132kV system is interconnected with HVPN intra state system. Therefore, the 132 kV Bus should not be considered as ISTS system as this bus is not interconnected with any ISTS system. This 132 kV interconnection was provided by HVPN to provide auxiliary power to BBMB.

BBMB informed that the power generated by their solar project shall be evacuated to all partner states including Haryana with the apportioned ratio and scheduling shall be done by NRLDC.

Grid India informed that as a special case the scheduling of the solar plants of BBMB shall be done by NRLDC. Grid India also informed that BBMB is a meshed network, which is interconnected with ISTS system as well as intra state system of STU networks of Punjab, Himachal, Haryana etc.

CEA informed that as the BBMB network is considered as ISTS network, there is no issue technically for grant of connectivity to BBMB at 132 kV Bus at Bhiwani(BBMB) S/s

Grid India also informed that as entire power (10 MW) from the solar plant is evacuated through intra state lines of Haryana, HVPN may claim the benefit for their allocated portion of power(out of 10 MW) under 'Direct drawl' by a State as per Annexure-II of GNA Regulations 2022 1st Amendment. Accordingly, Grid India advised HVPNL to file their response with CERC to claim this benefit and facilitate the connectivity of BBMB solar project.

CTUIL enquired BBMB about the possibility of shifting their connectivity to the 33kV tertiary side of 400/220 kV ICTs. Regarding this, BBMB informed that their transformers are very old and are under replacement. Therefore, they are not in a position to utilize their tertiary system.

After deliberations, it was decided to grant connectivity to BBMB at Bhiwani & Hissar. Regarding any envisaged commercial issues, HVPN was advised to approach CERC for the same.

List of Participants of Meeting regarding BBMB connectivity held on 04.06.2025

CEA

Shri Nitin Deswal	Deputy Director
-------------------	-----------------

Grid India

Shri Sheikh Shadrudin	Sr. GM, NRLDC
-----------------------	---------------

CTUIL

Shri Partha Sarathi Das	Sr. GM (CTUIL)
Shri Sandeep Kumawat	DGM (CTUIL)
Shri Narendra Sathvik Ranganath	Ch. Manager (CTUIL)
Shri Yatin Sharma	Manager (CTUIL)
Shri Madhusudan Meena	Engineer (CTUIL)

HVPNL

Shri Rajeev Kumar	CE (SO & Commercial)
Shri Rohtas Kaushik	SE
Shri Subhash Dhiman	XEN (Area Planning-II)

BBMB

Smt. Ruchi Sharma	Director (Power Regulation), BBMB Chandigarh
Shri Satwant Kaur	Director (P&D TS), BBMB Chandigarh
Shri Surjeet Singh	CE (TS), BBMB Chandigarh
Shri Vijay Singh	SE (O&M), BBMB Bhiwani
Shri Tarun Dewan	XEN(O&M), BBMB Hisar
Shri Rakesh Tewatia	XEN(O&M), BBMB Bhiwani

List of Participants of 38th Consultation meeting for Evolving Transmission Schemes in NR held on 28.05.2025**CEA**

Smt. Kavita Jha	Director
-----------------	----------

SECI

Shri Vineet Kumar	DGM
-------------------	-----

NRPC

Shri D. K. Meena	SE
------------------	----

Grid India

Shri Gaurav Malviya	Manager, NRLDC
---------------------	----------------

CTUIL

Shri Partha Sarathi Das	Sr. GM (CTUIL)
Shri Sandeep Kumawat	DGM (CTUIL)
Shri Narendra Sathvik Ranganath	Ch. Manager (CTUIL)
Shri Yatin Sharma	Manager (CTUIL)
Shri Madhusudan Meena	Engineer (CTUIL)
Shri Rishabh Bansal	ET (CTUIL)
Shri Kumar Anjul	ET (CTUIL)
Shri Jayesh Raikwar	ET (CTUIL)

POWERGRID

Shri Arikilla Sambaiiah	Sr. DGM
Shri Vijay Srivastava	Sr. DGM
Shri Rakesh Kumar Gupta	DGM
Shri Rohit Kumar Jain	DGM

JKPTCL

Shri Ajaz Ahmad Sheikh	SE
------------------------	----

RVPNL

Shri Dr. Om Prakash Mahela	XEN(PP&D)
----------------------------	-----------

HPPTCL

Shri Harmanjeet Singh	AE(Plg.)
-----------------------	----------

HVPN

Shri Sanjay Verma	SE(Plg.)
Shri Rohtas Kaushik	SE
Shri Ramesh Chand	Ex. En (Sys. Study)

UPPTCL

Shri Satyendra Kumar	SE
----------------------	----

Connectivity/GNA Applicants

Annexure-A

Shri Ajay Pradhan	ACME Solar Holdings Limited, ACME Taurus Urja Private Limited
Shri Yogesh Sanklecha	ACME Solar Holdings Limited, ACME Taurus Urja Private Limited
Shri Tushar Goyal	ACME Solar Holdings Limited, ACME Taurus Urja Private Limited
Shri Rahul Kumar	ACME Solar Holdings Limited, ACME Taurus Urja Private Limited
Shri Vaibhav Kapoor	ABREL (RJ) Projects Limited
Shri Diwakar Kumar	Adani Green Energy Holding Twelve Limited
Shri Mahendra Singh Dabi	Adani Green Energy Holding Twelve Limited
Shri Shubham Roy	Adyant Enersol Private Limited
Shri Tapan Rajpurohit	Aman Hospitality Private Limited
Shri Gopal Eti	Apraava Energy Private Limited
Shri Manjunath Hidakal	Apraava Energy Private Limited
Shri Vishal Kumar	Azure Power Fifty One Private Limited
Shri Vijay Singh	BBMB
Shri Surjeet Singh	BBMB
Shri Tarun Dewan	BBMB
Shri Rahul Tyagi	BN Peak Power-3 Private Limited
Shri Punkaj Kumar	Chenab Valley Power Projects Limited
Shri Mohan Lal Thakur	Chenab Valley Power Projects Limited
Shri Pawan Kumar Sharma	Green Infra Renewable Energy Farms Private Limited
Shri Devi Dutta	Green Infra Renewable Energy Farms Private Limited
Shri Pramod Chauhan	Godavari Green, Mahanadi Renewable, Sabarmati Green Energy Pvt. Ltd.
Shri Harshit Gupta	Hexa Climate Solutions Private Limited
Shri Vinod Kumar Jaroli	Hindustan Zinc Limited
Shri Surendra Kumar Sharma	Jindal India RE Limited
Shri Manish Tak	Juniper Green Energy Private Limited
Shri Pavan Kumar Gupta	Juniper Green Stellar Private Limited
Shri Manish Pratap Singh	Northern Railway/Delhi Division
Shri Manish Tiwari	Northern Railway/Delhi Division
Smt Archana Garg	Northern Railway/Delhi Division
Smt Ritu Kaira	ReNew Solar Power Private Limited
Shri Mohit Jain	ReNew Solar Power Private Limited
Shri Sanjay	RJS Renewables Private Limited
Shri Dhir Singh	Solarcraft Power India 4 Private Limited
Shri Santosh Narayan	Tata Power Renewable Energy Limited
Shri Devansh Patel	Torrent Green Energy Private Limited
Shri Ashok Kumar Sana	Vedanta- Oil and Gas Limited
Shri Vikram Malkotia	Vismaya Four Renewables Private Limited
Shri Sharul Khan	Waaree Forever Energies Private Limited
Shri Deepak A Parmar	Waaree Forever Energies Private Limited