


Overview :-


SMART ENERGY
MULTI-ROOM IOT
TELEMETRY OPERATIONS
Overview
Appliance Control
Occupancy Monitoring
Energy Analytics
History & Reports
Settings
Hub Gateway
v2.4.12-r
ESP32 CONTROLLER: ONLINE • Hardware Testbed
Overview
MINIATURE TESTBED
Smart Multi-Room Energy Manager
System Online | Prototype Link: Active
TOTAL ROOMS
3
Monitored Units
OCCUPIED ROOMS
2 / 3
Active sensor detections
67% Active
APPLIANCES ON
3 / 6
1 Fan, 2 Lights active
SYSTEM STATUS
Online
ESP32 Controller Connected
Room Overview
Independent 3-room hardware status (LD2410C + DC Fan + LED Light)
Physical Prototype 1:1 Scale
Room 1
Main Office
Occupied
Room 1 Main Office Occupied
Room 1 Main Office ON
Room 1 Main Office ON
Demonstration Data
Real-time Sync
Room 2
Meeting Space
Occupied
Room 2 Meeting Space Occupied
Room 2 Meeting Space OFF
Room 2 Meeting Space ON
Demonstration Data
Real-time Sync
Room 3
Workstation Lab
Vacant
Room 3 Workstation Lab Vacant
Room 3 Workstation Lab OFF
Room 3 Workstation Lab OFF
DEMO DATA
Auto-cutoff active (03:45)
Energy Summary
HARDWARE STATUS: NOTICE
Energy measurement not connected
CT sensor / power measurement hardware module not installed on physical prototype. Live Wattage & kWh monitoring will activate upon hardware module integration.
CURRENT POWER
Hardware Unlinked
-- W
Awaiting Current Transformer
TOTAL CONSUMED
Hardware Unlinked
-- kWh
Accumulator offline
Relay Telemetry Active
Hardware Prototype Testbed
Recent Activity
LIVE LOG
Room 1 Occupancy Detected
2 mins ago
LD2410C micro-radar sensor triggered lighting & motor actuators
Room 2 Fan Switched OFF
14 mins ago
Appliance manual toggle / eco action
Room 3 Vacancy Countdown Started
28 mins ago
No presence detected; 5m vacancy timer initiated for auto-cutoff
Telemetry buffer synced
Events: 3/3 Stored


Appliance Control :-

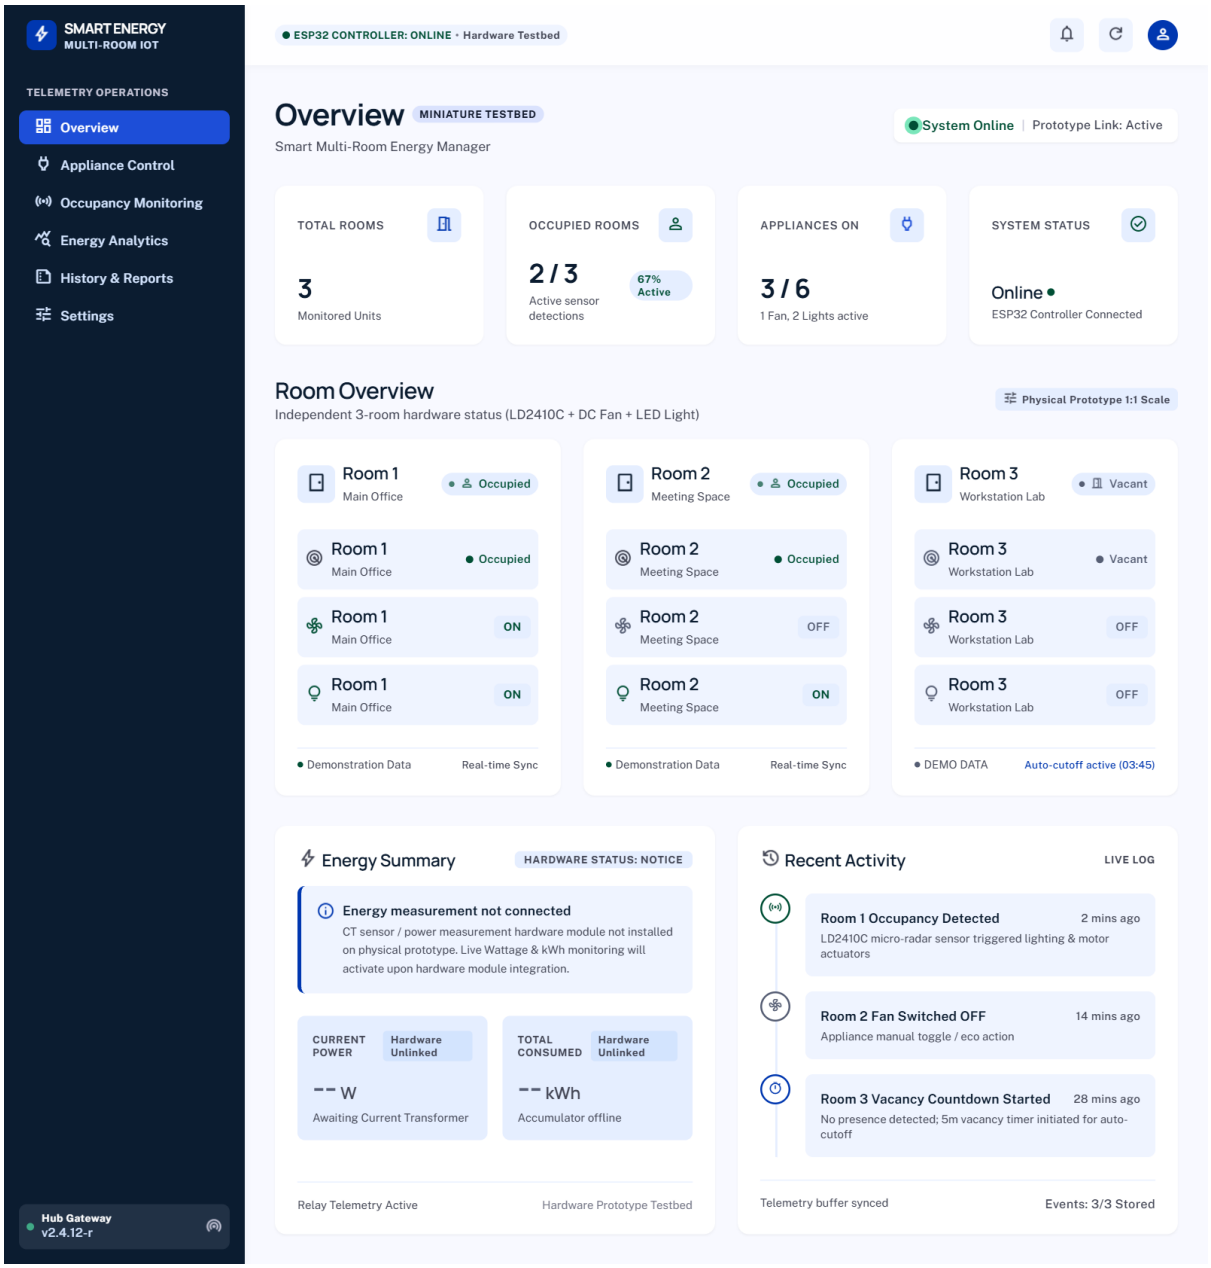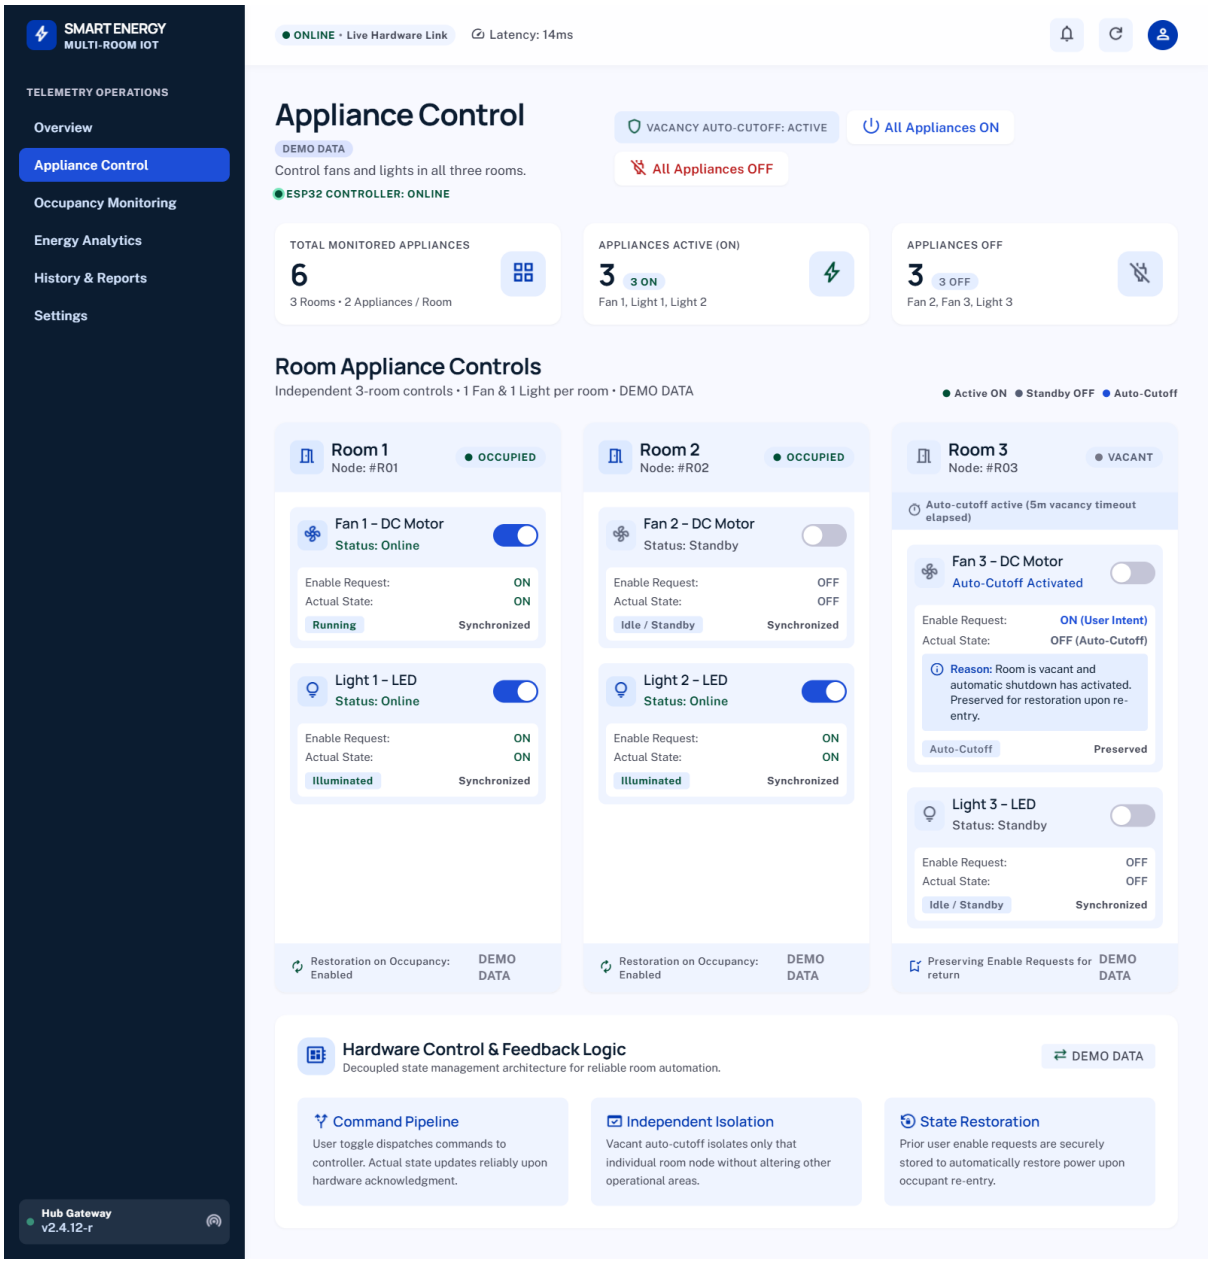


Occupancy Monitoring :-

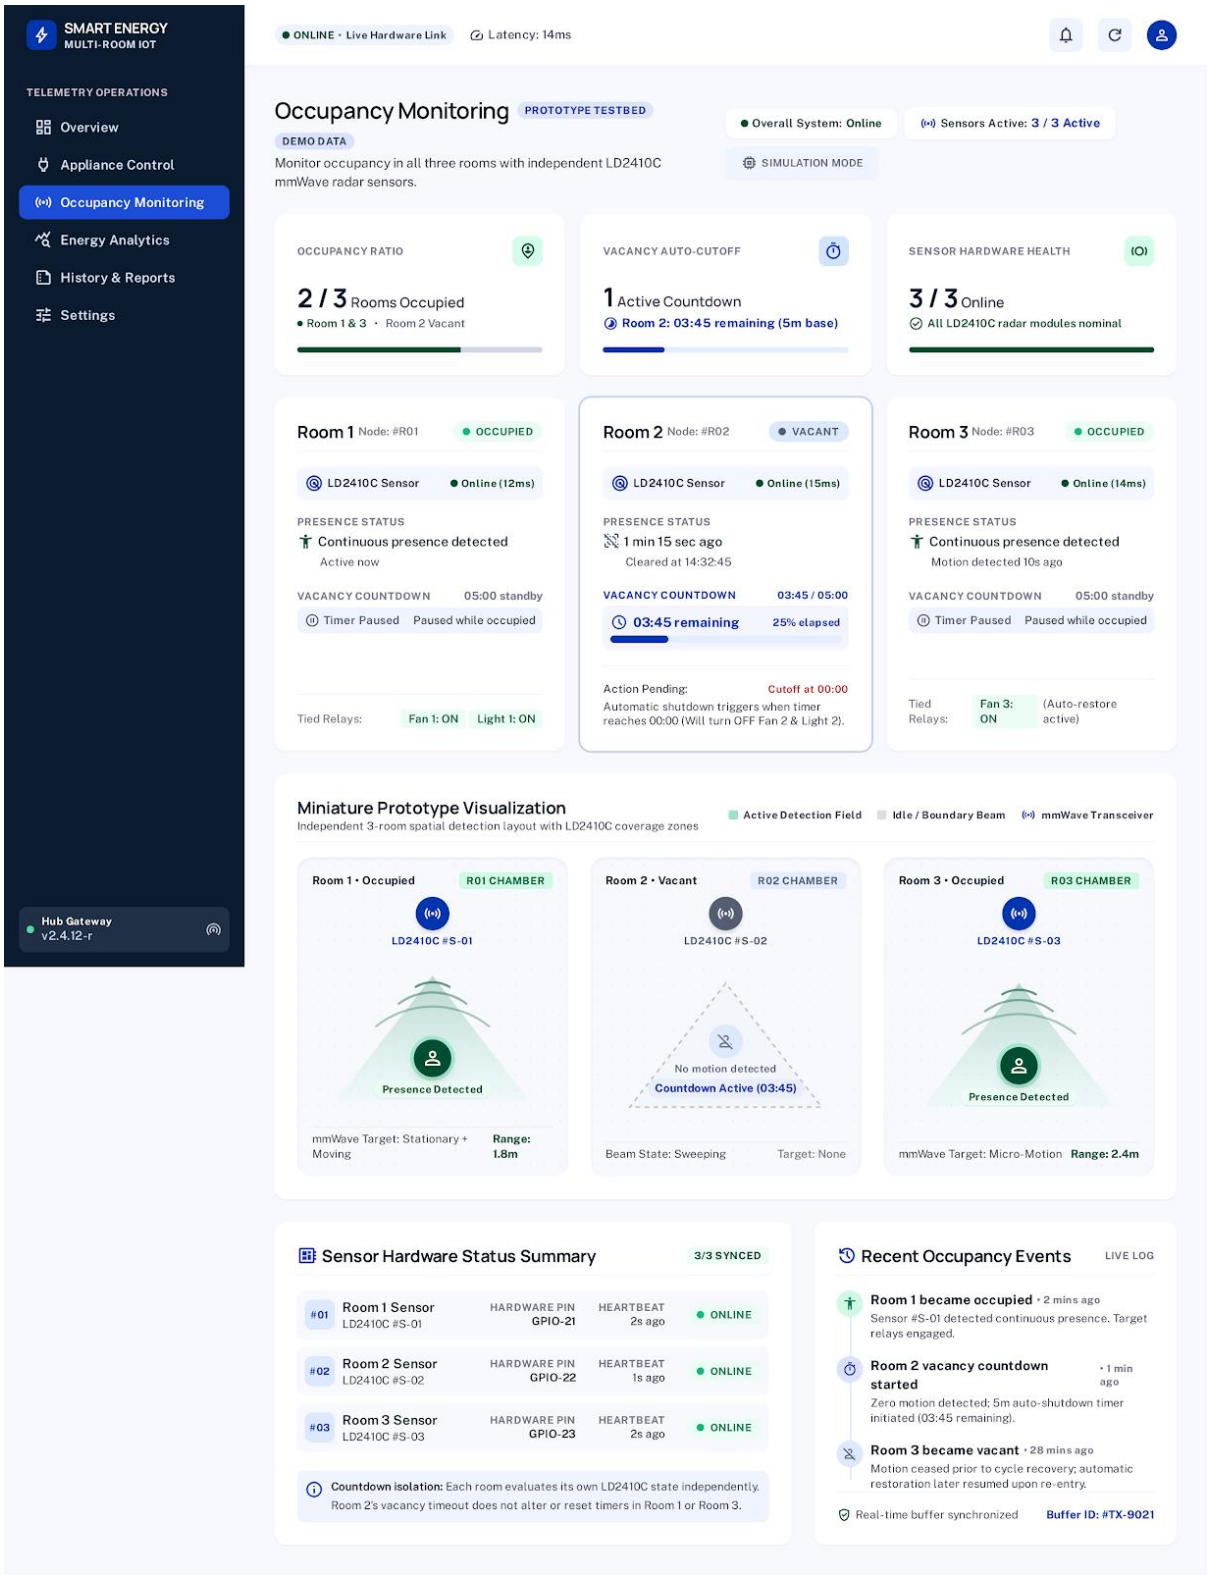


Energy Analytics :-

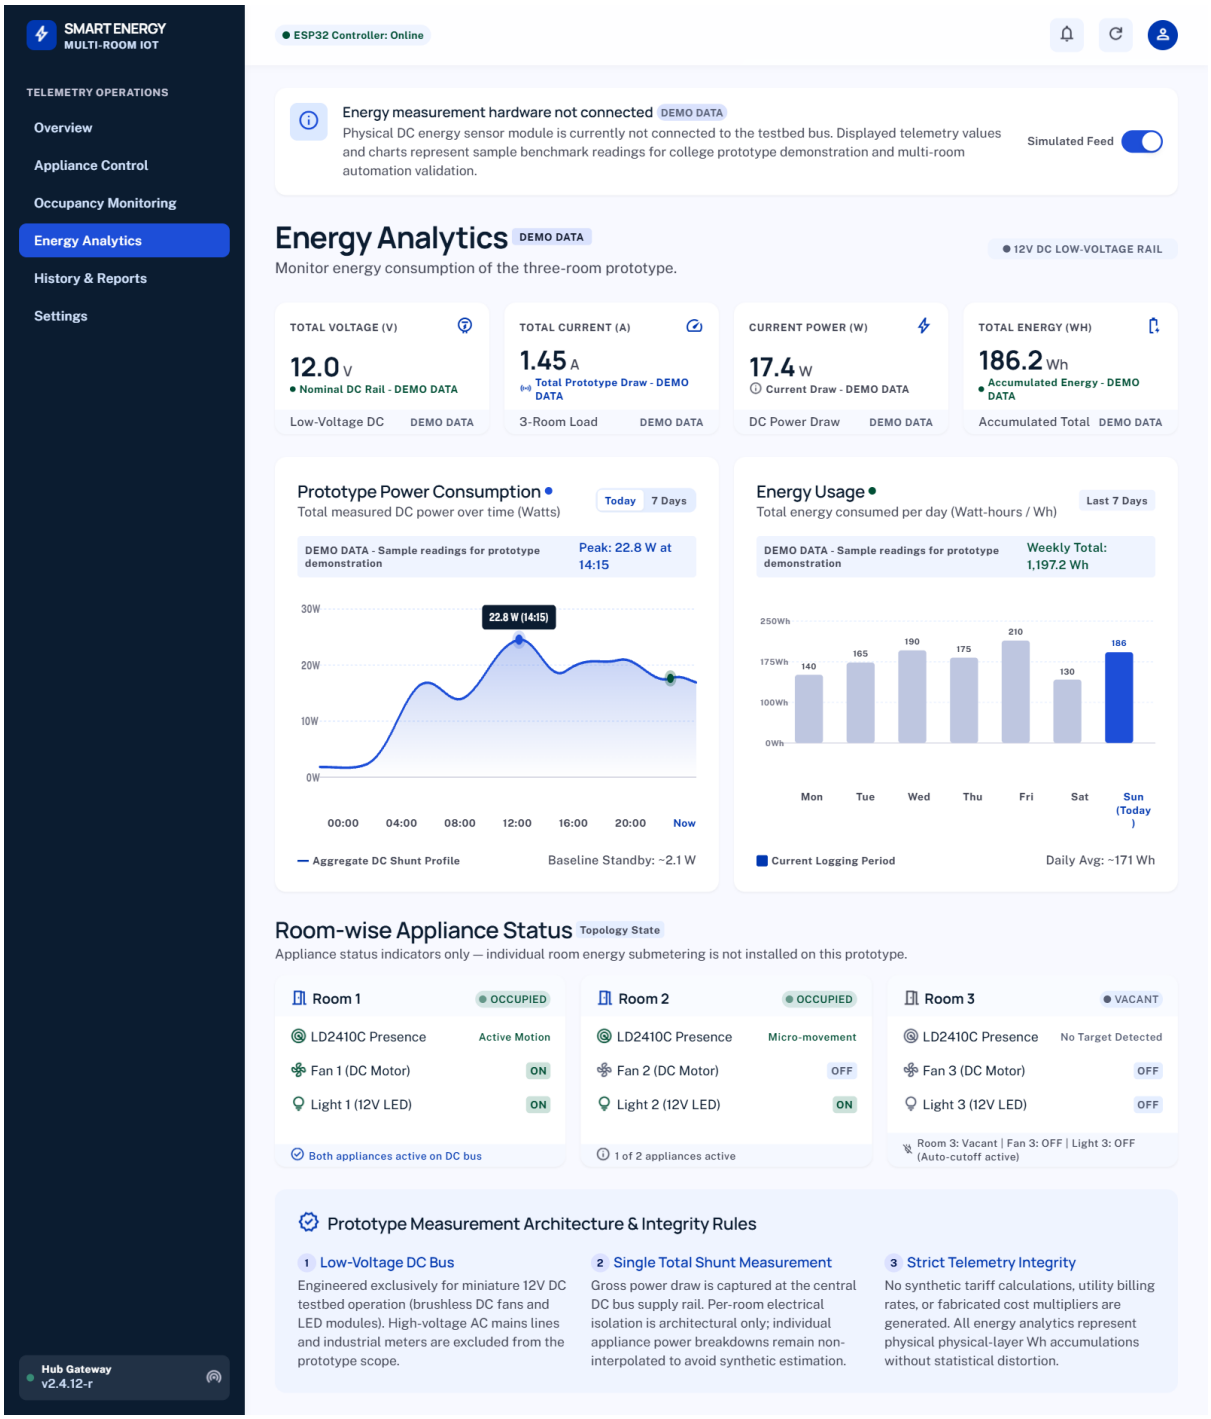

History & Reports :-

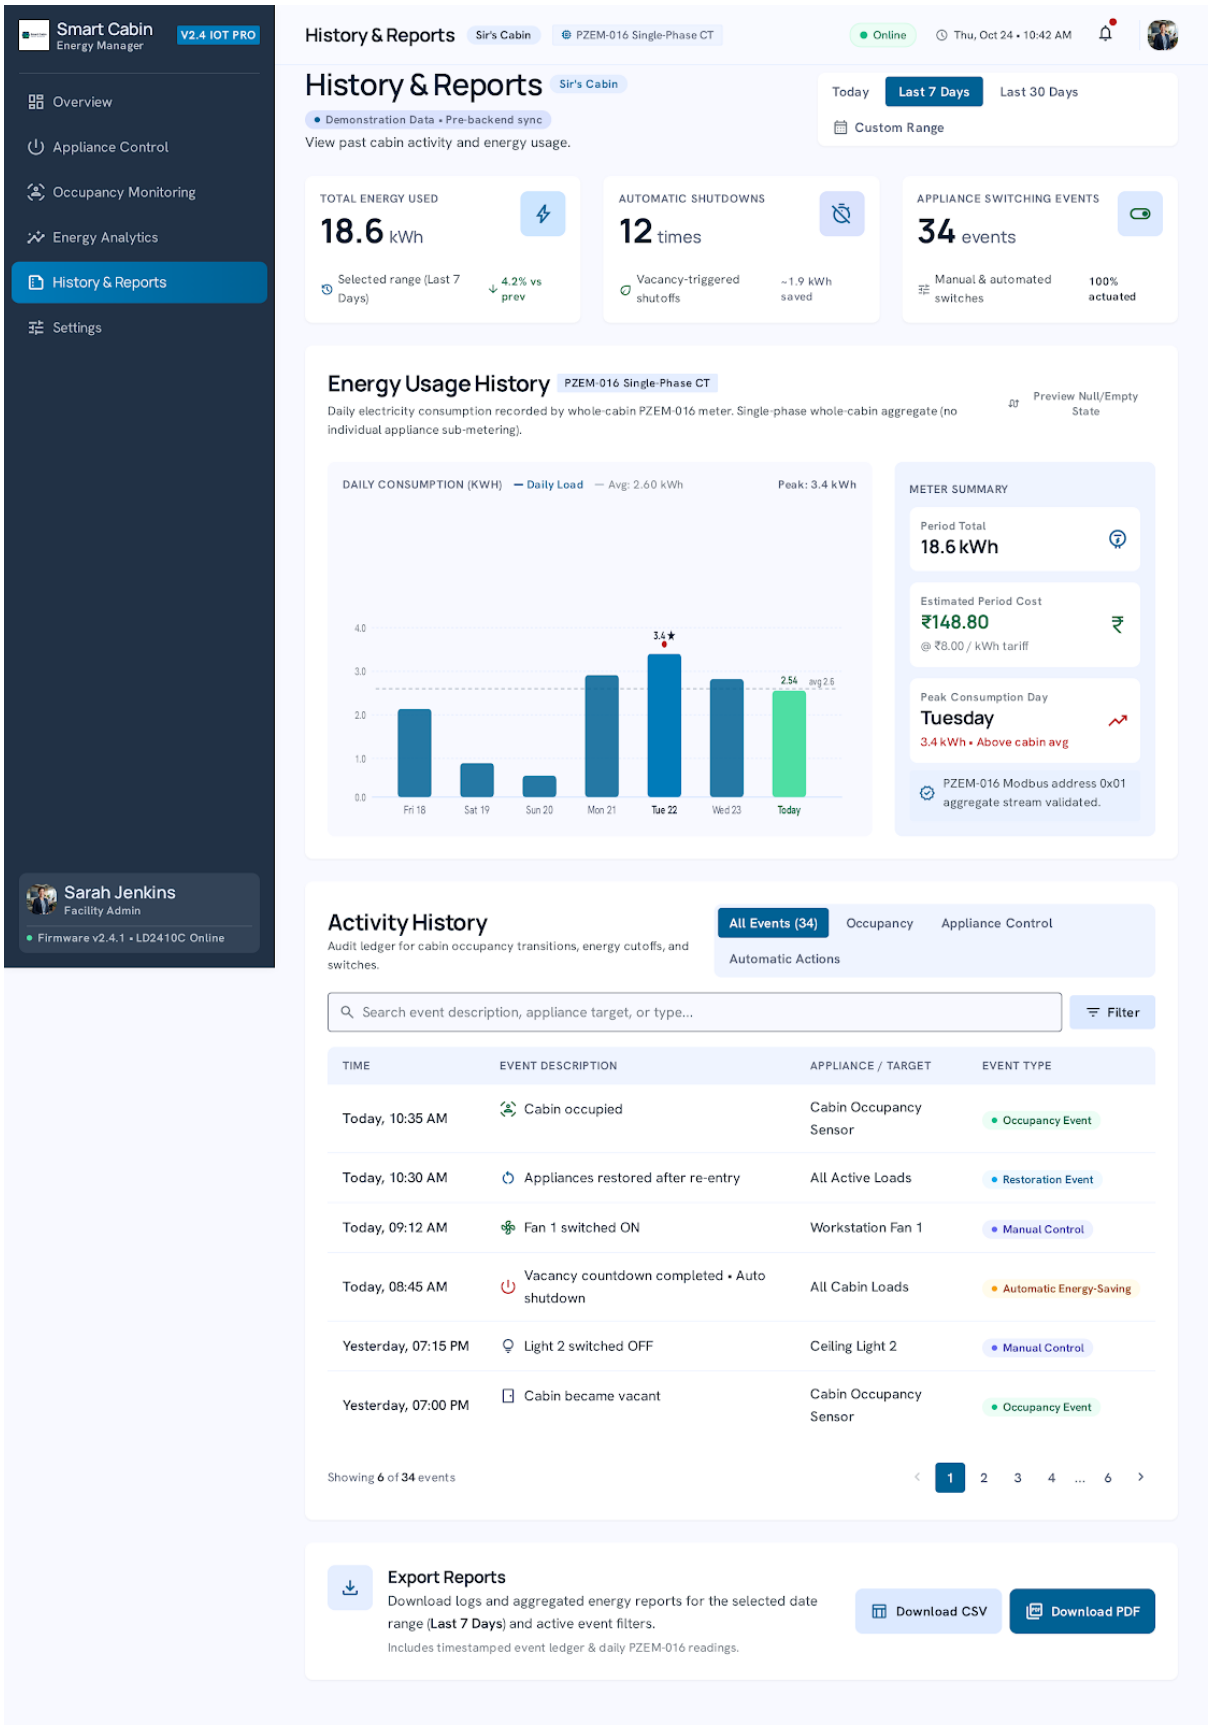

Settings :-

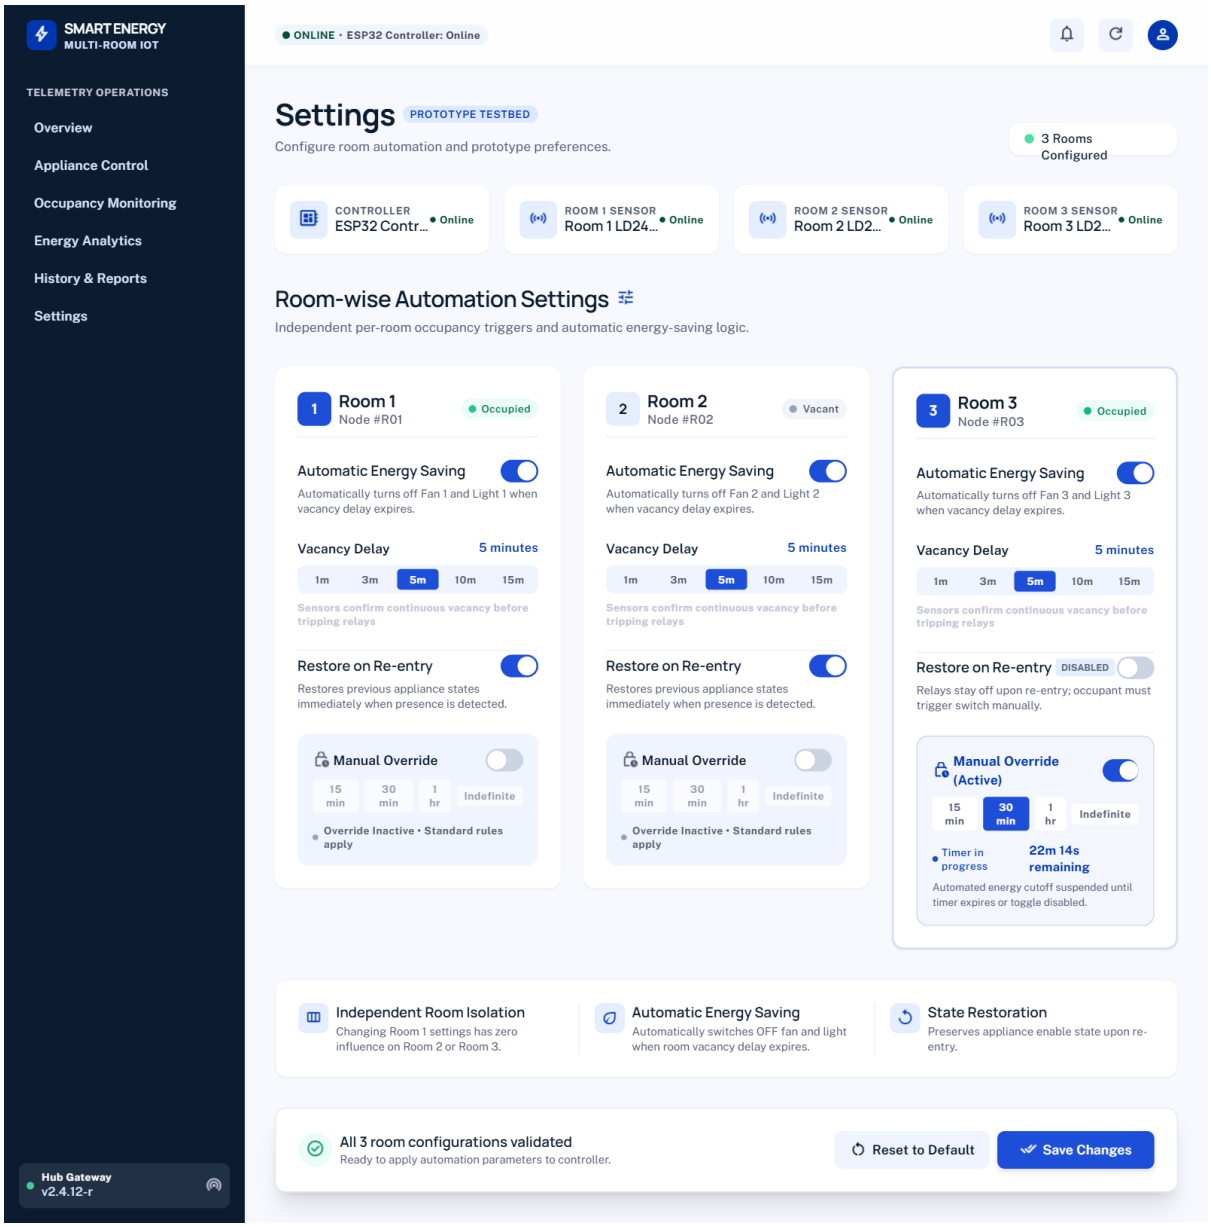
SMART ENERGY
MULTI-ROOM IOT
TELEMETRY OPERATIONS
Overview
Appliance Control
Occupancy Monitoring
Energy Analytics
History & Reports
Settings
Hub Gateway
v2.4.12-r
ONLINE · ESP32 Controller: Online
Settings
PROTOTYPE TESTBED
Configure room automation and prototype preferences.
3 Rooms Configured
CONTROLLER
ESP32 Contr... Online
ROOM 1 SENSOR
Room 1 LD24... Online
ROOM 2 SENSOR
Room 2 LD2... Online
ROOM 3 SENSOR
Room 3 LD2... Online
Room-wise Automation Settings
Independent per-room occupancy triggers and automatic energy-saving logic.
1 Room 1
Node #R01
Occupied
Automatic Energy Saving
Automatically turns off Fan 1 and Light 1 when vacancy delay expires.
Vacancy Delay
5 minutes
1m 3m 5m 10m 15m
Sensors confirm continuous vacancy before tripping relays
Restore on Re-entry
Restores previous appliance states immediately when presence is detected.
Manual Override
15 min 30 min 1 hr Indefinite
Override Inactive · Standard rules apply
2 Room 2
Node #R02
Vacant
Automatic Energy Saving
Automatically turns off Fan 2 and Light 2 when vacancy delay expires.
Vacancy Delay
5 minutes
1m 3m 5m 10m 15m
Sensors confirm continuous vacancy before tripping relays
Restore on Re-entry
Restores previous appliance states immediately when presence is detected.
Manual Override
15 min 30 min 1 hr Indefinite
Override Inactive · Standard rules apply
3 Room 3
Node #R03
Occupied
Automatic Energy Saving
Automatically turns off Fan 3 and Light 3 when vacancy delay expires.
Vacancy Delay
5 minutes
1m 3m 5m 10m 15m
Sensors confirm continuous vacancy before tripping relays
Restore on Re-entry
DISABLED
Relays stay off upon re-entry; occupant must trigger switch manually.
Manual Override (Active)
15 min 30 min 1 hr Indefinite
Timer in progress
22m 14s remaining
Automated energy cutoff suspended until timer expires or toggle disabled.
Independent Room Isolation
Changing Room 1 settings has zero influence on Room 2 or Room 3.
Automatic Energy Saving
Automatically switches OFF fan and light when room vacancy delay expires.
State Restoration
Preserves appliance enable state upon re-entry.
All 3 room configurations validated
Ready to apply automation parameters to controller.
Reset to Default
Save Changes