LAMINEX®

LTO

WITH LVT TECHNOLOGY
FIRE RETARDANT
LOUVERS & LAMINATES

ELEVATE YOUR SPACE
WITH EASE

LVT-10025 HPL-25

LVT-10023 HPL-23

LVT-10026 HPL-26

LVT-10024 HPL-24

LVT-10011 HPL-11

LVT-10012 HPL-12

LVT-10013 HPL-13

LVT-10014 HPL-14

LVT-10016 HPL-16

LVT-10017 HPL-17

LVT-10015 HPL-15

LVT-10018 HPL-18

LVT-10022 HPL-22

LVT-10020 HPL-20

LVT-10019 HPL-19

LVT-10021 HPL-21

WARM & WELCOMING

Specially made to look good even in high traffic environment.

Authentic *flair*

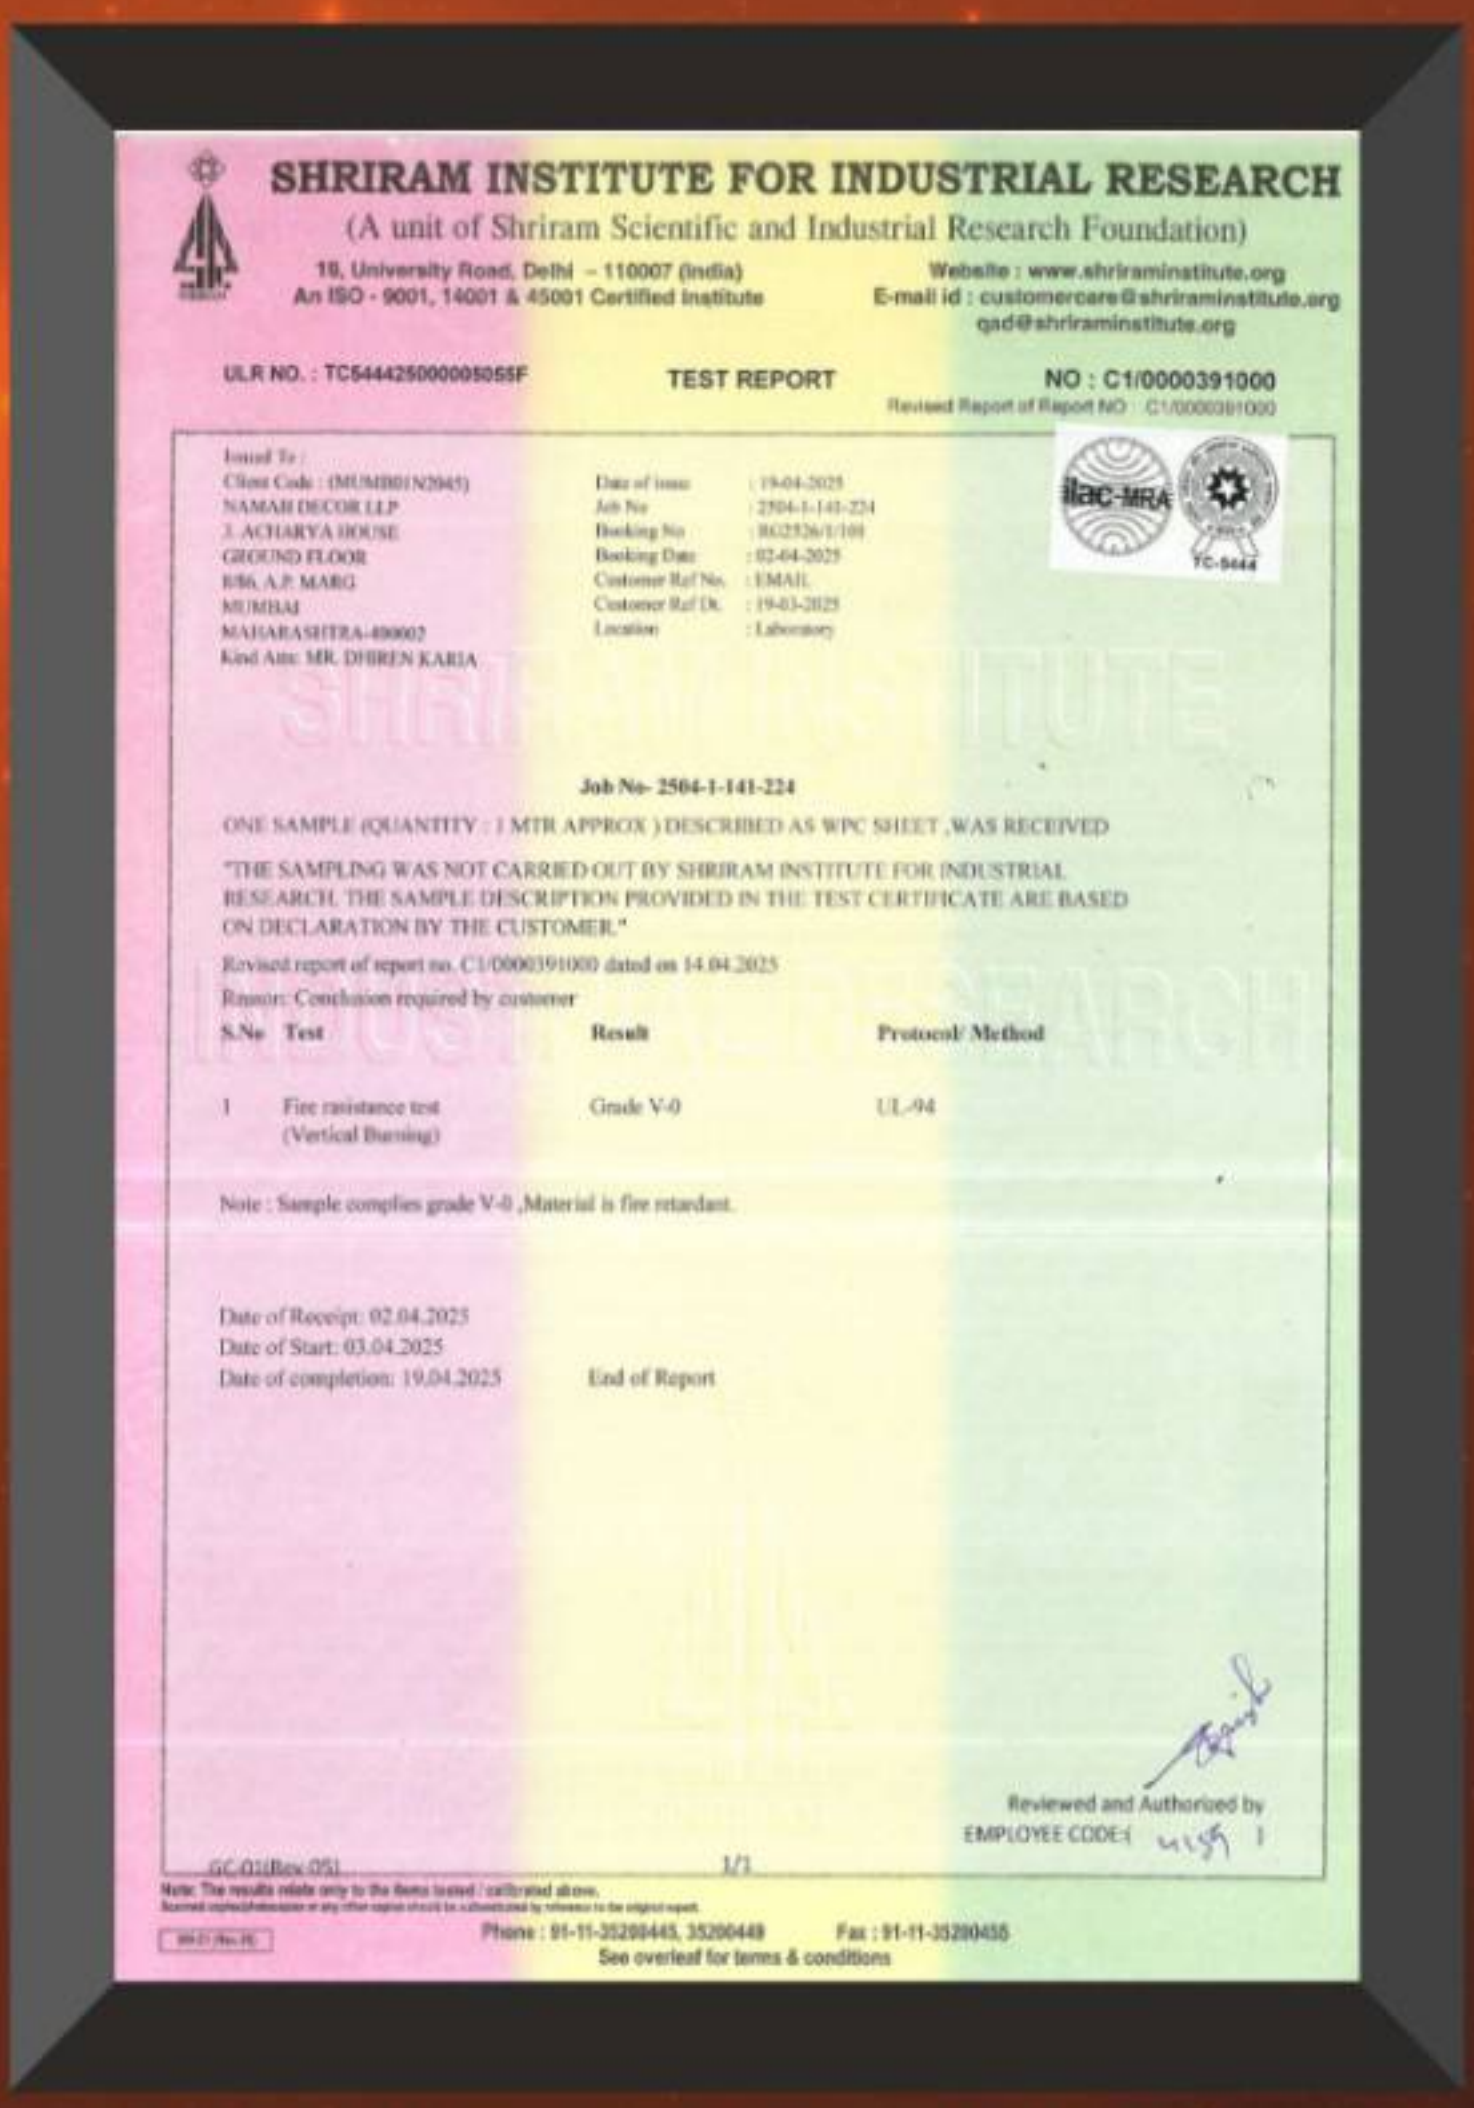

SHRIRAM INSTITUTE FOR INDUSTRIAL RESEARCH

(A unit of Shriram Scientific and Industrial Research Foundation)

19, University Road, Delhi – 110007 (India)
An ISO - 9001, 14001 & 45001 Certified Institute

Website : www.shriraminstitute.org
E-mail id : customercare@shriraminstitute.org
qad@shriraminstitute.org

ULR NO. : TC544425000005055F

TEST REPORT

NO : C1/0000391000
Revised Report of Report NO : C1/0000391000

Issued To :
Client Code : (MUMB01N2945)
NAMAH DECOR LLP
3, ACHARYA HOUSE
GROUND FLOOR
R86, A.P. MARG
MUMBAI
MAHARASHTRA-400002
Kind Attn: MR. DHIREN KARIA

Date of issue : 19-04-2025
Job No : 2504-1-141-224
Booking No : R02526/1/101
Booking Date : 02-04-2025
Customer Ref No. : EMAIL
Customer Ref Dt. : 19-03-2025
Location : Laboratory

Job No- 2504-1-141-224

ONE SAMPLE (QUANTITY : 1 MTR APPROX) DESCRIBED AS WPC SHEET ,WAS RECEIVED

"THE SAMPLING WAS NOT CARRIED OUT BY SHRIRAM INSTITUTE FOR INDUSTRIAL RESEARCH. THE SAMPLE DESCRIPTION PROVIDED IN THE TEST CERTIFICATE ARE BASED ON DECLARATION BY THE CUSTOMER."

Revised report of report no. C1/0000391000 dated on 14.04.2025

Reason: Conclusion required by customer

S.No	Test	Result	Protocol/ Method
1	Fire resistance test (Vertical Burning)	Grade V-0	UL-94

Note : Sample complies grade V-0 ,Material is fire retardant.

Date of Receipt: 02.04.2025
Date of Start: 03.04.2025
Date of completion: 19.04.2025

End of Report

Reviewed and Authorized by
EMPLOYEE CODE:

GC-01(Rev 05) 1/1

Note: The results relate only to the items tested / calibrated above.

Phone : 91-11-35200445, 35200449 Fax : 91-11-35200455
See overleaf for terms & conditions

FIRE RETARDANT CERTIFICATE FOR LAMINATE SHEET

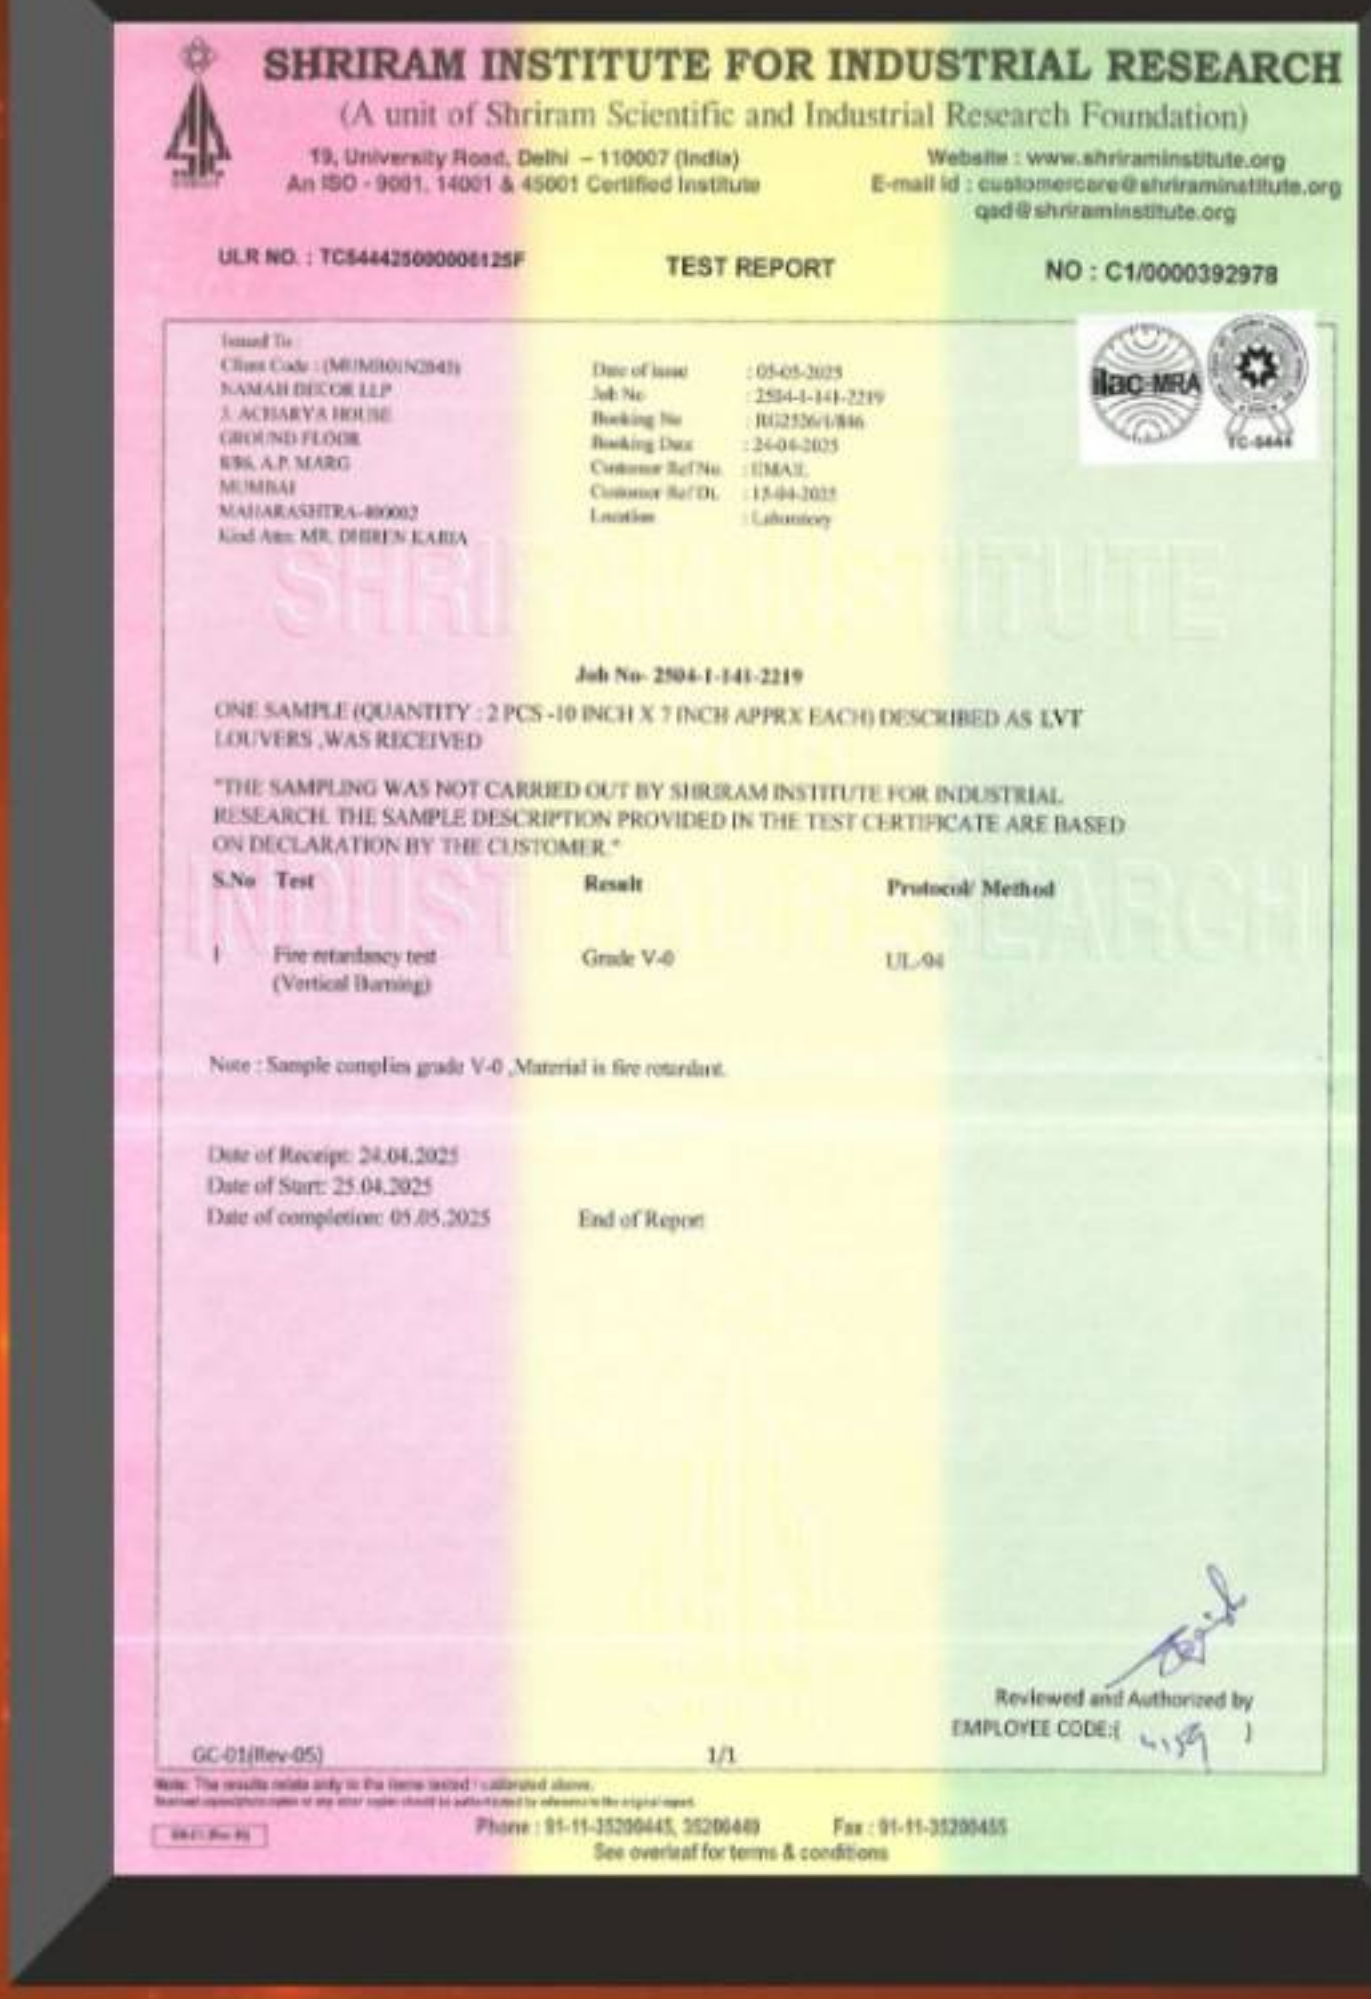

SHRIRAM INSTITUTE FOR INDUSTRIAL RESEARCH

(A unit of Shriram Scientific and Industrial Research Foundation)

19, University Road, Delhi – 110007 (India)
An ISO - 9001, 14001 & 45001 Certified Institute

Website : www.shriraminstitute.org
E-mail id : customercare@shriraminstitute.org
qad@shriraminstitute.org

ULR NO. : TC544425000006125F

TEST REPORT

NO : C1/0000392978

Issued To
Client Code : (MUMI01N2843)
NAMAH DECOR LLP
J. ACHARYA HOUSE
GROUND FLOOR
83/86, A.P. MARG
MUMBAI
MAHARASHTRA-400002
Kind Attn: MR. DHIREN KARIA

Date of issue : 05-05-2025
Job No : 2504-1-141-2219
Booking No : BG2526/1/846
Booking Date : 24-04-2025
Customer Ref No. : EMAIL
Customer Ref Dt. : 15-04-2025
Location : Laboratory

Job No- 2504-1-141-2219

ONE SAMPLE (QUANTITY : 2 PCS -10 INCH X 7 INCH APPRX EACH) DESCRIBED AS LVT LOUVERS ,WAS RECEIVED

"THE SAMPLING WAS NOT CARRIED OUT BY SHRIRAM INSTITUTE FOR INDUSTRIAL RESEARCH. THE SAMPLE DESCRIPTION PROVIDED IN THE TEST CERTIFICATE ARE BASED ON DECLARATION BY THE CUSTOMER."

S.No	Test	Result	Protocol/ Method
1	Fire retardancy test (Vertical Burning)	Grade V-0	UL-94

Note : Sample complies grade V-0 ,Material is fire retardant.

Date of Receipt: 24.04.2025
Date of Start: 25.04.2025
Date of completion: 05.05.2025

End of Report

Reviewed and Authorized by
EMPLOYEE CODE:(4159)

GC-01(Rev-05)

1/1

Phone : 91-11-35200445, 35200449 Fax : 91-11-35200455
See overleaf for terms & conditions

FIRE RETARDANT CERTIFICATE FOR LOUVERS

LAMINEX®

OUR RANGE OF PRODUCT

Graffico Metallic Surfaces
OUT OF THE BOX
BENDER MATTE
LAMI-CORE
BENDER
Abbrico
TOUGH GLOSS Anti Scratch Acrylic
GLOSSIA
Satino Anti-scratch Matt
POLARIS
Acrio
Foilo
UNIX
MOTO ACRYLIC GLASS
MAATE ACRYLIC GLASS
EXTREMO Charcoal Panel
Corio
MIRO
METAL CRUST
FLUTTERS SEAMLESS
WOOD CRUST SEAMLESS
LIQUID METAL DESIGNER WALL PANEL
30 centimetre
SOLID Crust
LEMDO T PROFILE
Organic
ETO
MIRO
URBANCASA
CARNIVAL
FLEXIPULP PAINTABLE FLEXI PANEL
Bubblewave
Titanium SEAMLESS LOUVERS
VOLUME 10

ETO

WITH LVT TECHNOLOGY FIRE RETARDANT LOUVERS & LAMINATES

The UL 94 V-0 flammability test is a vertical burning test used to assess the flame retardancy of LVT materials. It evaluates how quickly a vertically oriented polymer specimen extinguishes itself after a flame source is removed and if it drips flaming particles that could ignite cotton. A material achieves a V-0 rating if it self-extinguishes within 10 seconds and does not drip flaming particles.

Here's a more detailed breakdown:

- Vertical Burning Test:The test involves clamping a plastic specimen vertically and exposing it to a flame for a specific duration.
- Self-Extinguishing Time:The time it takes for the specimen to stop burning after the flame is removed is a key factor in determining the flammability rating.
- V-0 Rating:A material is rated V-0 if it extinguishes itself within 10 seconds after the flame is removed and no flaming particles drip from it.

MARKETED BY :