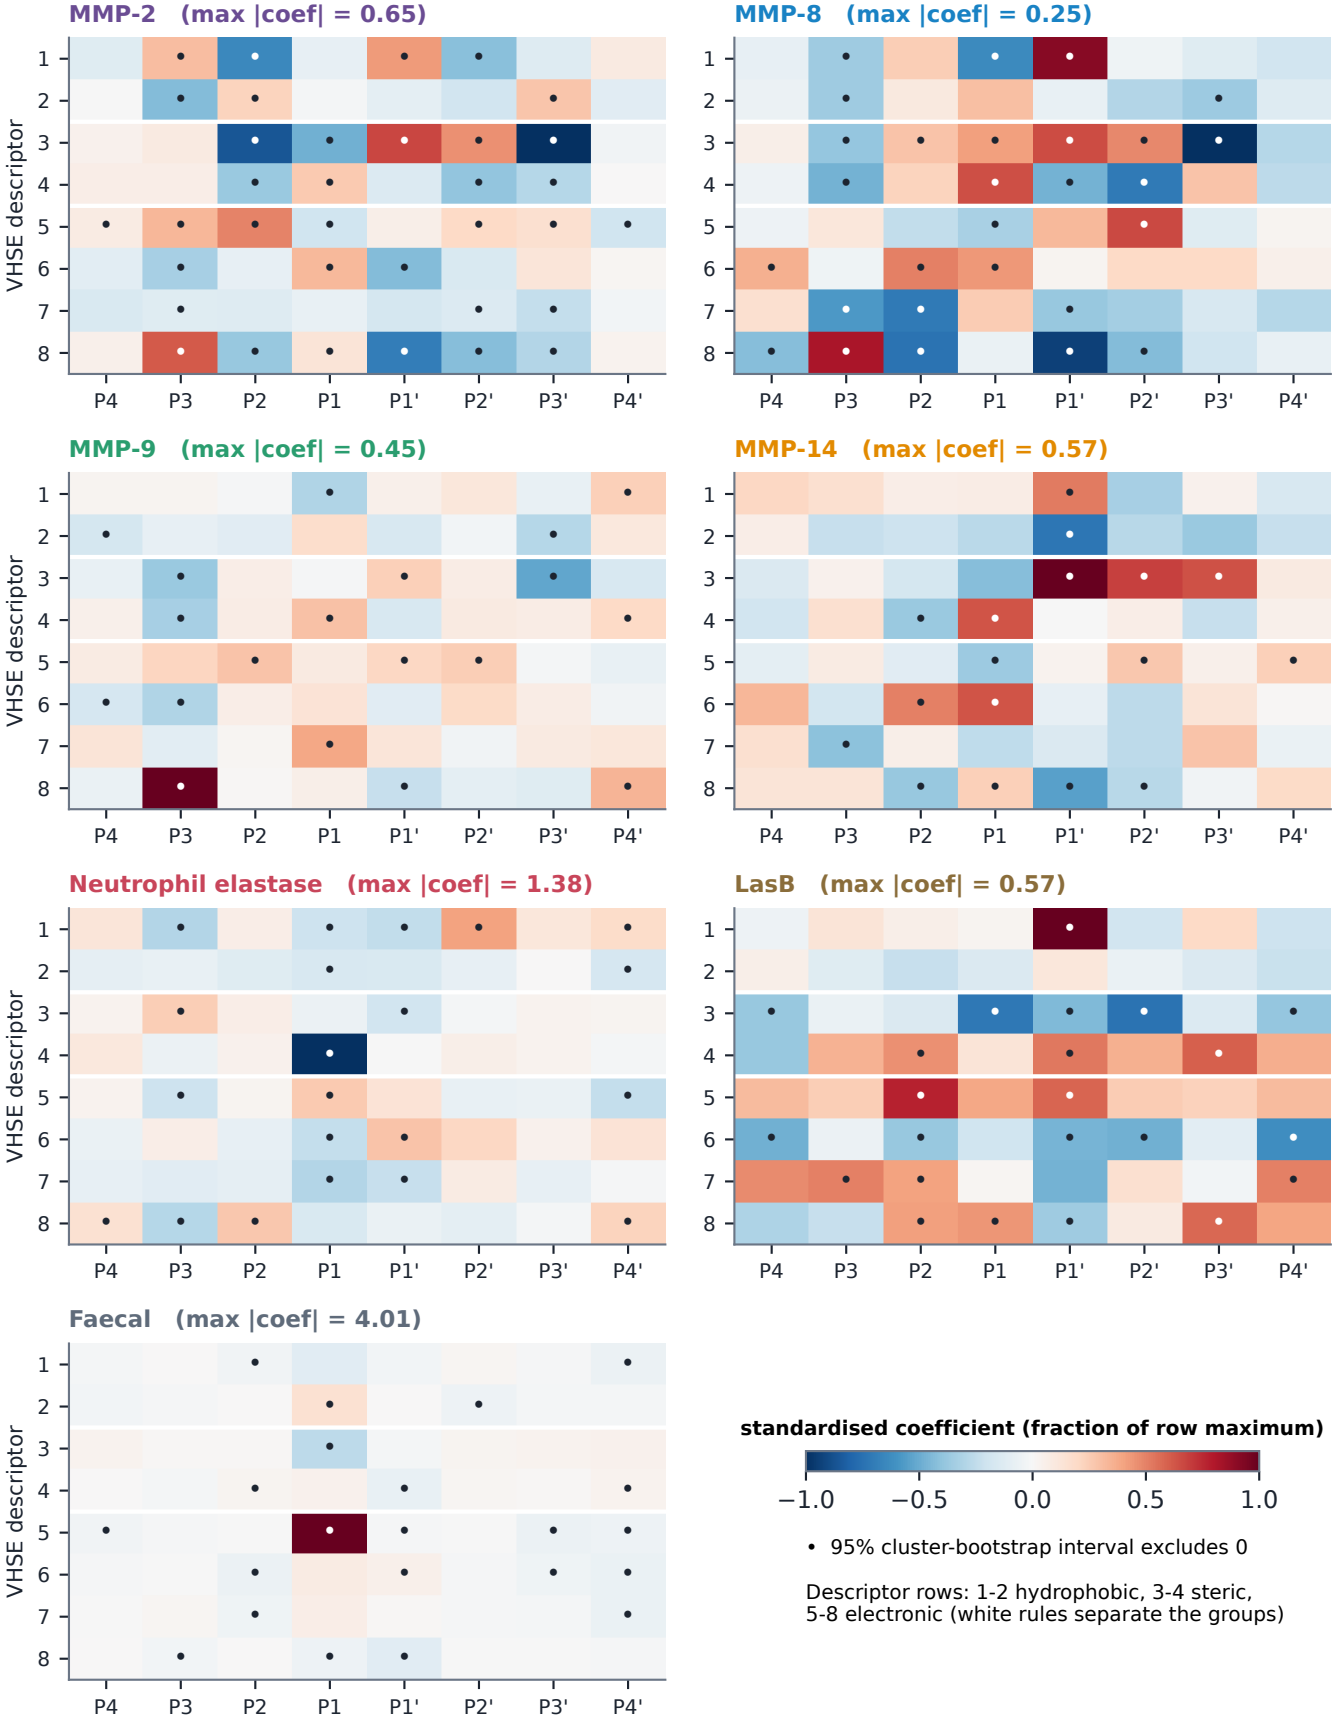
MMP-2 (max |coef| = 0.65)
MMP-8 (max |coef| = 0.25)
MMP-9 (max |coef| = 0.45)
MMP-14 (max |coef| = 0.57)
Neutrophil elastase (max |coef| = 1.38)
LasB (max |coef| = 0.57)
Faecal (max |coef| = 4.01)
VHSE descriptor
1
2
3
4
5
6
7
8
P4
P3
P2
P1
P1'
P2'
P3'
P4'
standardised coefficient (fraction of row maximum)
−1.0
−0.5
0.0
0.5
1.0
• 95% cluster-bootstrap interval excludes 0
Descriptor rows: 1-2 hydrophobic, 3-4 steric,
5-8 electronic (white rules separate the groups)