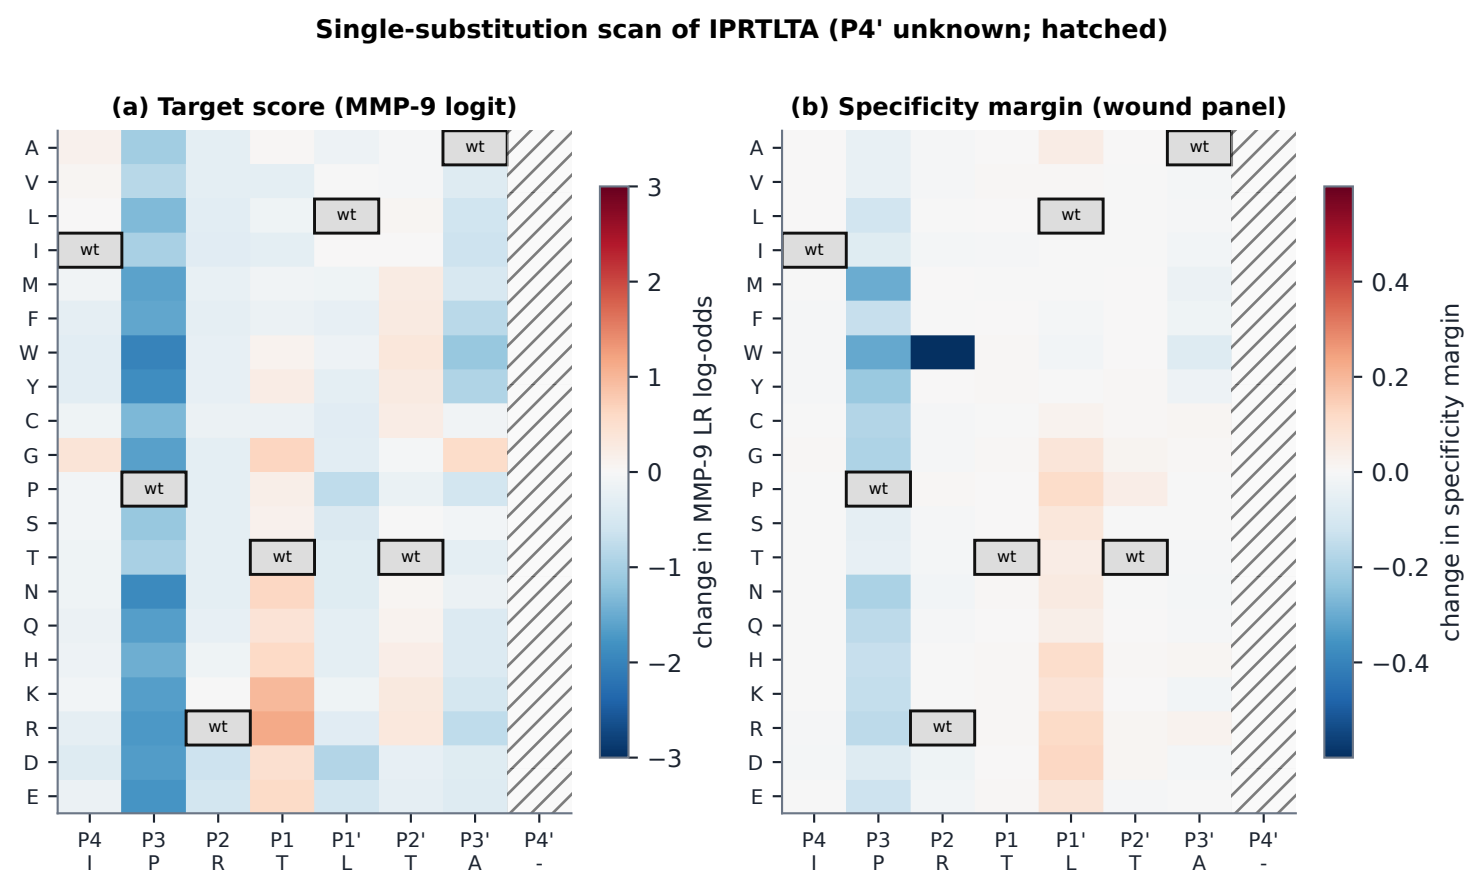
Single-substitution scan of IPRTLTA (P4' unknown; hatched)
(a) Target score (MMP-9 logit)
(b) Specificity margin (wound panel)
A
V
L
I
M
F
W
Y
C
G
P
S
T
N
Q
H
K
R
D
E
wt
P4 I
P3 P
P2 R
P1 T
P1' L
P2' T
P3' A
P4' -
3
2
1
0
−1
−2
−3
change in MMP-9 LR log-odds
0.4
0.2
0.0
−0.2
−0.4
change in specificity margin