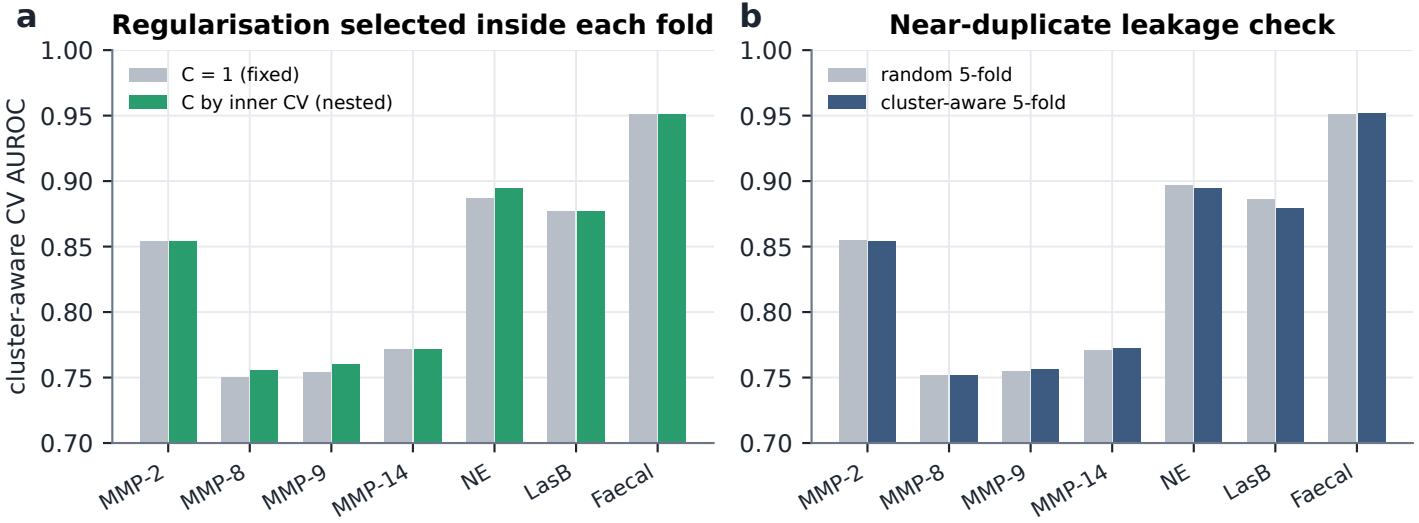
a
Regularisation selected inside each fold
cluster-aware CV AUROC
1.00
0.95
0.90
0.85
0.80
0.75
0.70
C = 1 (fixed)
C by inner CV (nested)
MMP-2
MMP-8
MMP-9
MMP-14
NE
LasB
Faecal
b
Near-duplicate leakage check
random 5-fold
cluster-aware 5-fold
MMP-2
MMP-8
MMP-9
MMP-14
NE
LasB
Faecal