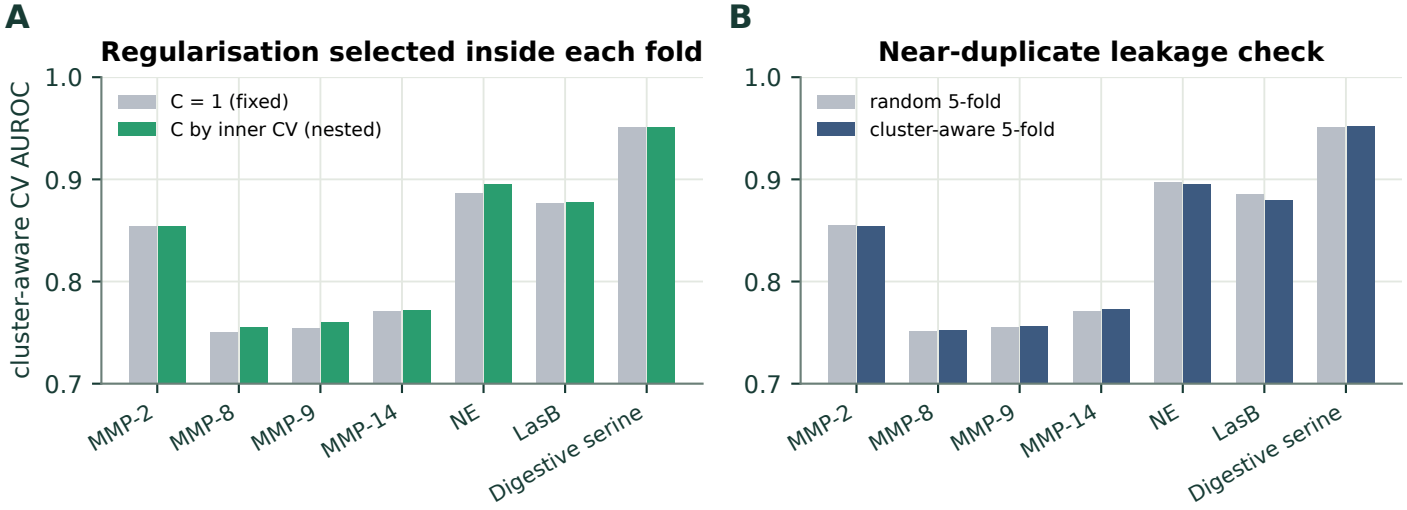
A
Regularisation selected inside each fold
cluster-aware CV AUROC
1.0
0.9
0.8
0.7
C = 1 (fixed)
C by inner CV (nested)
MMP-2
MMP-8
MMP-9
MMP-14
NE
LasB
Digestive serine
B
Near-duplicate leakage check
1.0
0.9
0.8
0.7
random 5-fold
cluster-aware 5-fold
MMP-2
MMP-8
MMP-9
MMP-14
NE
LasB
Digestive serine