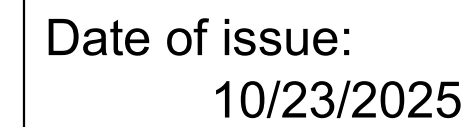


# GENERAL PLAN NOTES

1. ALL NEW WALLS ARE TYPE A3-DA UNLESS NOTED OTHERWISE.
2. ALL EXTERIOR FLOOR LEVELS ARE AT EL. 100'-0" UNLESS NOTED OTHERWISE.
3. PROVIDE CONTROL JOINTS IN GYPSUM BOARD ABOVE THE FINISH FLOOR LINE OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 3'-0" IN LENGTH OR GREATER OR AS INDICATED ON INTERIOR ELEVATIONS.
4. PROVIDE HORIZONTAL CONTROL JOINTS AT 4'-0" A.F.F. THROUGHOUT BUILDING.
5. REFER TO SHEET A0-01 FOR STANDARD PLUMBING FIXTURE LAYOUT.
6. "S1", "S4", "U2", "L1", "EW-C1", ETC.).
7. ALL NEW WALL MOUNTED FIRE EXTINGUISHERS SHALL BE MOUNTED AT 45° MAX. TO EXTINGUISHER HANDLE U.O.A.
8. PROVIDE ACCESSORIES TYPE "H" & "J" ABOVE MOUNTS. REFR. RESTROOM ACCESSORY LEGEND & SPEC.
9. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GY. BOARD CORNERS MOUNTED AT 4'-0" TO BOTTOM.
10. EACH SINK (NOT LIMITED TO RESTROOMS) SHALL RECEIVE AN OCFI PAPER TOWEL & SOAP DISPENSER.
11. ALL EXISTING TO REMAIN HM DOOR FRAMES (INTERIOR & EXTERIOR) TO BE PAINTED, REFINISH SCHEDULE FOR FINISH.
12. PROVIDE NEW MINI-BLINDS ON ALL EXISTING EXTERIOR WINDOWS AND ON INTERIOR WINDOWS AS INDICATED ON PLANS.
13. PROVIDE NEW TILES & GROUT AT ALL WALLS WHERE TILE IS BEING REMOVED AND REPLACED AND WHERE NEW TILE IS BEING INSTALLED.
14. PROVIDE (1) EVAC SIGN TYPE "G" AT DOORS AS SCHEDULED ON SHEET A0-01.
15. REFERENCE SHEET A0-01 FOR BUILDING ENVELOPE SCOPE OF WORK.
16. FIRE EXTINGUISHER CABINETS THAT ARE EXISTING TO REMAIN ARE TO BE PROTECTED BY RE-INSTALLATION IF REMOVAL IS REQUIRED.
17. PATCH AND REPAIR EXISTING WALLS TO REMAIN AS A RESULT OF ANY DAMAGE FROM DEMOLITION.
18. ALL WALL PATCHES FOR REMOVED DOORS AND

[illegible][illegible]

**JOB** 25228.0100  
**DATE** 10/23/2025  
**SHEET**

NA02-02