
DC POWER INPUT

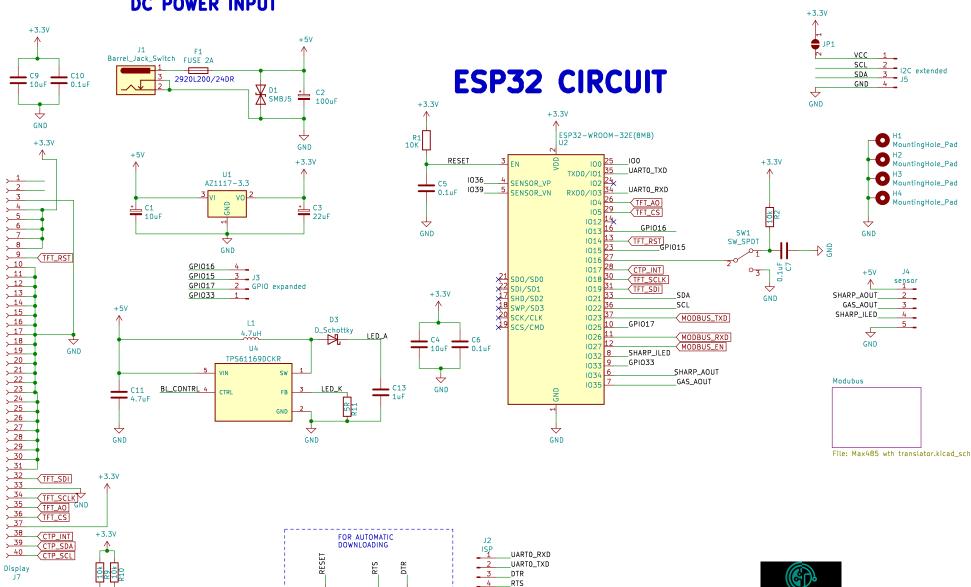

RESET

 \rightarrow GND

Q1B


UMH3N

Q1A

DTR

UMH3N



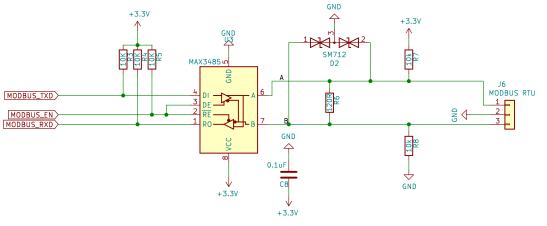

MODBUS RTU