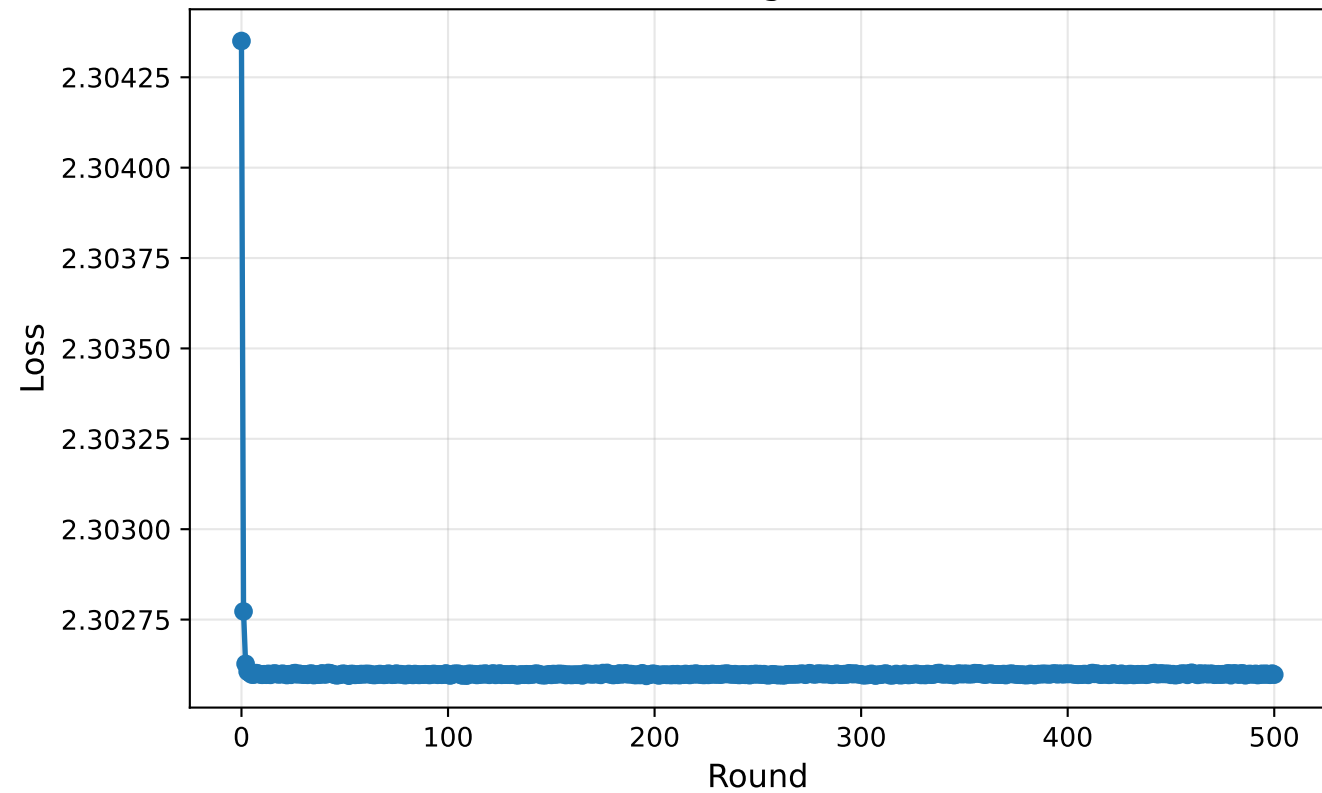# cifar10_vae_c50_m15_20251120_183902

Training Loss

Test Accuracy

Final Acc: 0.100
Best Acc: 0.100
Final Loss: 2.303