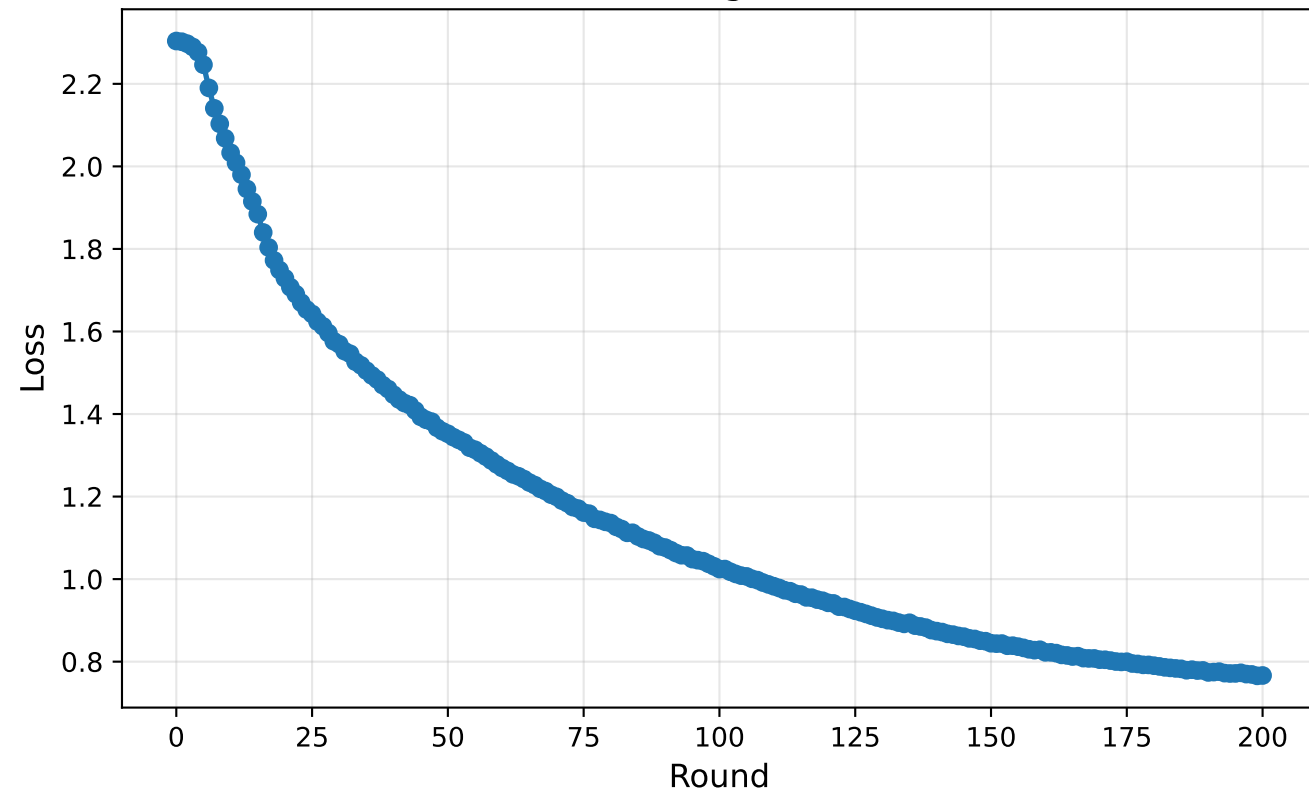# cifar10_krum_c50_m0_20251207_151312

Training Loss

Test Accuracy

Final Acc: 0.738
Best Acc: 0.738
Final Loss: 0.767