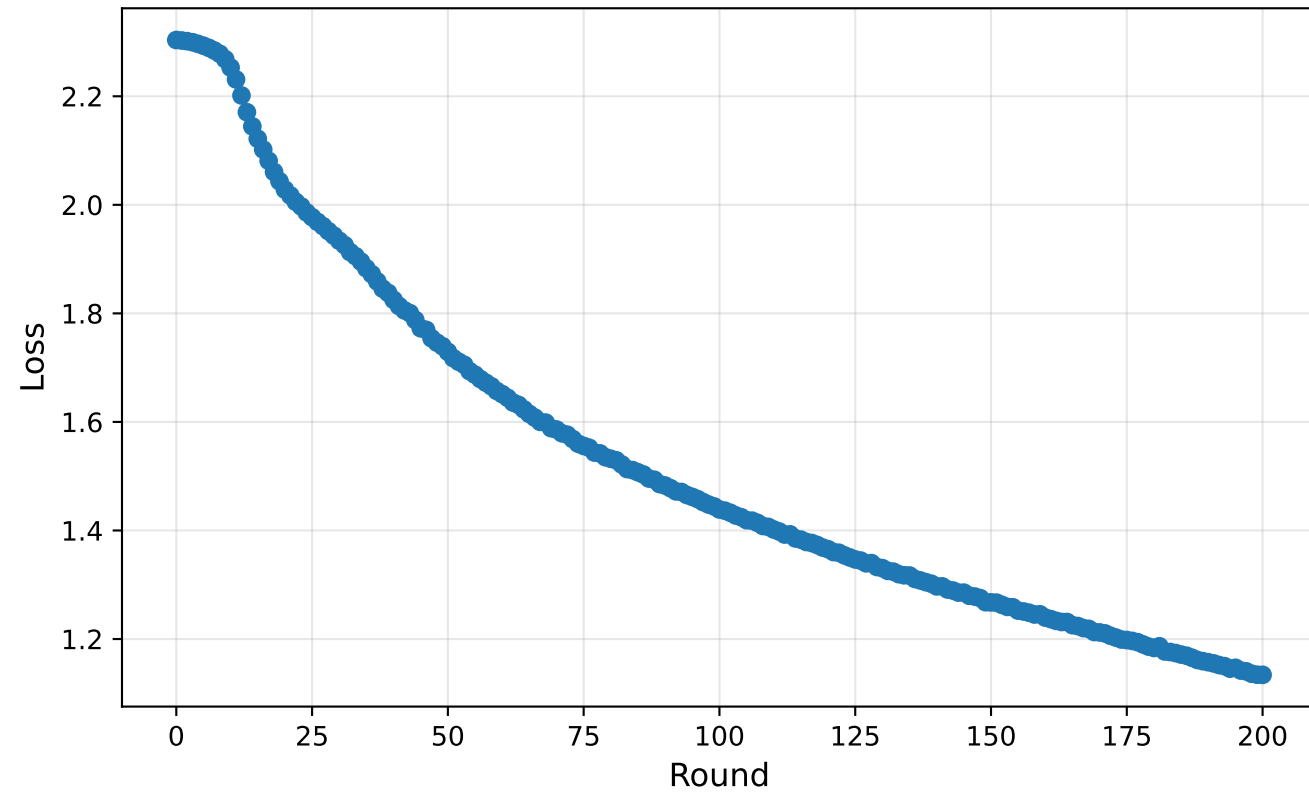# cifar10_krum_c100_m0_20251207_153745

Training Loss

Test Accuracy

Final Acc: 0.595
Best Acc: 0.595
Final Loss: 1.134