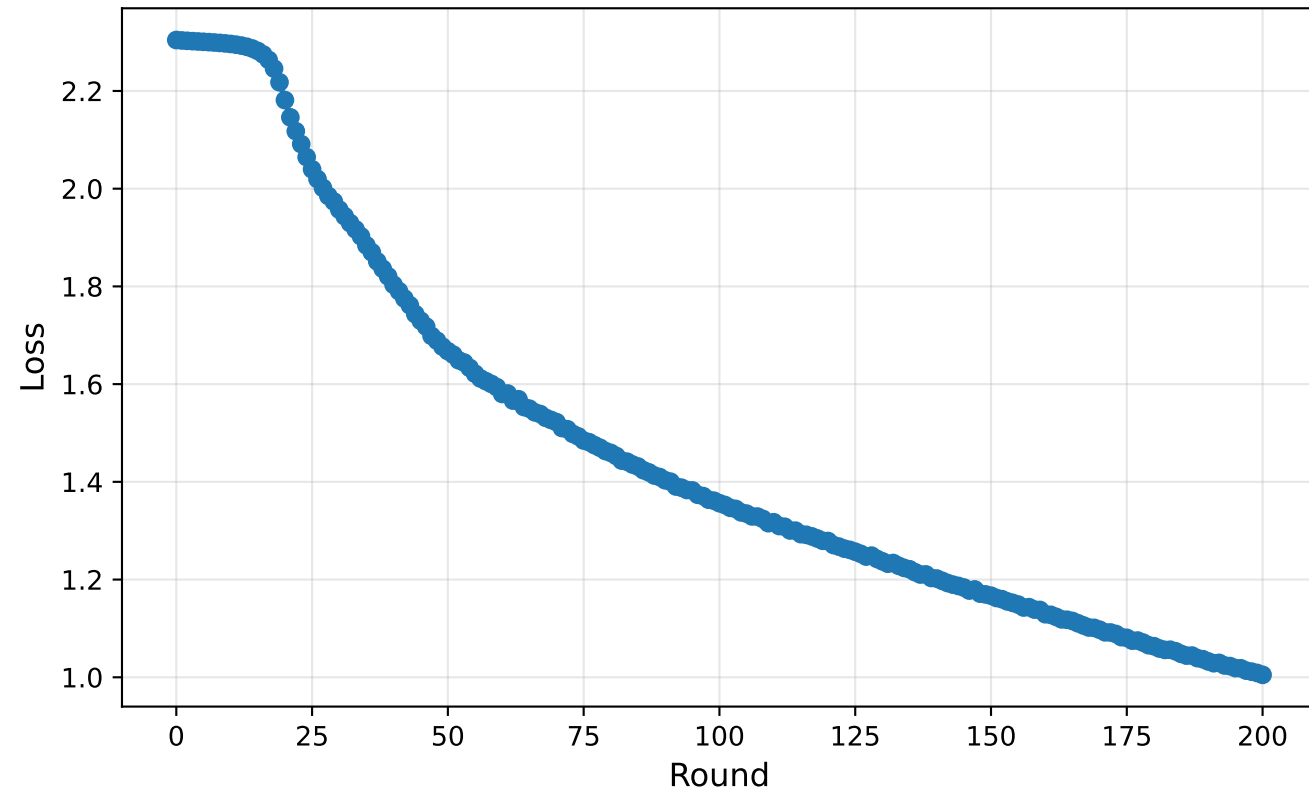# cifar10_fedavg_c100_m0_20251119_155657

Training Loss

Test Accuracy

Final Acc: 0.645
Best Acc: 0.645
Final Loss: 1.005