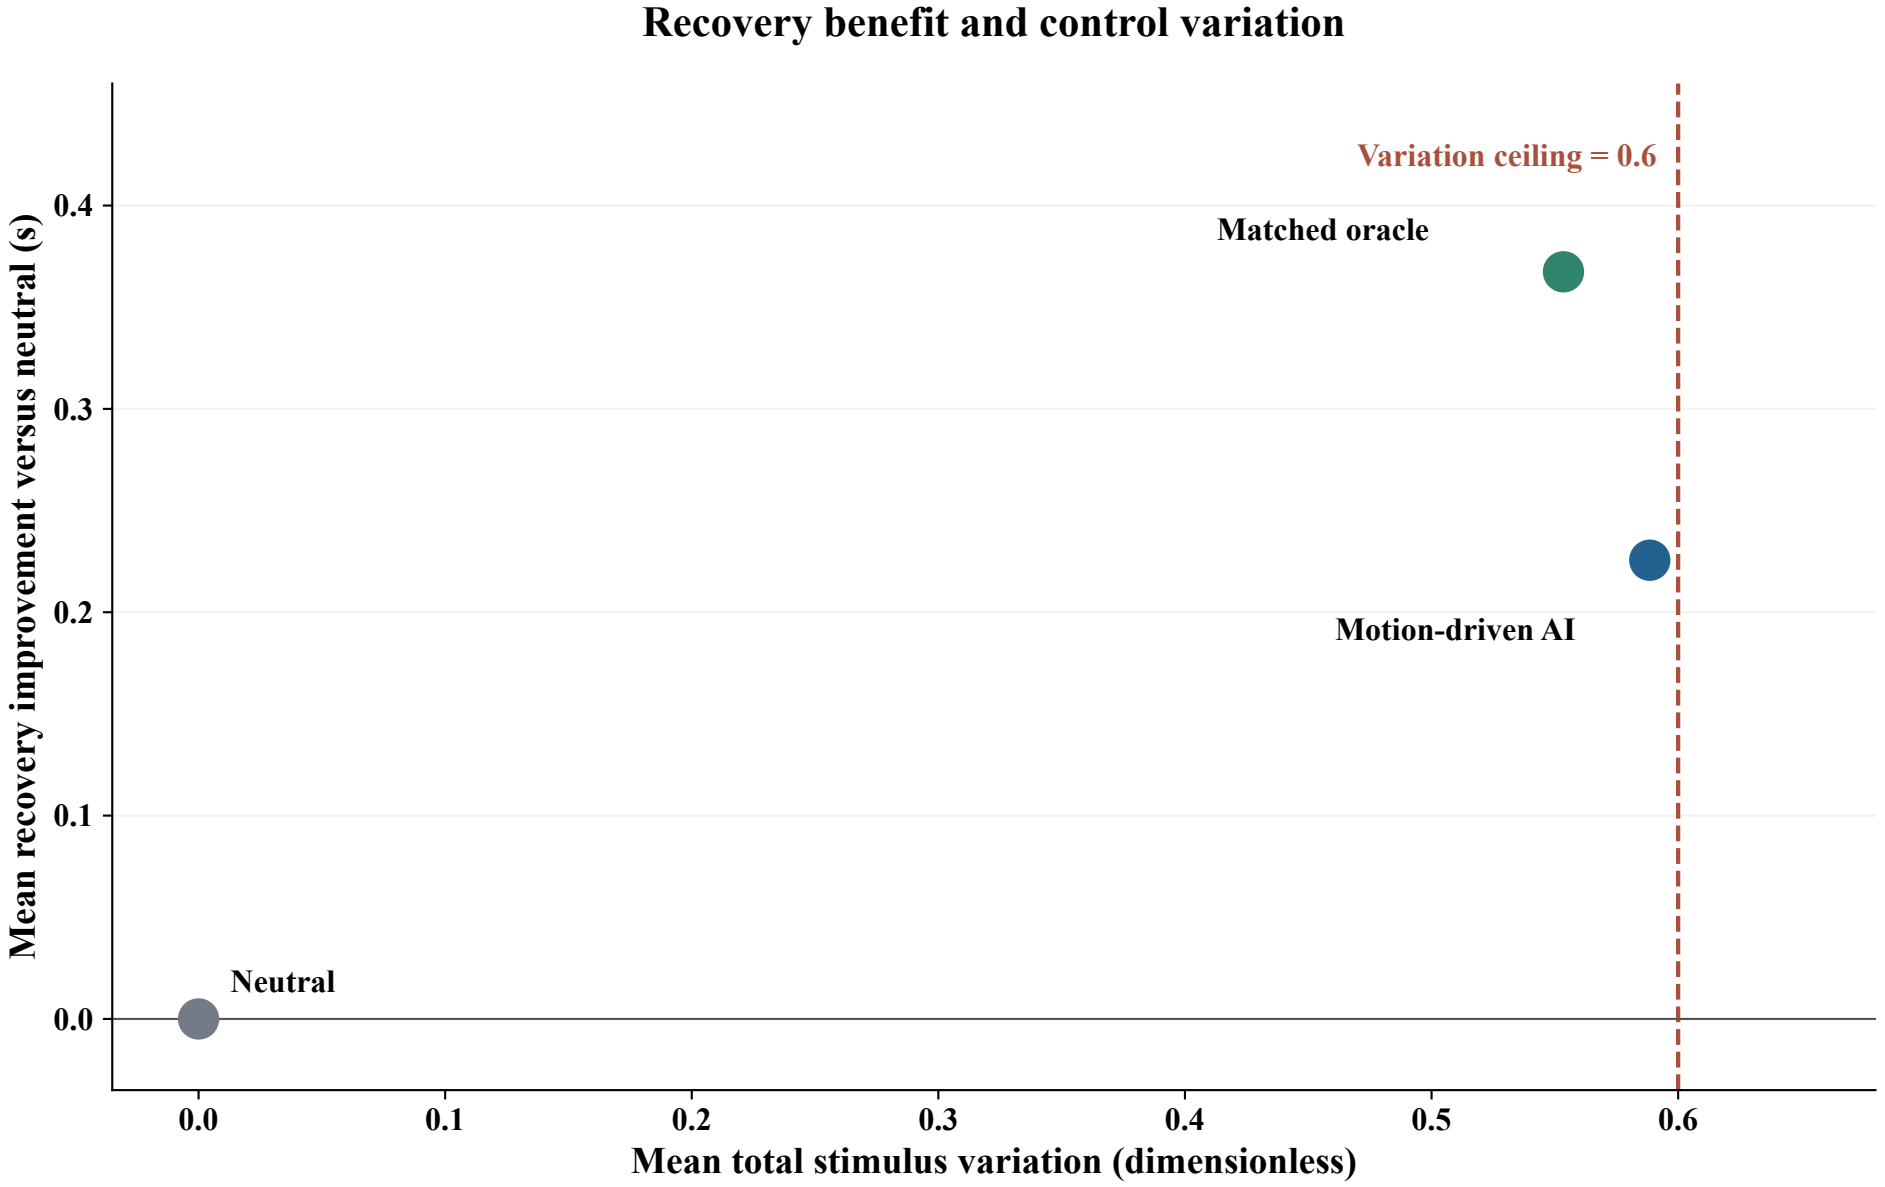
Recovery benefit and control variation
Variation ceiling = 0.6
Matched oracle
Motion-driven AI
Neutral
Mean recovery improvement versus neutral (s)
0.0
0.1
0.2
0.3
0.4
Mean total stimulus variation (dimensionless)
0.0
0.1
0.2
0.3
0.4
0.5
0.6