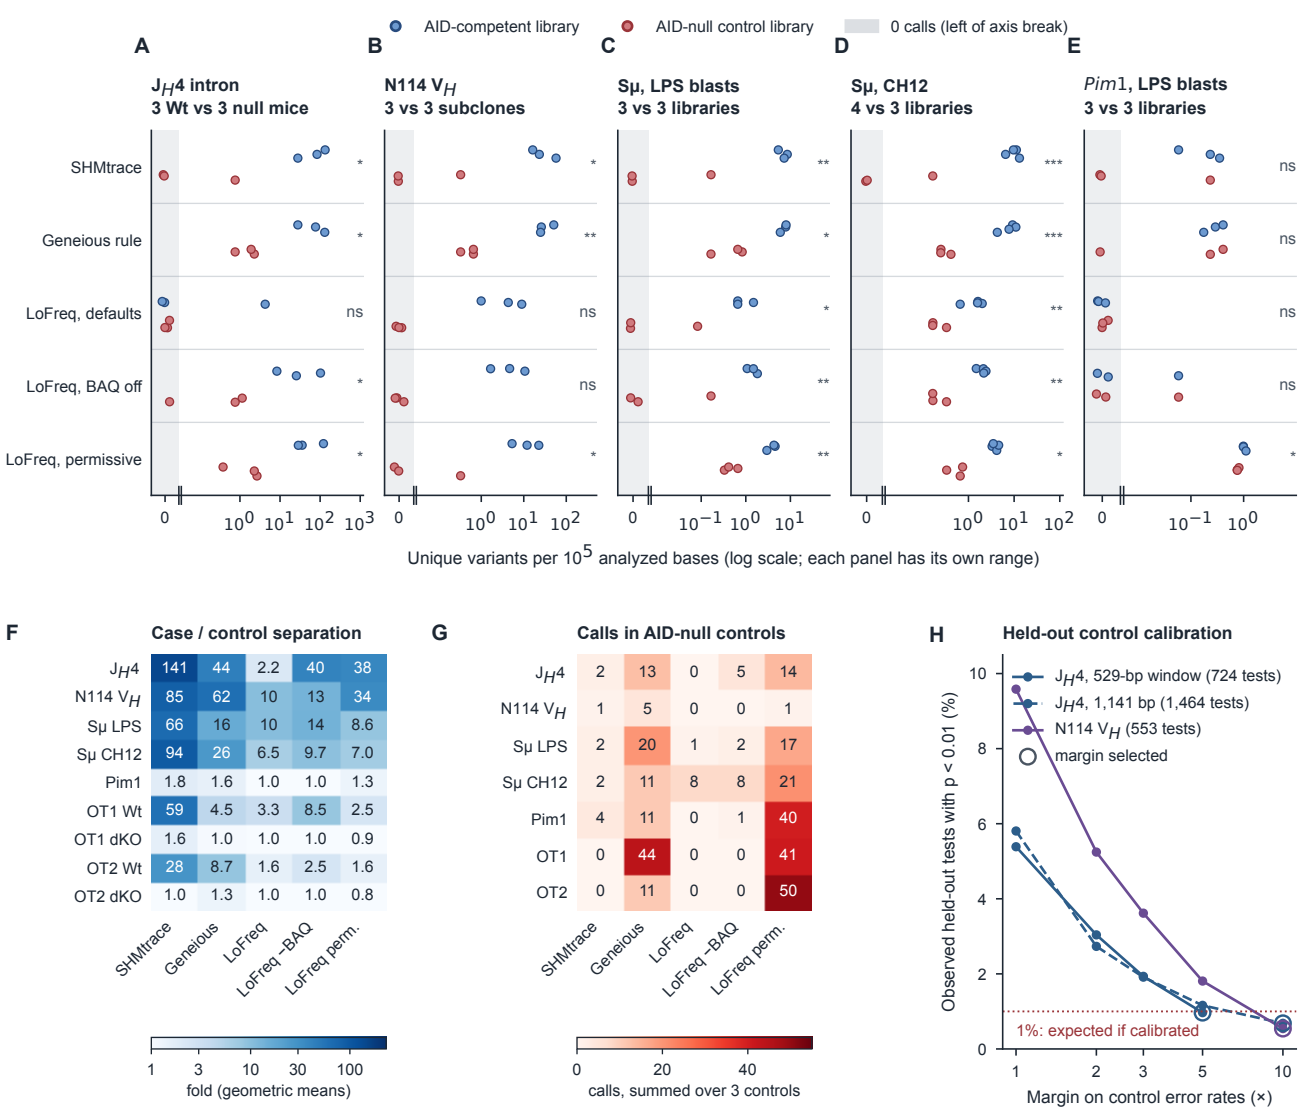

AID-competent library
AID-null control library
0 calls (left of axis break)
A
B
C
D
E
JH4 intron
3 Wt vs 3 null mice
N114 VH
3 vs 3 subclones
Sμ, LPS blasts
3 vs 3 libraries
Sμ, CH12
4 vs 3 libraries
Pim1, LPS blasts
3 vs 3 libraries
SHMtrace
Geneious rule
LoFreq, defaults
LoFreq, BAQ off
LoFreq, permissive
ns
Unique variants per 10^5 analyzed bases (log scale; each panel has its own range)
F
Case / control separation
JH4 141 44 2.2 40 38
N114 VH 85 62 10 13 34
Sμ LPS 66 16 10 14 8.6
Sμ CH12 94 26 6.5 9.7 7.0
Pim1 1.8 1.6 1.0 1.0 1.3
OT1 Wt 59 4.5 3.3 8.5 2.5
OT1 dKO 1.6 1.0 1.0 1.0 0.9
OT2 Wt 28 8.7 1.6 2.5 1.6
OT2 dKO 1.0 1.3 1.0 1.0 0.8
SHMtrace
Geneious
LoFreq
LoFreq −BAQ
LoFreq perm.
1 3 10 30 100
fold (geometric means)
G
Calls in AID-null controls
JH4 2 13 0 5 14
N114 VH 1 5 0 0 1
Sμ LPS 2 20 1 2 17
Sμ CH12 2 11 8 8 21
Pim1 4 11 0 1 40
OT1 0 44 0 0 41
OT2 0 11 0 0 50
SHMtrace
Geneious
LoFreq
LoFreq −BAQ
LoFreq perm.
0 20 40
calls, summed over 3 controls
H
Held-out control calibration
JH4, 529-bp window (724 tests)
JH4, 1,141 bp (1,464 tests)
N114 VH (553 tests)
margin selected
1%: expected if calibrated
Observed held-out tests with p < 0.01 (%)
Margin on control error rates (×)