



All Bills Paid 

You have no outstanding balance.

Ward Water Level

75%



Report Leak



Billing History



Statistics



Contact Us



Home



Billing



Complaints



Profile



Billing History

August 2024

\$132.80

DUE

July 2024

\$125.50

PAID

June 2024

\$110.75

PAID

May 2024

\$95.20

PAID

April 2024

\$130.00

PAID

March 2024

\$115.30

PAID

February 2024

\$105.40

PAID



Home



Billing



Complaints



Profile



Bill Details

Total Amount Due

\$125.50

Water Usage

1500 gallons



Fine

\$10.00



Due Date

July 15, 2024



Pay Now



Home



Billing



Complaints



Profile



Complaints

Low Water Pressure

Submitted

Submitted on 2024-07-26

Water Leak

In Progress

Submitted on 2024-07-20

Billing Issue

Resolved

Submitted on 2024-07-15

Taste & Odor

Submitted

Submitted on 2024-07-28

Service Disruption

Resolved

Submitted on 2024-07-18



Home



Billing



Complaints



Profile



New Complaint

Complaint Type

Select Complaint Type



Description

Describe your complaint in detail...



Upload Photo

Submit Complaint



Profile



Ethan Carter

Citizen

Ward ID

W12-45B

Phone

+1 555 1234

Connection Status

Active



Account



Personal Information



Payment Methods



Billing History

Settings



Notifications



App Preferences

Support



Help & FAQs



Contact Us



Logout



Home



Billing



Complaints



Profile



Welcome Back
Supervisor

AquaSense

Pending
Complaints

12

New
Requests

5

Cash in
Hand

₹2,500



**View
Complaints**



**Manage
Connections**



Generate Bill



Ward Members

TANK

Tank Levels



Settle Payments



Dashboard



Complaints



Connections



Bills



Complaints

Unresolved

Liam Carter

Leak in main water line

Urgent >

Sophia Bennett

Water contamination
reported

High Priority >

Resolved

Ethan Harper

Low water pressure



Olivia Hayes

Billing discrepancy



Dashboard



Complaints



Connections



Bills



Complaint Details



Water Leak at 123 Ocean View Drive

Submitted by Alex Rivera
Complaint ID: #12345

Details

Location 123 Ocean View Drive

Date July 26, 2024

Status **Pending**

Description

A significant water leak is observed near the main valve. Water is pooling, causing potential damage to the property.

Mark as In Progress

Mark as Resolved



New Connections



Ethan Carter

Application Date: 2024-07-26



Olivia Bennett

Application Date: 2024-07-25



Noah Thompson

Application Date: 2024-07-24



Ava Harper

Application Date: 2024-07-23



Liam Foster

Application Date: 2024-07-22



Sophia Hayes

Application Date: 2024-07-21



Dashboard



Complaints



Connections



Bills



Sophia Bennett

Application ID: 789012
Submitted: 2024-07-26

Personal Information

Full Name	Date of Birth
Sophia Bennett	1988-05-12
Address	
123 Ocean View Dr, Apt 4B	
Contact Number	
+1 (555) 123-4567	
Email	
sophia.bennett@email.com	
Occupation	
Architect	

Application Details

Property Type	Connection Type
Residential	New Connection
Estimated Usage	Application Status
2000 gal/month	Pending Review



View Proof of Residence





Meter Reading

Enter Current Reading

000000

Last Reading
123456

Avg. Consumption
1500

Generate Bill

Accept Cash Payment



Dashboard



Complaints



Connections



Bills



100ml



250ml



500ml

Today's Summary

Total Intake
1250ml

Logs
5

Avg. Intake
250ml

Last 7 Days



IoT Sensor Monitor



System Status: Normal



85 L/min

Flow Rate



2.4 Bar

Pressure



78%

Tank Level




92%

Battery

Last synced: 10s ago via ESP32

AI ANALYSIS

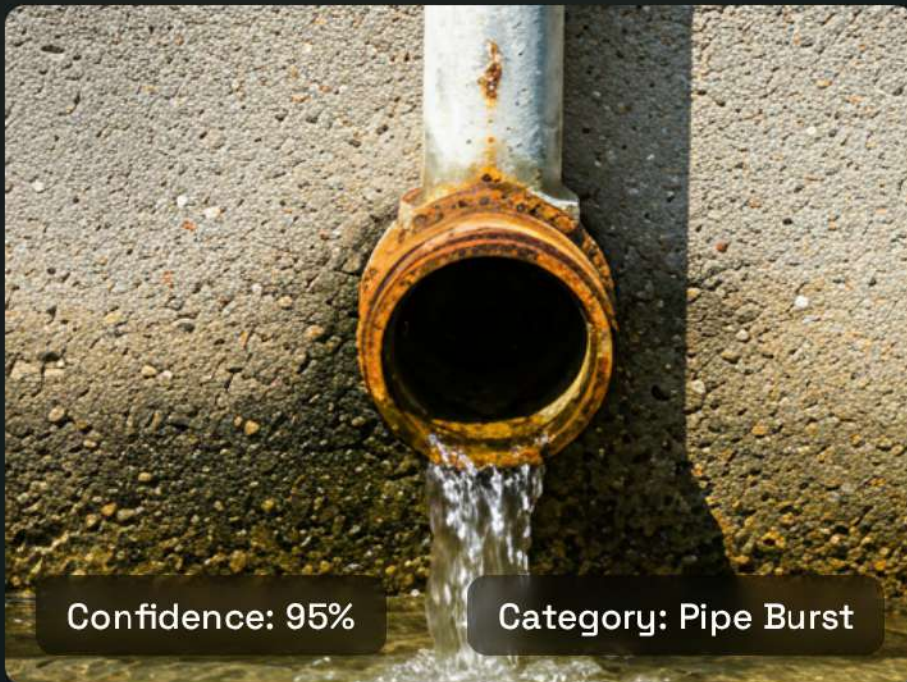

Confidence: 95%

Category: Pipe Burst

Confirm & Report

Retake



SETUP

Personalize Your Goal

GENDER



Male



Female

WEIGHT

75 kg



ACTIVE HOURS



WAKE UP



BEDTIME

07:00

AM

11:00

PM

Daily Target


2450 ml

START TRACKING





CRITICAL LEAK DETECTED

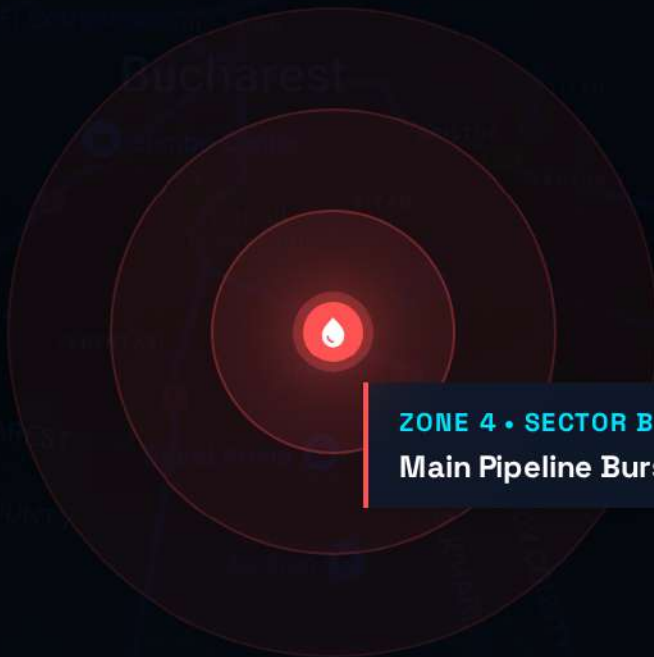

ZONE 4 • SECTOR B
Main Pipeline Burst

Sensor Diagnostic

URGENCY
EXTREME

● Live Feed • ID #H20-X9

PRESSURE DROP

-1.5 Bar

in 5 mins

Rapid Depressurization

EVENT DETECTED



SLIDE TO DISPATCH

Predictive Maintenance



Upcoming schedule & AI Risk Assessment

- All Wards
- Critical Risk
- High Priority

TODAY, OCT 24



09:00 AM

AI PREDICTED FAILURE



Main Valve Inspection

Ward A • Pressure variance detected

Pipe Health 40% (Critical)




11:30 AM

SCHEDULED

Filter Replacement

Ward B • Zone 2 Intake

Filter Efficiency 80% (Stable)



02:00 PM

Sensor Calibration

Zone 4 • Routine Check



SYSTEM INTELLIGENCE



Day

Week


Month

PROJECTED CONSUMPTION

2,450 L

+8.4%

vs last week

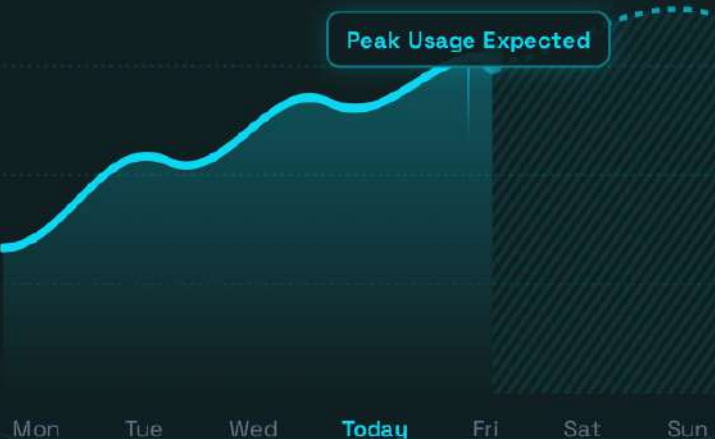

Ward Intensity



Ward A
High Usage

92%



Ward B
Moderate

64%



Ward C
Stable

28%



Ward D
Elevated

76%

Live Insights



SYSTEM HEALTH
Leak Efficiency

+12%



COMMUNITY
1,240 Ac