




CH: paired supplier offers and price composition per 1 GW — C20

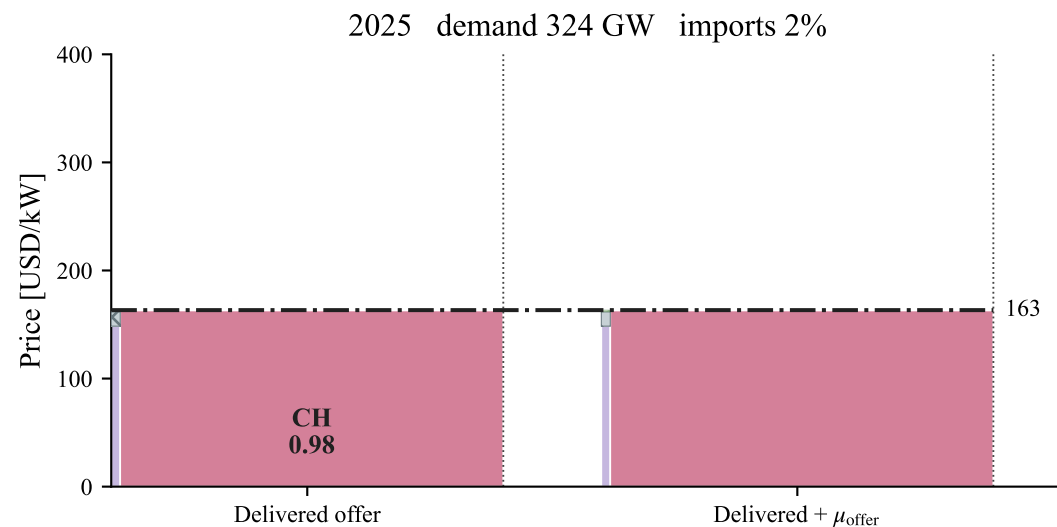


Supplier flow [GW]: APAC 7.4 · CH 316.6

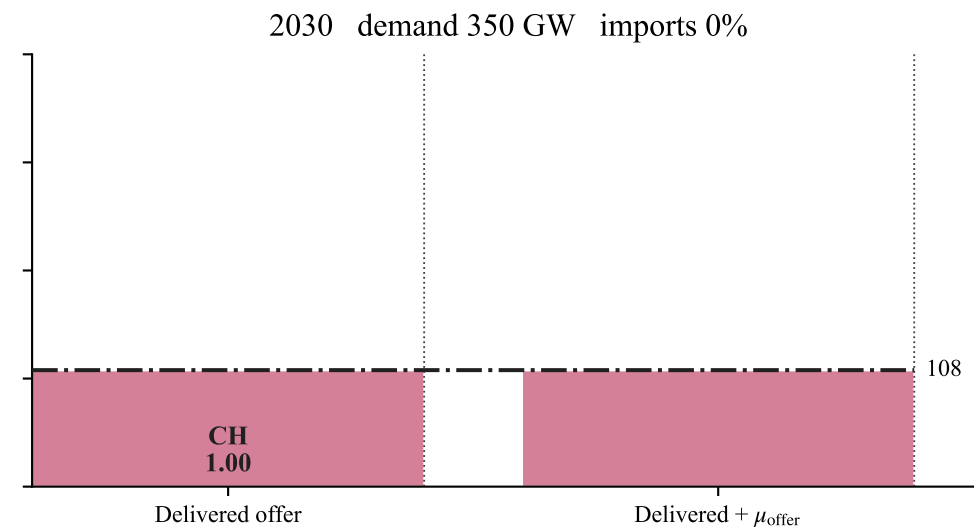

Supplier flow [GW]: CH 350.0

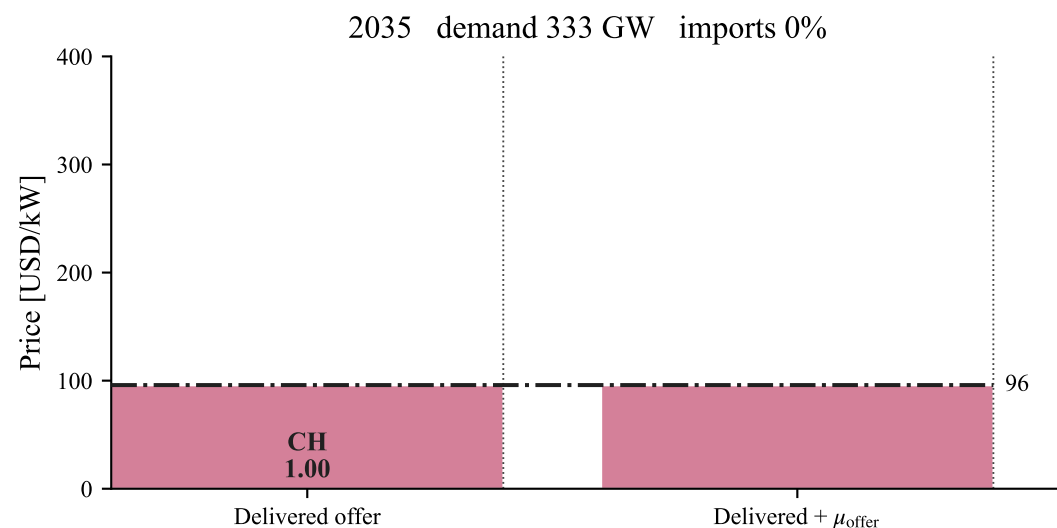

Supplier flow [GW]: CH 333.0

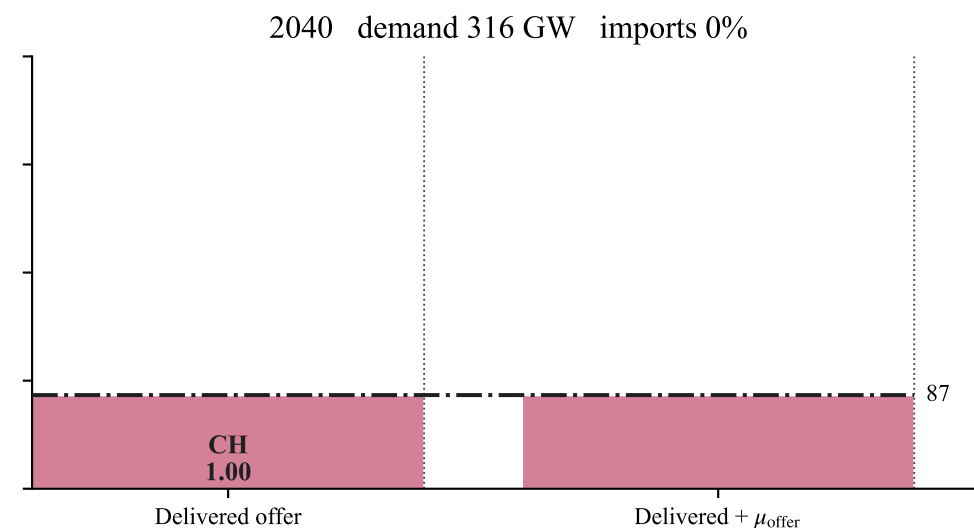


Supplier flow [GW]: CH 316.0


Each bar spans 1 GW of demand; supplier widths are identical in the two bars.




EU: paired supplier offers and price composition per 1 GW — C20

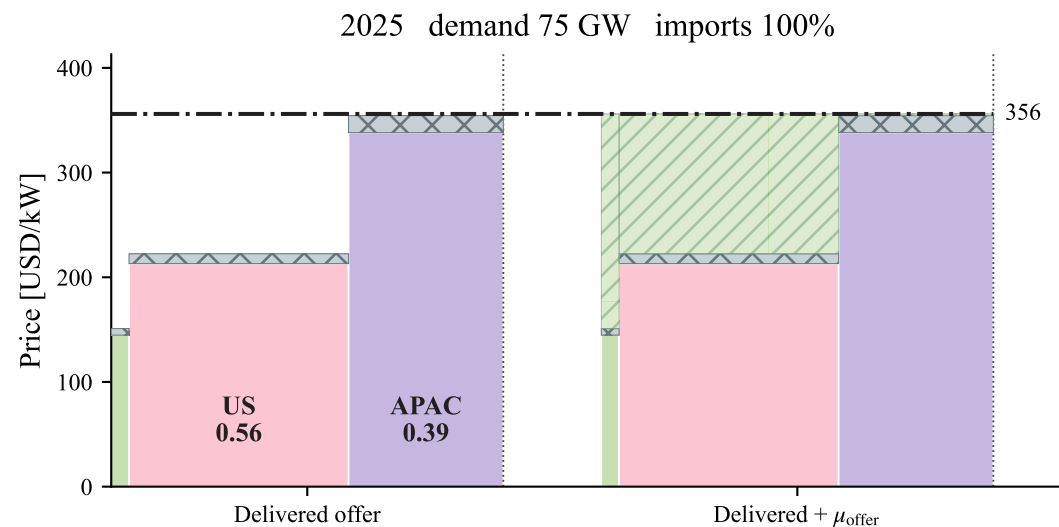


Supplier flow [GW]: AF 3.4 · US 42.0 · APAC 29.6

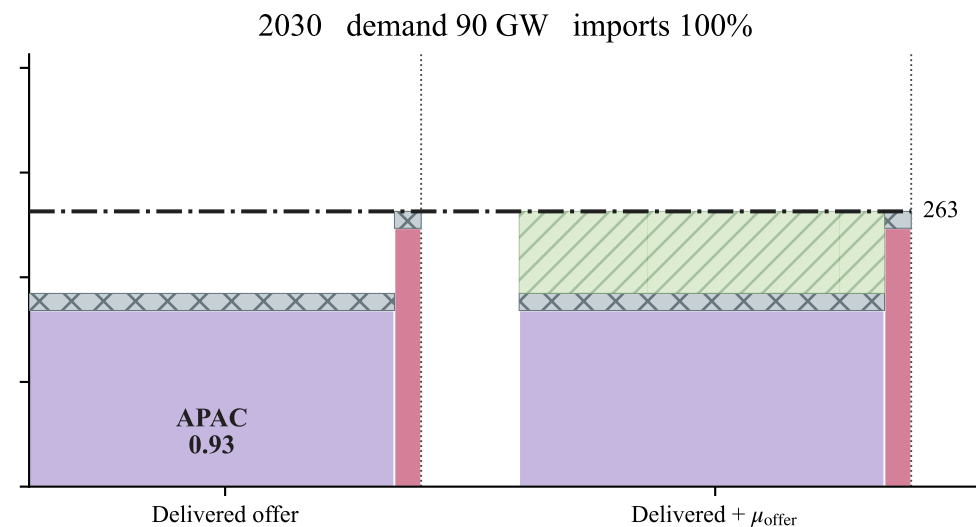

Supplier flow [GW]: APAC 83.9 · CH 6.1

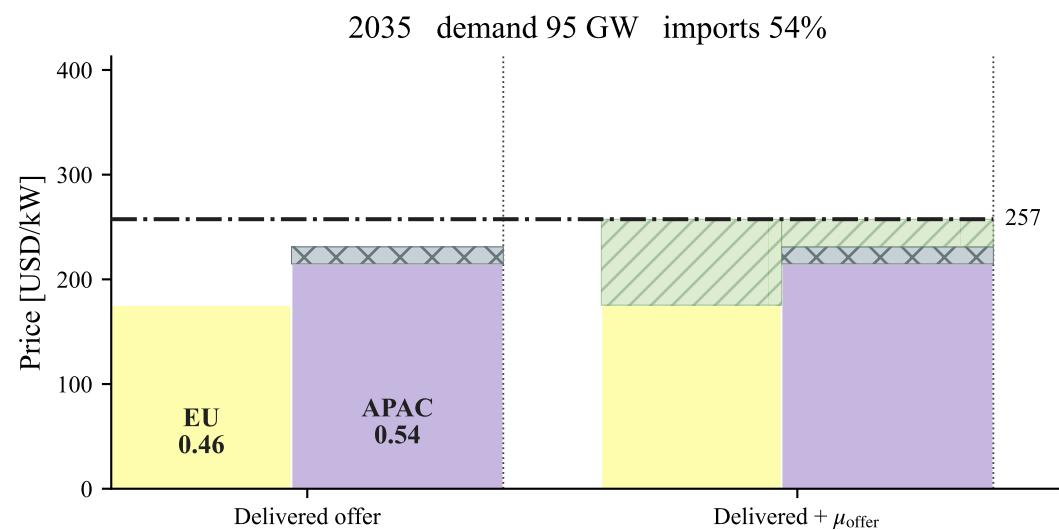


Supplier flow [GW]: EU 43.7 · APAC 51.3

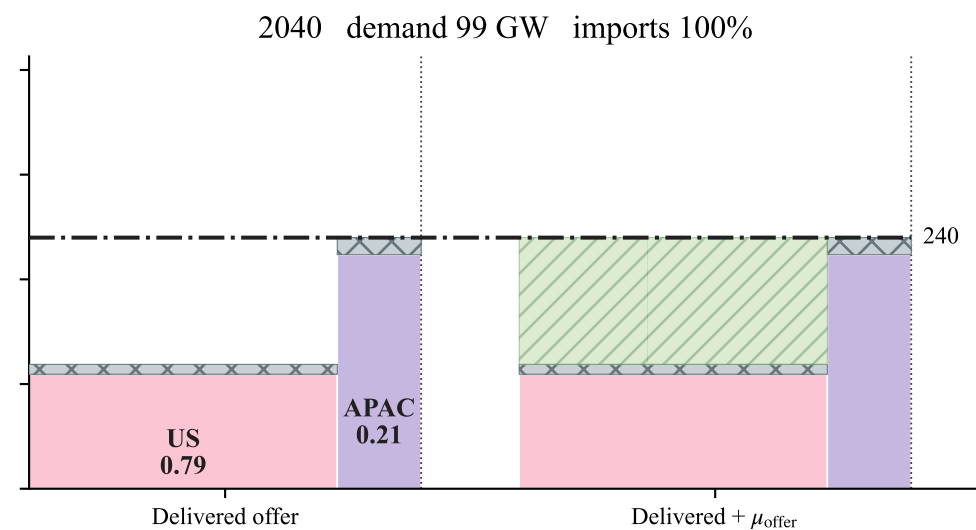


Supplier flow [GW]: US 77.8 · APAC 21.2

Each bar spans 1 GW of demand; supplier widths are identical in the two bars.




US: paired supplier offers and price composition per 1 GW — C20

2025 demand 45 GW imports 100%

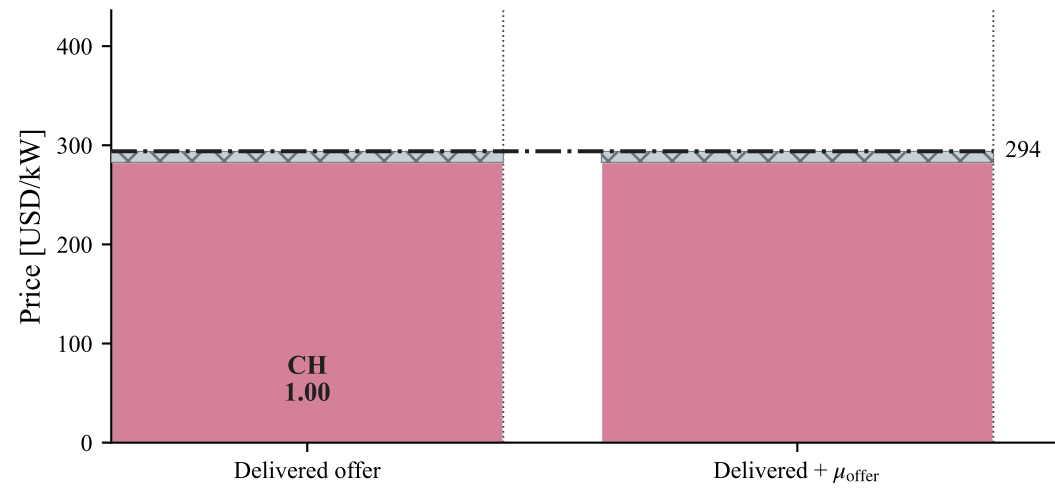


Supplier flow [GW]: CH 45.0

2030 demand 65 GW imports 0%

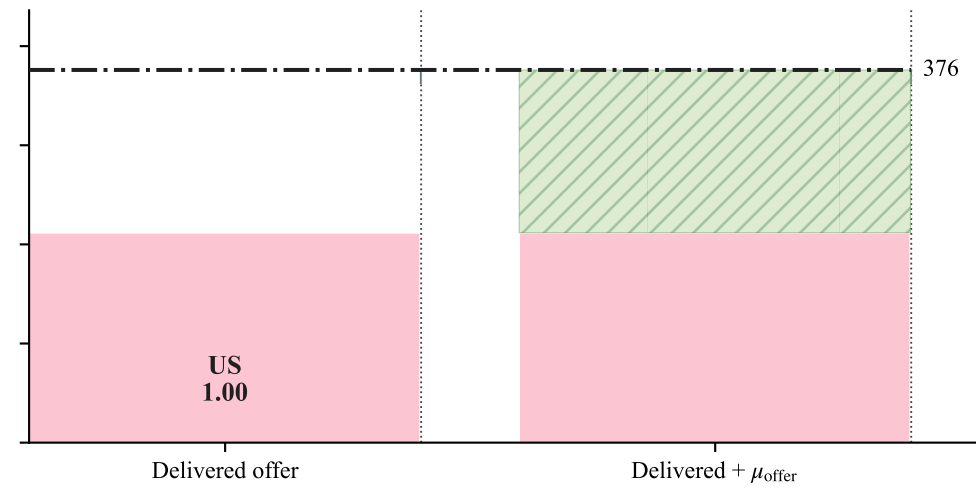


Supplier flow [GW]: US 64.9 · ROW 0.1

2035 demand 70 GW imports 0%

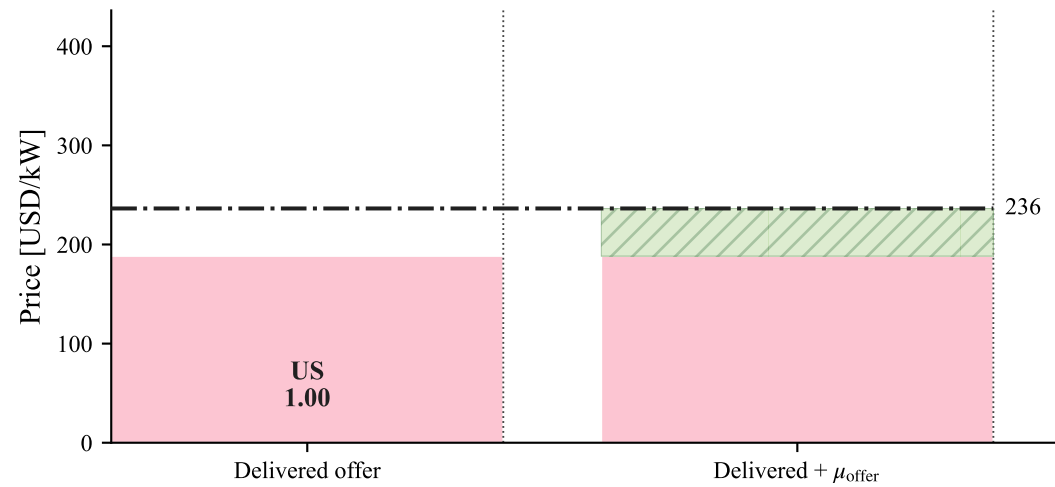


Supplier flow [GW]: US 70.0

2040 demand 75 GW imports 100%

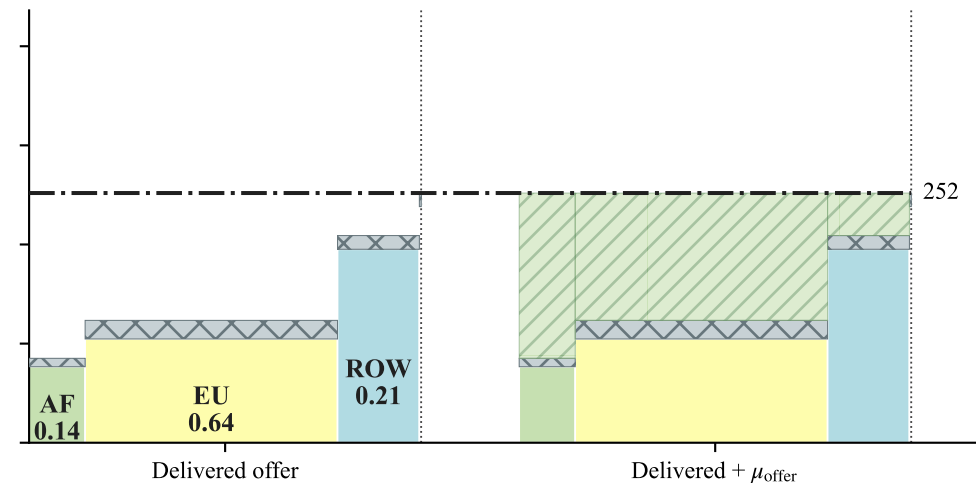


Supplier flow [GW]: AF 10.7 · EU 48.3 · ROW 15.7 · APAC 0.3


Each bar spans 1 GW of demand; supplier widths are identical in the two bars.




APAC: paired supplier offers and price composition per 1 GW — C20

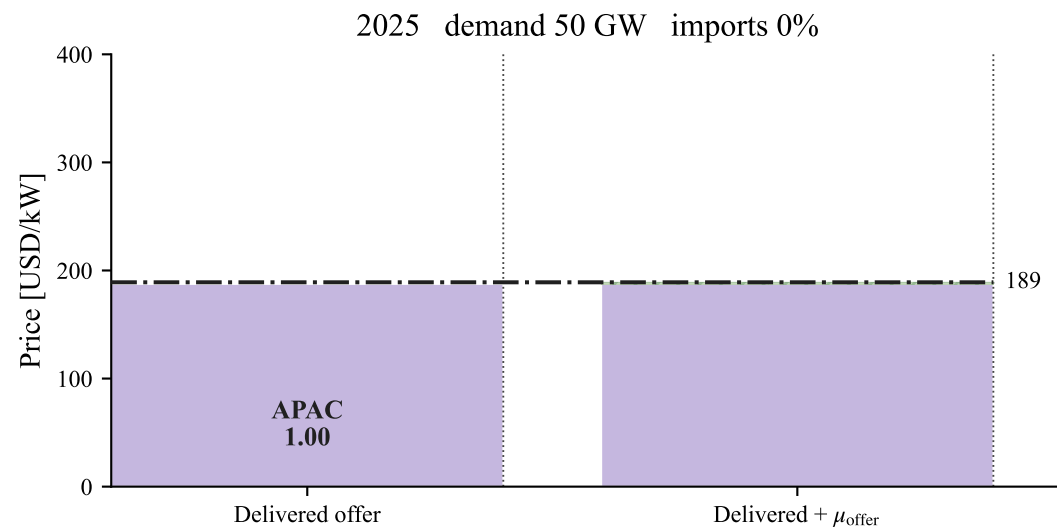


Supplier flow [GW]: APAC 50.0

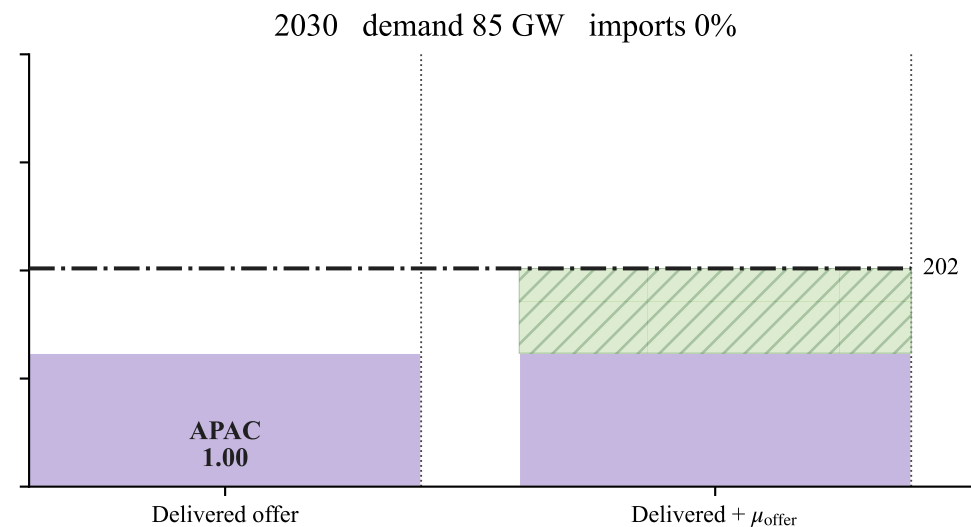

Supplier flow [GW]: APAC 85.0

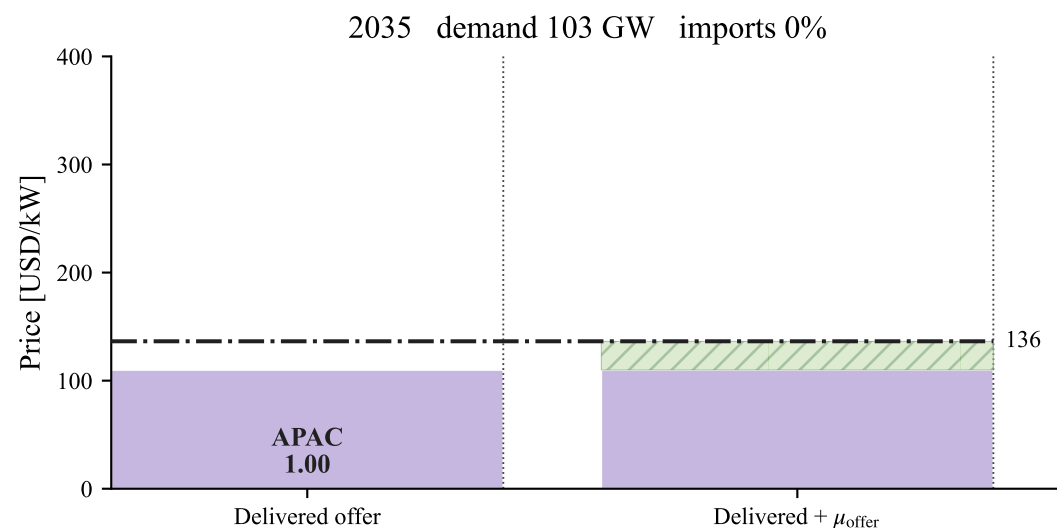


Supplier flow [GW]: APAC 103.0




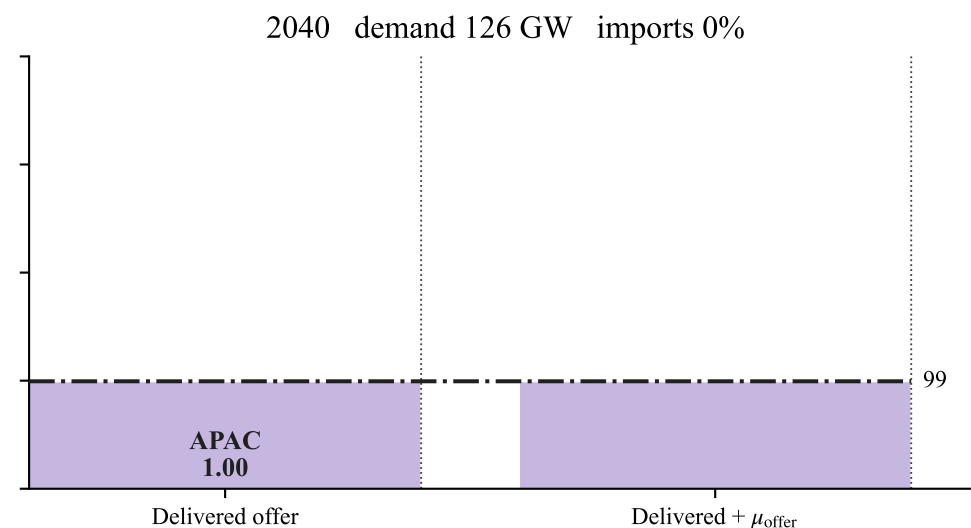


Supplier flow [GW]: APAC 126.0


Each bar spans 1 GW of demand; supplier widths are identical in the two bars.







AF: paired supplier offers and price composition per 1 GW — C20

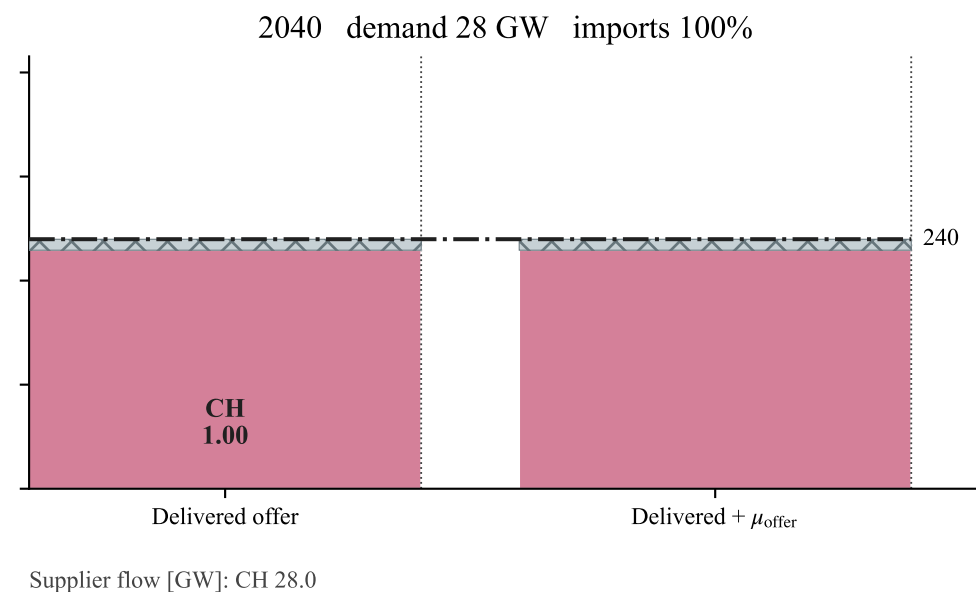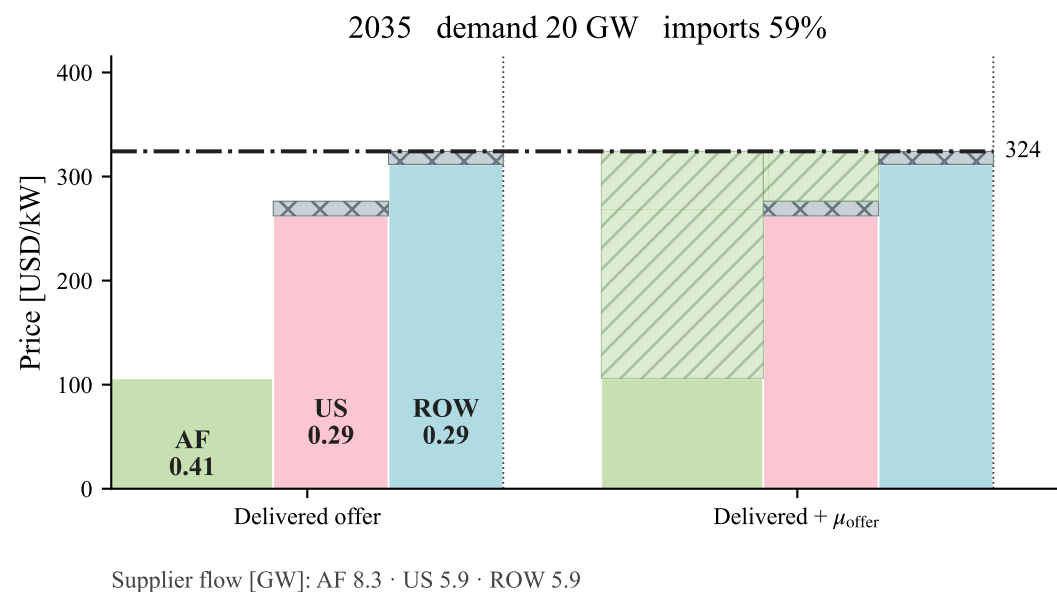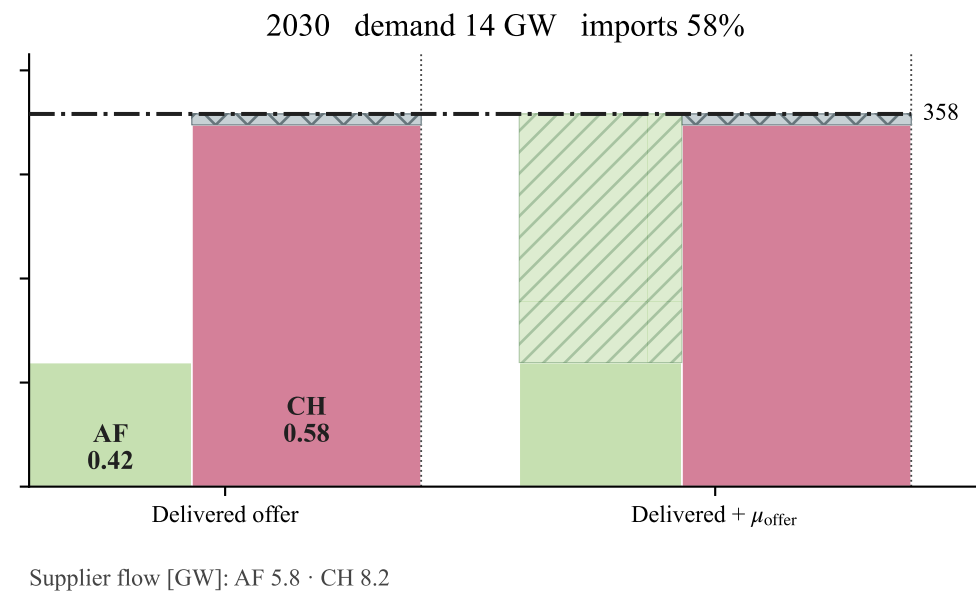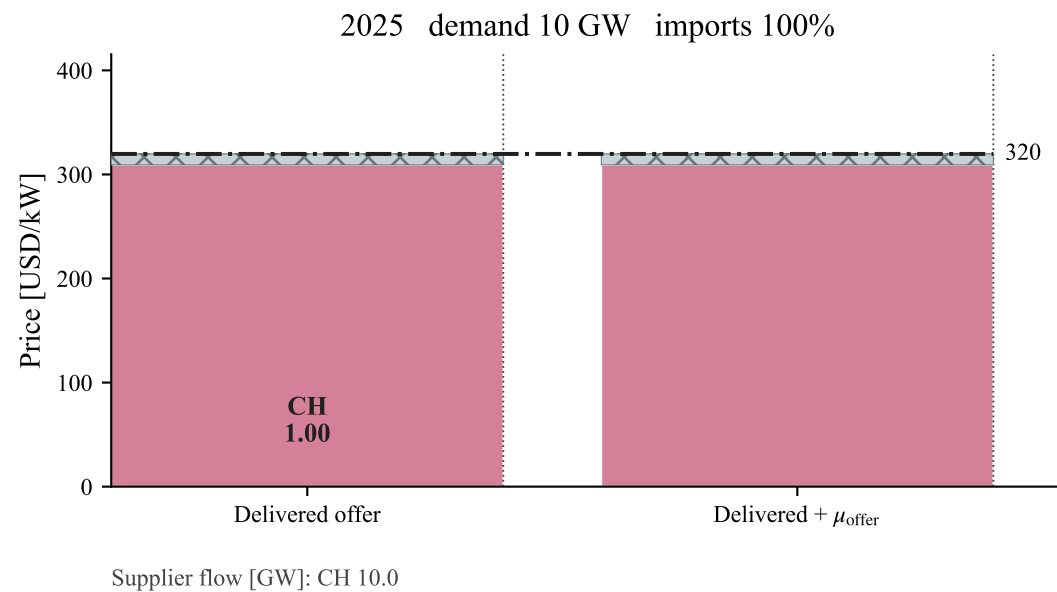

Each bar spans 1 GW of demand; supplier widths are identical in the two bars.



ROW: paired supplier offers and price composition per 1 GW — C20

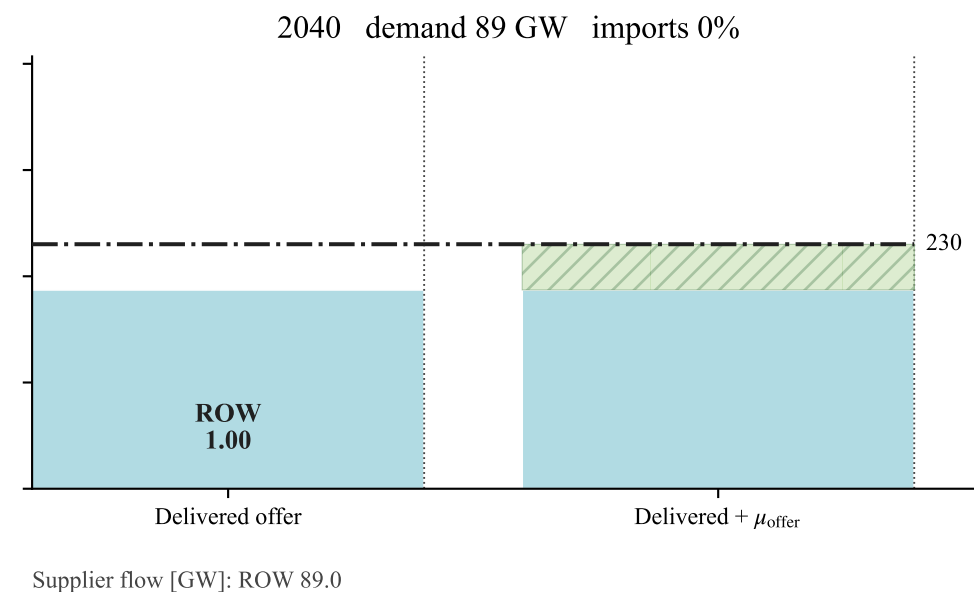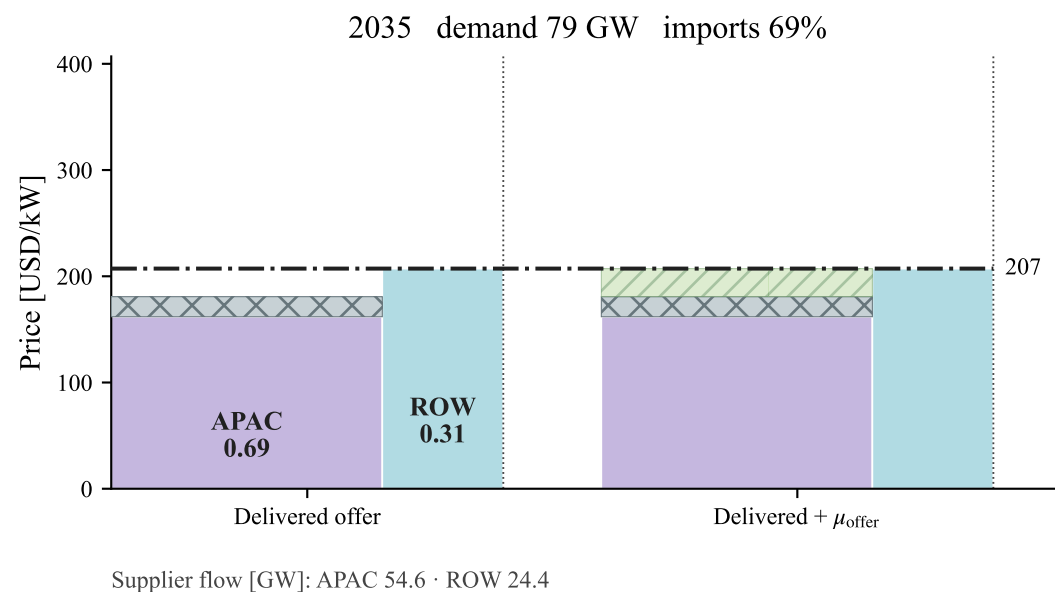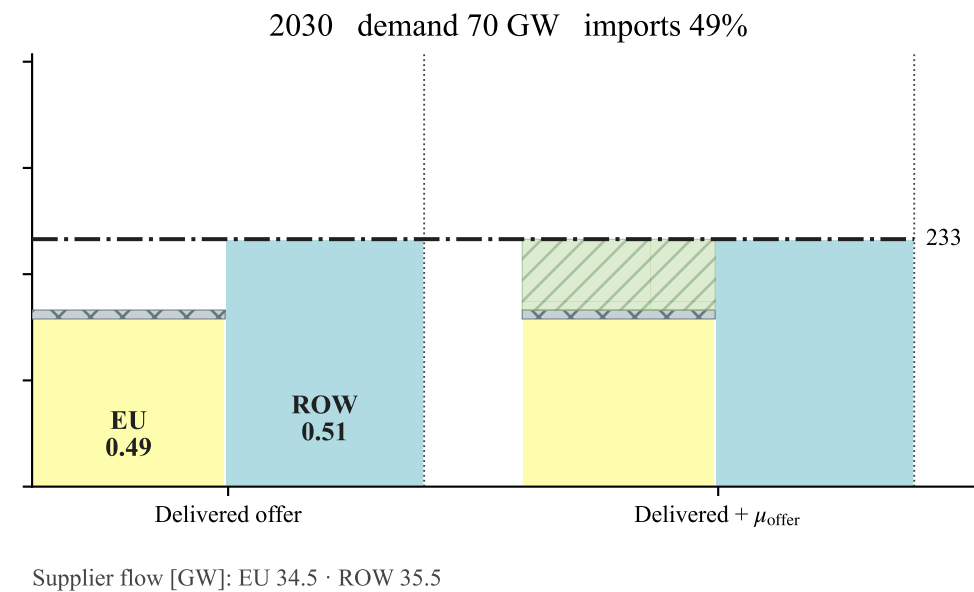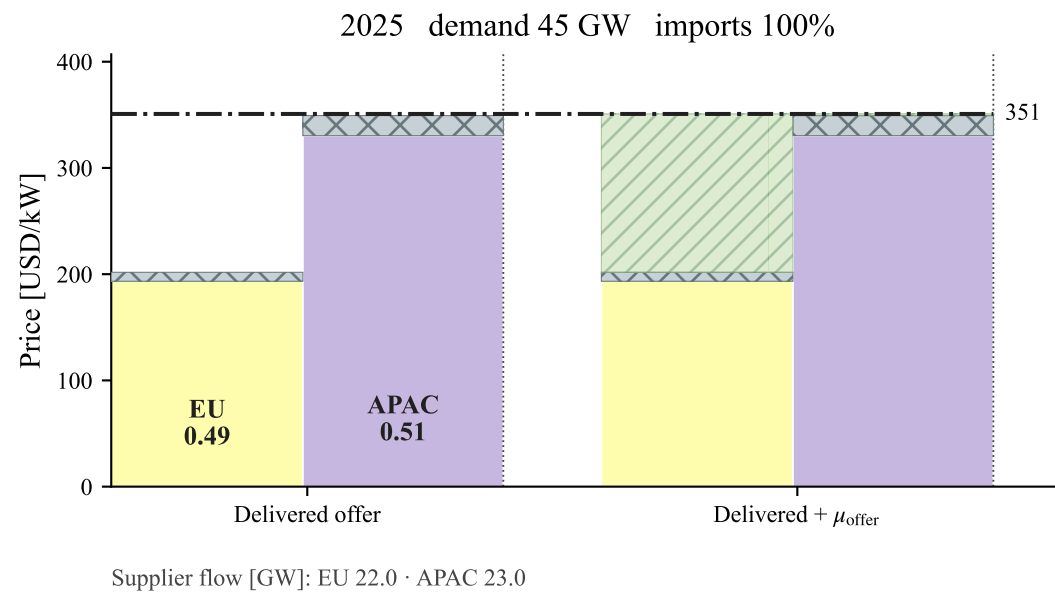

Each bar spans 1 GW of demand; supplier widths are identical in the two bars.

