


Parameter recovery: sensor acuity

independent trials/acuity = 960; observations/trial = 200


MAE = 0.0232; $R^2 = 0.9999$

Acuity recovery $R^2 = 0.9999$

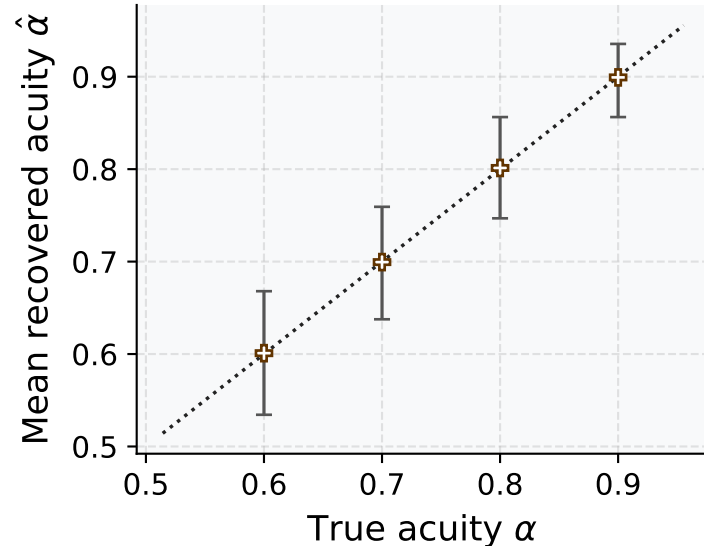

..... identity reference
+ recovered (95 % percentile interval)

Absolute recovery error per acuity level

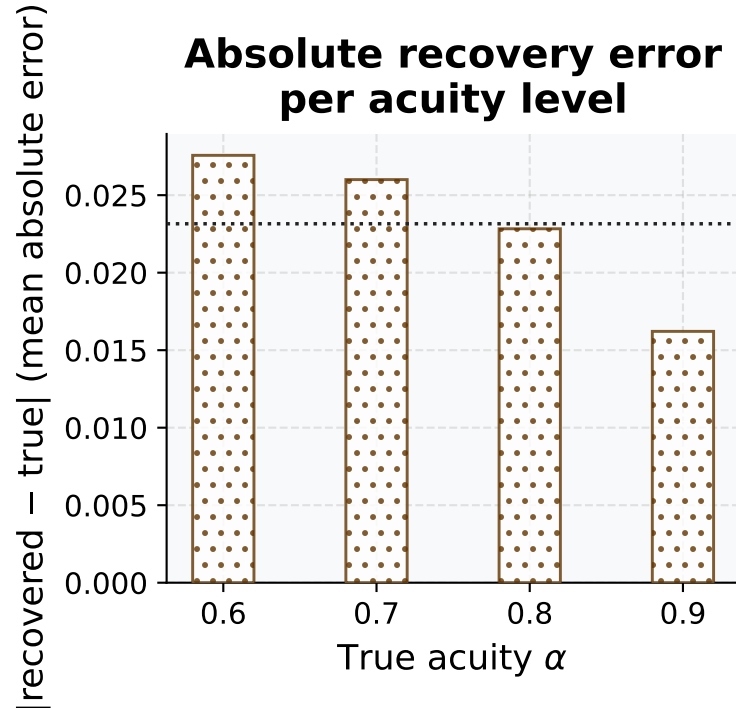

..... mean MAE = 0.0232
|recovered - true|

Intervals vary independent simulation trials within each acuity condition;
observations are nested within trial.