



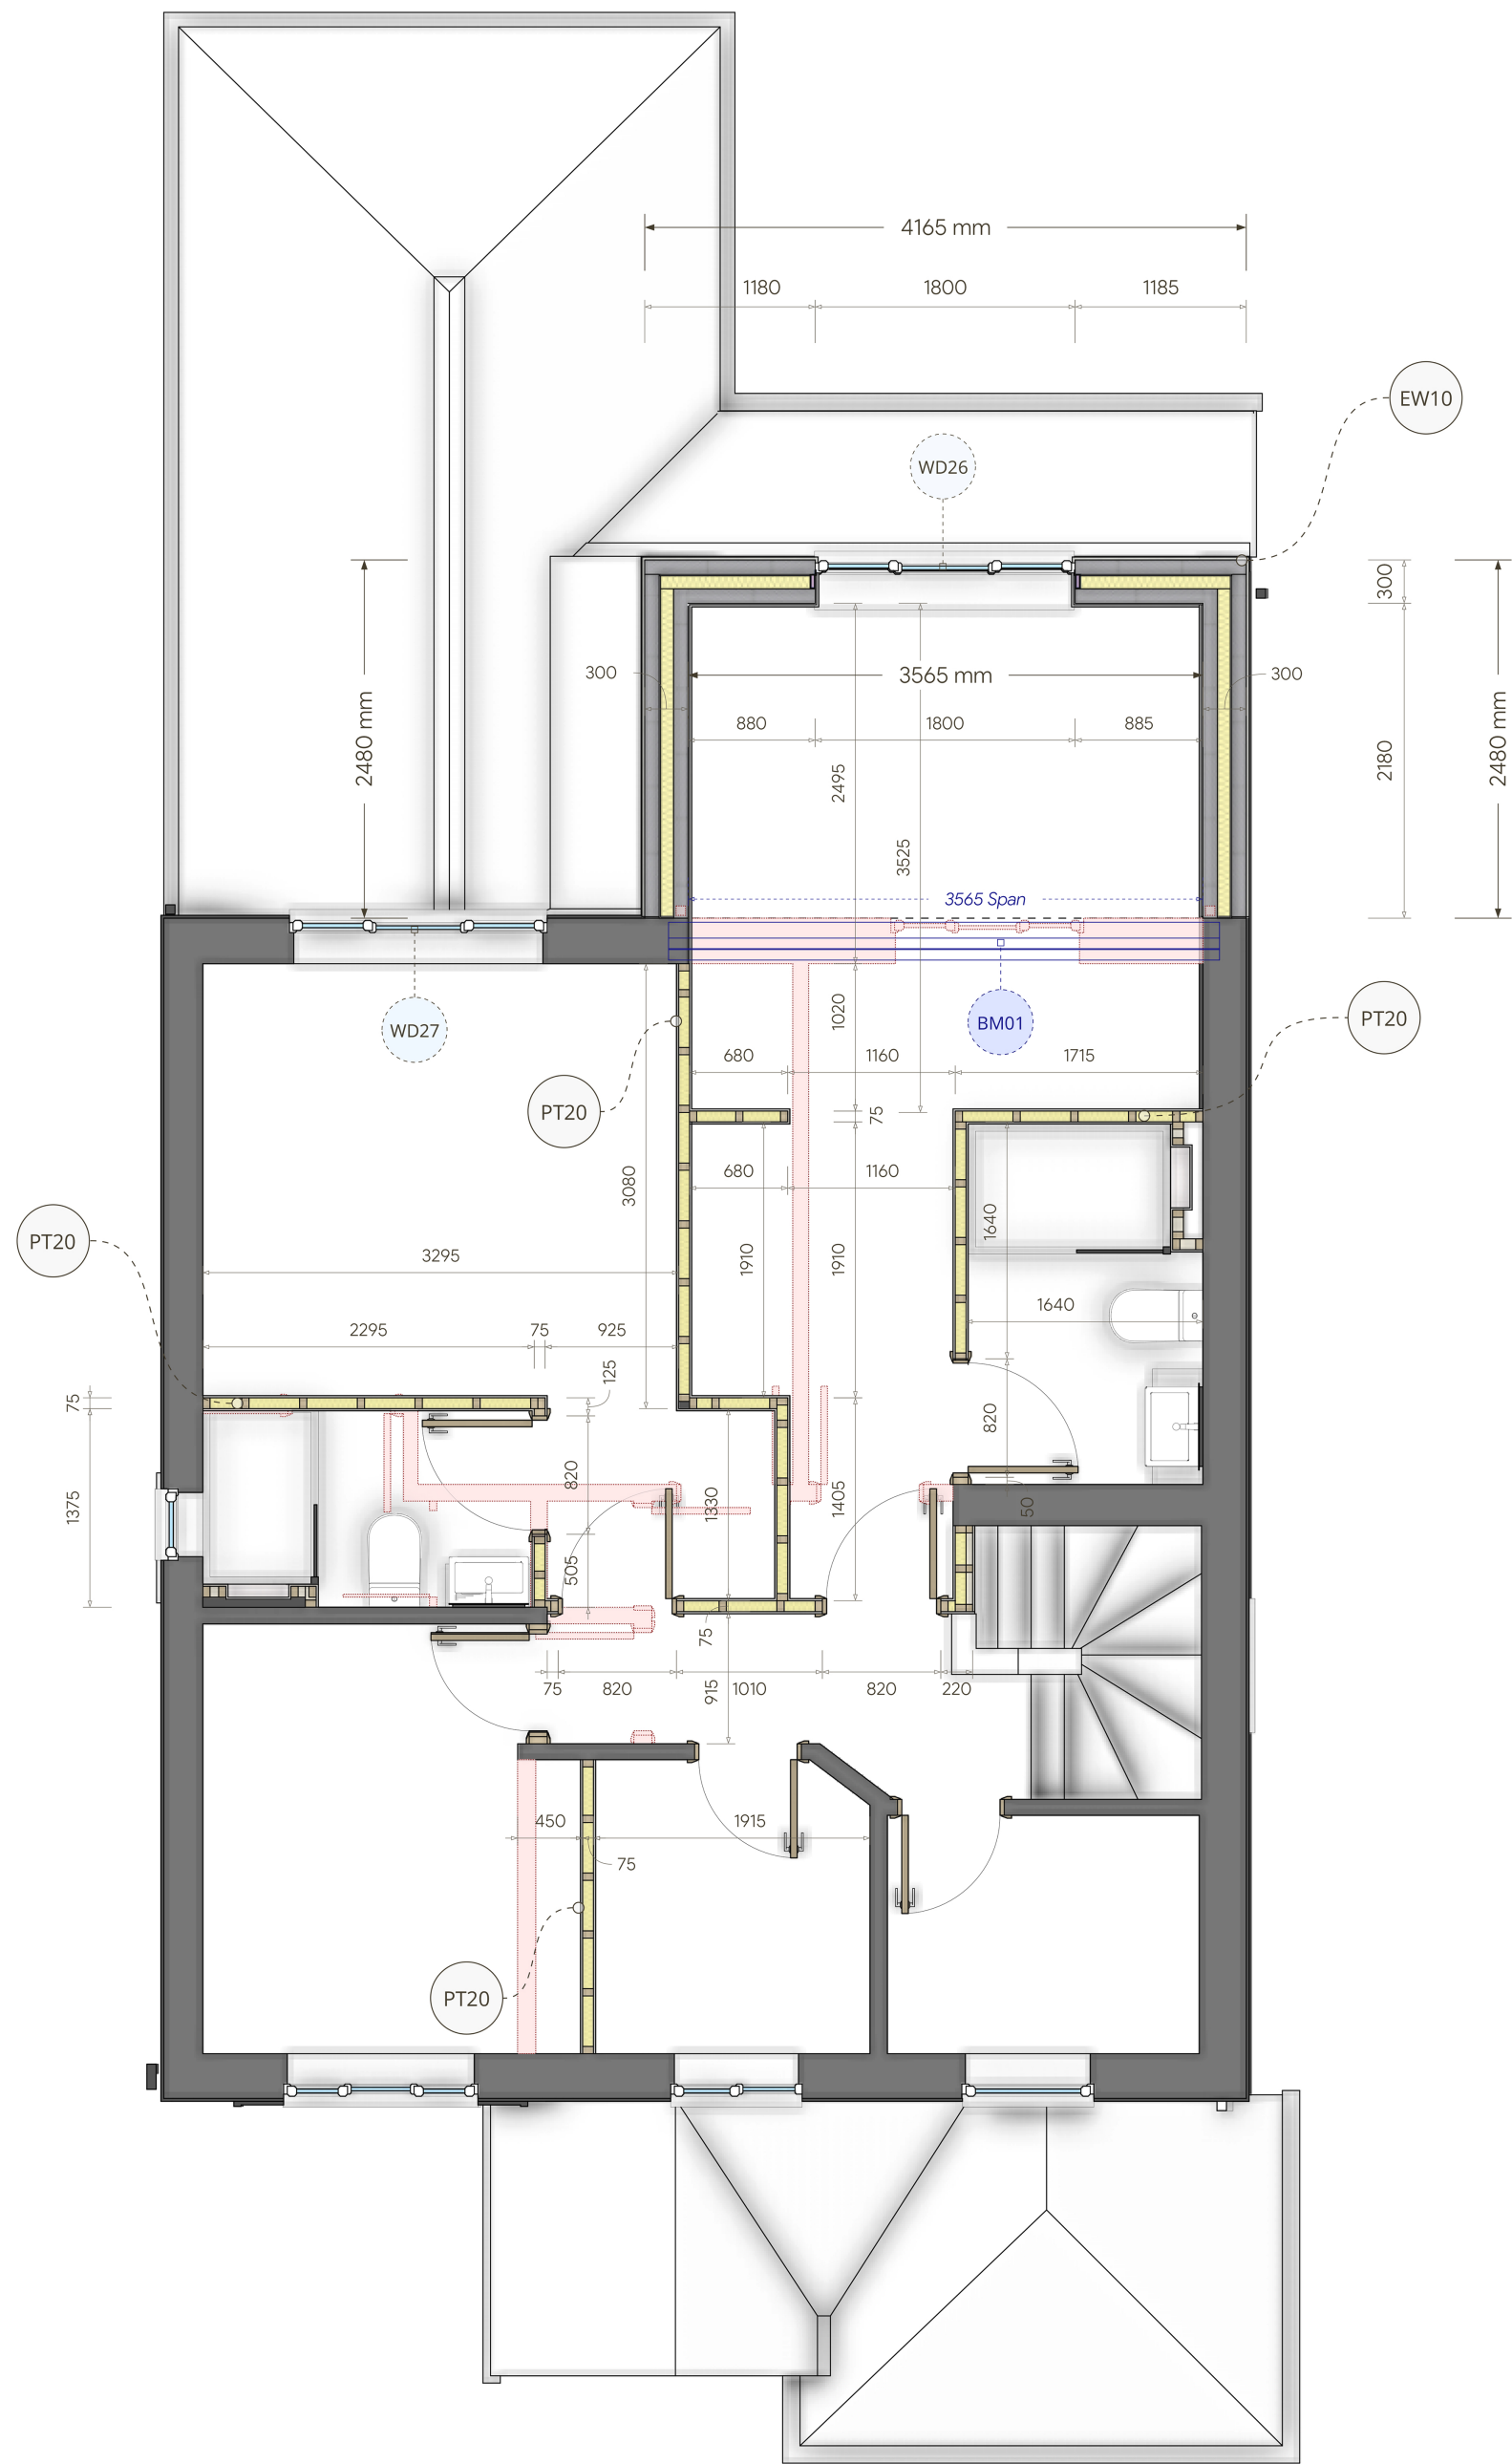

PT20	Internal Studwork Partition - (w105 mm)
1. Timber Stud Spec	
1.1. Dimensions	75mm x 38mm
1.2. Material	Kiln-dried softwood
1.3. Critical Info	Ensure timber is treated to resist moisture and pests.
1.4. Accreditations	CE marked; FSC certified
2. Insulation Layer	
2.1. Thickness	75mm
2.2. Material	Acoustic mineral wool
2.3. Product	Rockwool Sound Insulation Slab or equivalent
2.4. Critical Info	Fit tightly between studs to avoid gaps; ensure full coverage for optimal sound insulation.
2.5. Note	Must comply with Part E requirements for resistance to the passage of sound.
2.6. Accreditations	CE marked; BBA certified
3. Plasterboard Layers	
3.1. Thickness	12.5mm
3.2. Material	Gypsum plasterboard
3.3. Product	British Gypsum Gyproc WallBoard or equivalent
3.4. Critical Info	Fix securely to timber studs with appropriate screws (35mm drywall screws recommended).
3.5. Note	Ensure plasterboard joints are staggered and taped.
3.6. Note	Line both sides of the studwork with plasterboard.
3.7. Accreditations	CE marked; complies with BS EN 520:2004+A1:2009
4. Finishing Layers	
4.1. Thickness	3mm
4.2. Material	Multi-finish plaster
4.3. Product	British Gypsum Thistle MultiFinish or equivalent
4.4. Critical Info	Apply skim coat evenly to achieve a smooth finish suitable for painting or wallpapering.
4.5. Note	Ensure all joints and screw heads are adequately covered.
4.6. Note	Finish both sides of studwork with plaster skim coat.
4.7. Accreditations	CE marked; complies with BS EN 13279-1:2008
5. Compliance & Accreditation	
5.1. British Standards	BS EN 520:2004+A1:2009 - (Gypsum plasterboards); BS EN 13279-1:2008 - (Gypsum binders and gypsum plasters)
5.2. Building Regulations	Approved Document E (Resistance to the passage of sound)
5.3. Quality Assurance	Ensure materials are installed as per CE marking requirements and manufacturer guidelines.

PL20 | Technical Plan - First Floor

