



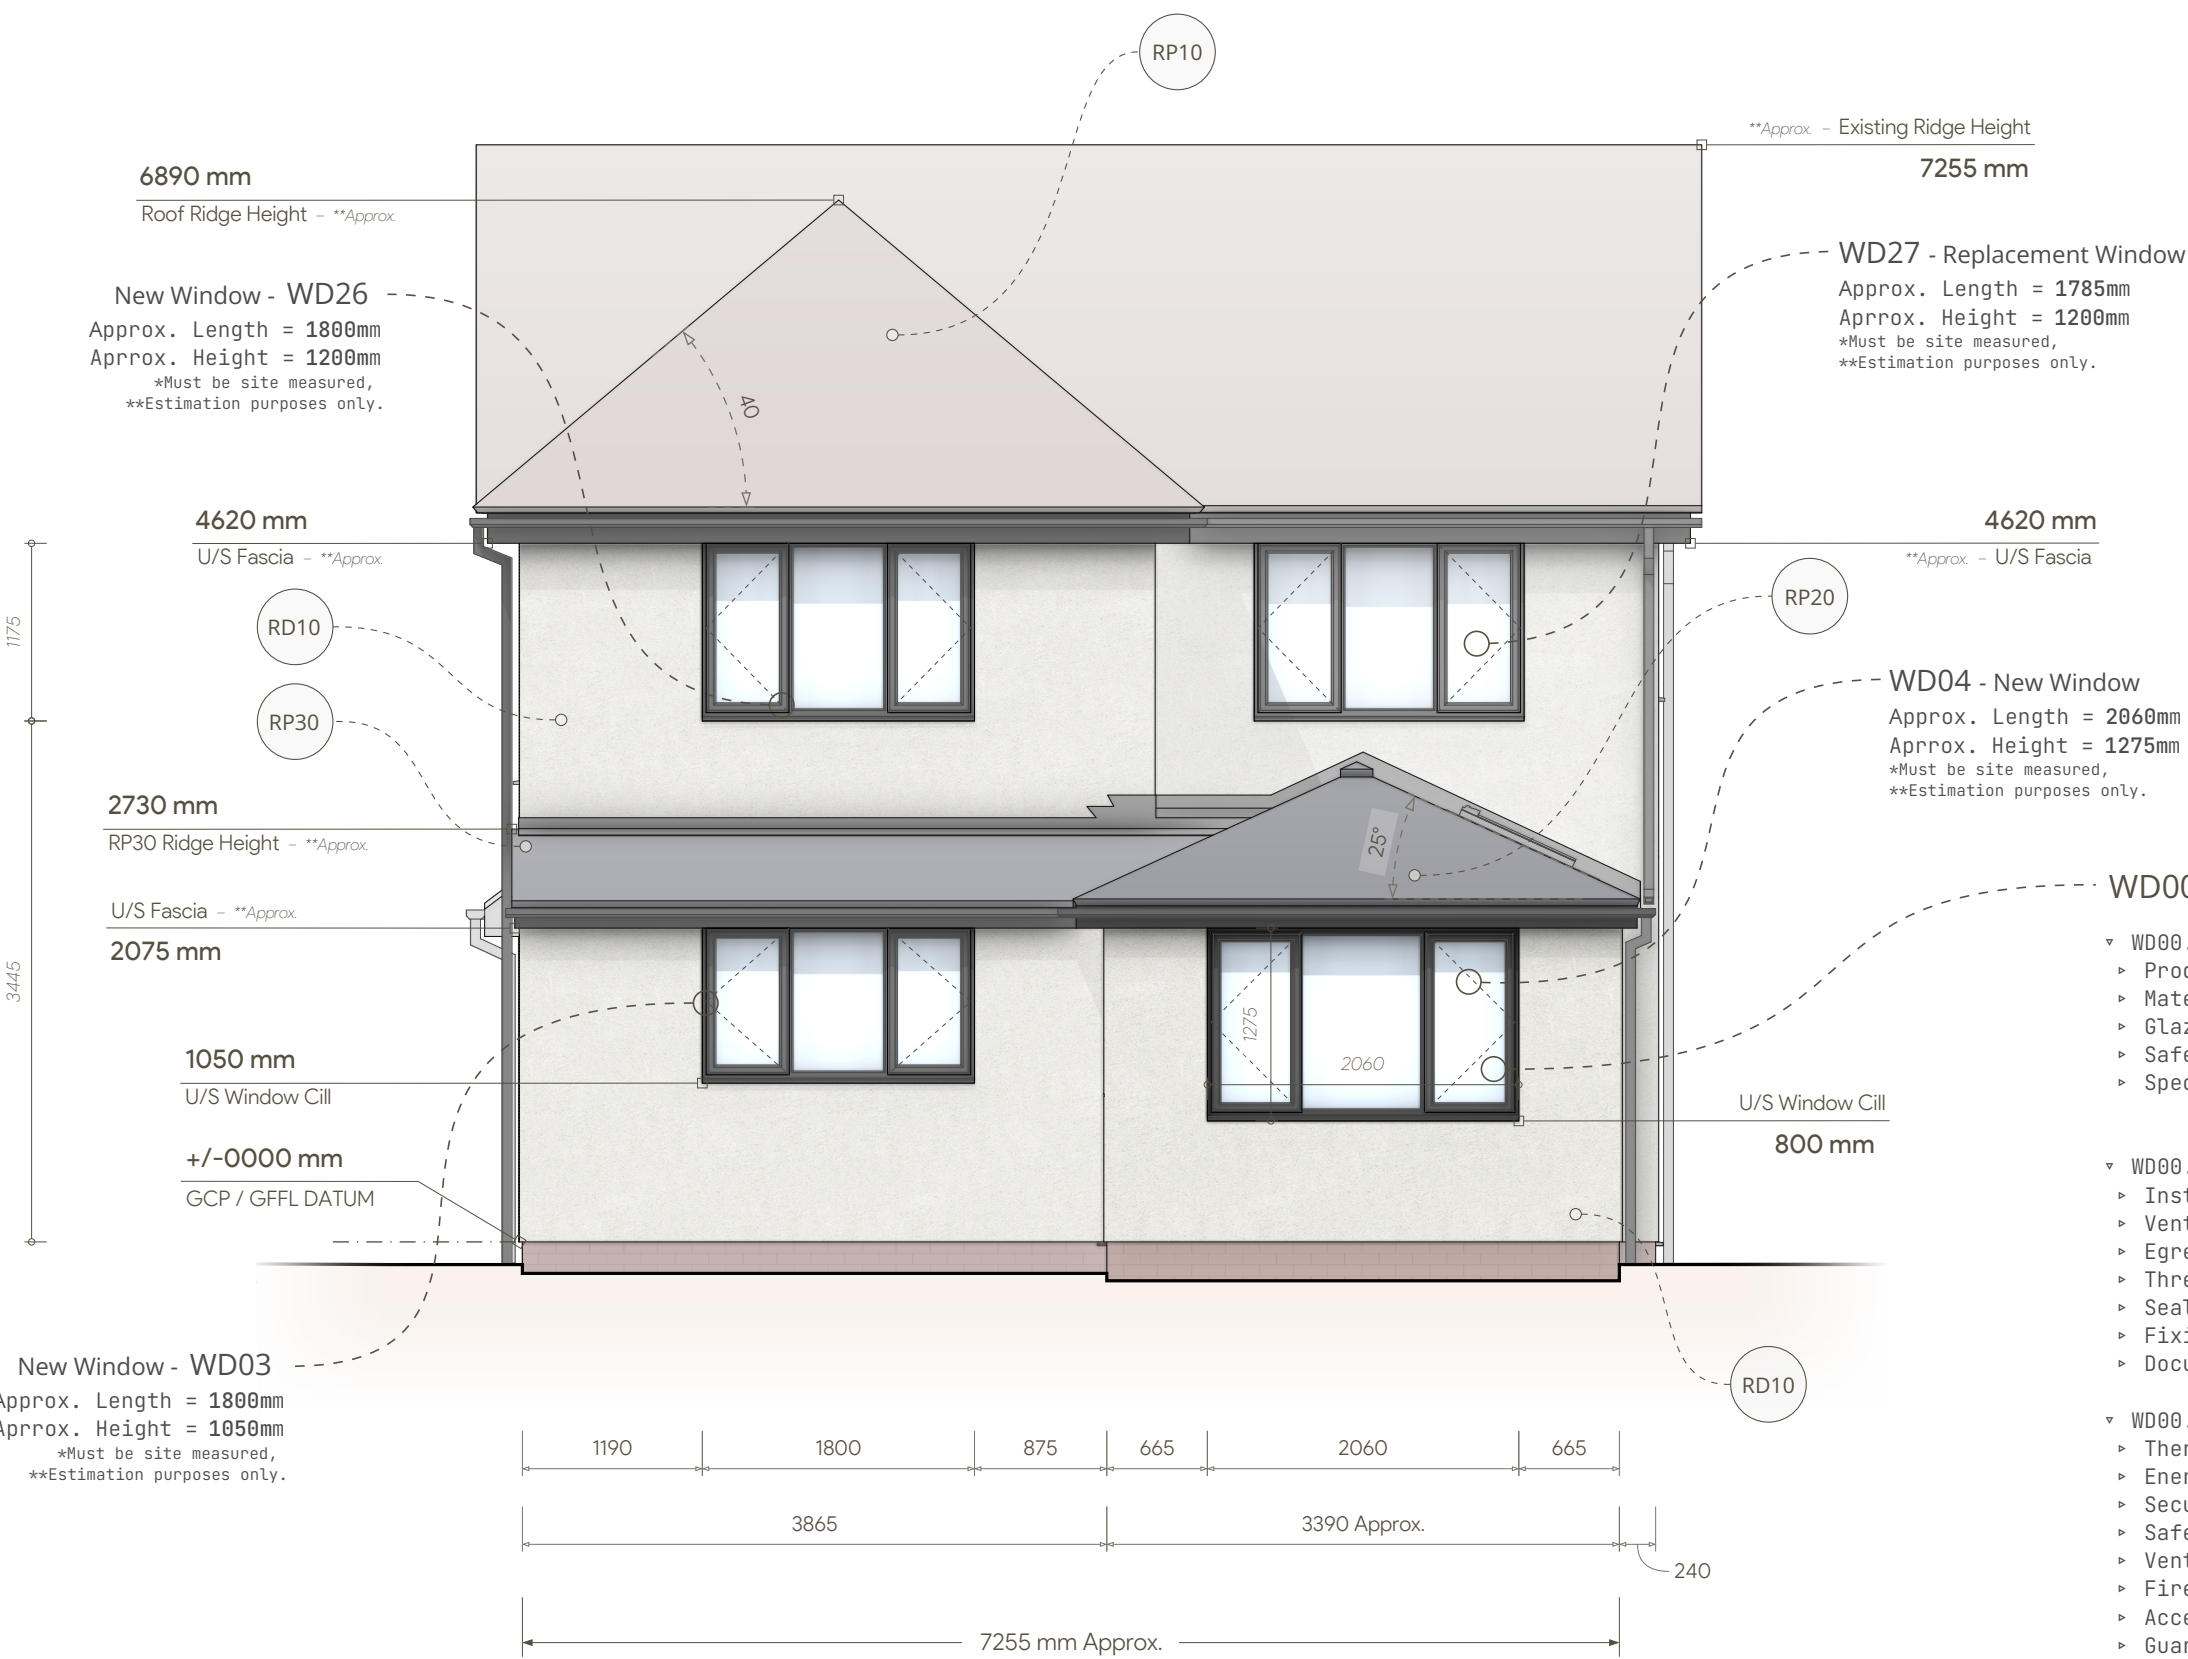

PE03 | South Elevation



VX00 | Velux Roof Window Specification

- **VX00.01 | MATERIALS & PRODUCT DETAILS**
 - Product - Velux CK02 Roof Window
 - Dimensions - W558mm x H780mm; *external frame dimensions*
 - Type - Centre-pivot (GGL CK02) or Top-hung (GPL CK02) **Client Preference**
 - Glazing - 78 Pane: Double glazed, laminated inner (U-value ~1.3 W/m²K) Or 66 Pane: Triple glazed (U-value ~1.0 W/m²K) **Client Preference**
 - Spec Note - This specification is a Quality Benchmark, **Contractor May Specify Alternatives** Any alternative must meet the same performance criteria specified on this document

- **VX00.02 | INSTALLATION REQUIREMENTS**
 - Structural Opening - 555mm wide x 785mm high (to allow for insulation collar and flashing)
 - Positioning - Min. 150mm from bottom of window to top of fascia/eaves; at least one tile course above gutter
 - Flashings - Velux proprietary flashing kit, compatible with tile profile
 - Insulation - Install Velux insulation collar and vapour barrier as per manufacturer's instructions
 - Trimming - Double trimmers to both sides for structural support
 - Ventilation - Maintain roof ventilation path around window
 - Fixings - As per Velux installation manual
 - Finishing - Internal reveals to be insulated and finished with plasterboard

- **VX00.03 | STANDARDS & COMPLIANCE**
 - U-Value - Min Val. 1.3 W/m²K (double), Min Val. 1.0 W/m²K (triple) per Part L 2022/2025
 - Standards - BS EN 14351-1, BBA Certified, CE Marked
 - Building Regs - Compliance with Parts B (Fire), C (Moisture), L (Thermal), K (Safety)
 - Fire Rating - As per Velux BBA certificate and local fire requirements




Global Height Benchmark

Datum GCP | Ground Floor Finished Floor Level


All height measurements on this drawing are taken from the existing ground floor finished floor level, which serves as the universal site datum benchmark unless otherwise specified. Heights are set globally based on the primary ground control point established during the survey. If exact coordinates of this ground control point are required, please contact Noble Architecture.

WD00 | Windows, Doors & Exterior Glazing Specification

- **WD00.01 | PRODUCT DETAILS**
 - Product - New & Replacement Windows, Doors & Exterior Glazing **Sourced By Contractor**
 - Material - RAL 9005 'Jet Black' finish uPVC, aluminium, or composite as specified
 - Glazing - High performance 'Low E' double glazing, min. 16mm argon-filled cavity
 - Safety - Toughened or laminated safety glass in all critical locations (*see Part K*)
 - Spec Note - This specification is a Quality Benchmark, **Contractor May Specify Alternatives** Any alternative must meet the same performance criteria specified on this document
- **WD00.02 | INSTALLATION REQUIREMENTS**
 - Installer - FENSA/CERTASS registered installer or works approved by Building Inspector
 - Ventilation - ALL habitable rooms to have windows/doors with trickle vents (Part F)
 - Egress - Escape windows to habitable rooms are required;
 - Threshold - Main entrance doors to have level threshold for accessibility (Part M)
 - Sealing - All frames to be fully sealed and insulated to prevent thermal bridging
 - Fixings - Install per manufacturer's instructions and BS 8213-4:2016
 - Documentation - FENSA/CERTASS certificate or Building Control sign-off required
- **WD00.03 | PERFORMANCE & COMPLIANCE**
 - Thermal Value - Windows & glazed doors: Min U-value : 1.2 W/m²K (*new*), 1.4 W/m²K (*Replacements*)
 - Energy Rating - Windows: WER Band B or better (*replacements*)
 - Security - PAS 24:2016 enhanced security standard
 - Safety - Safety glazing such as toughened or laminated glass to critical areas per Document K
 - Ventilation - Trickle vents to meet Part F requirements
 - Fire Escape - Egress windows to all habitable rooms at first floor and above (Part B)
 - Access - Main entrance doors to meet Part M (level threshold, clear width)
 - Guarantee - Min. 10-year product guarantee; Check with supplier for exact terms
 - Certification - CE Marked, BBA Certified, FENSA/CERTASS certificate
- **WD00.04 | EMERGENCY ESCAPE WINDOWS**
 - Bedrooms must be fitted with an emergency escape window in accordance with Approved Document B.
 - The window must provide a clear openable area of at least 0.33m².
 - The clear height and clear width of the opening must each be a minimum of 450mm.
 - The bottom of the openable area must be no more than 1100mm above the finished floor level.
 - The clear opening is measured free of obstructions (i.e., excluding fixed bars, stays, or handles).

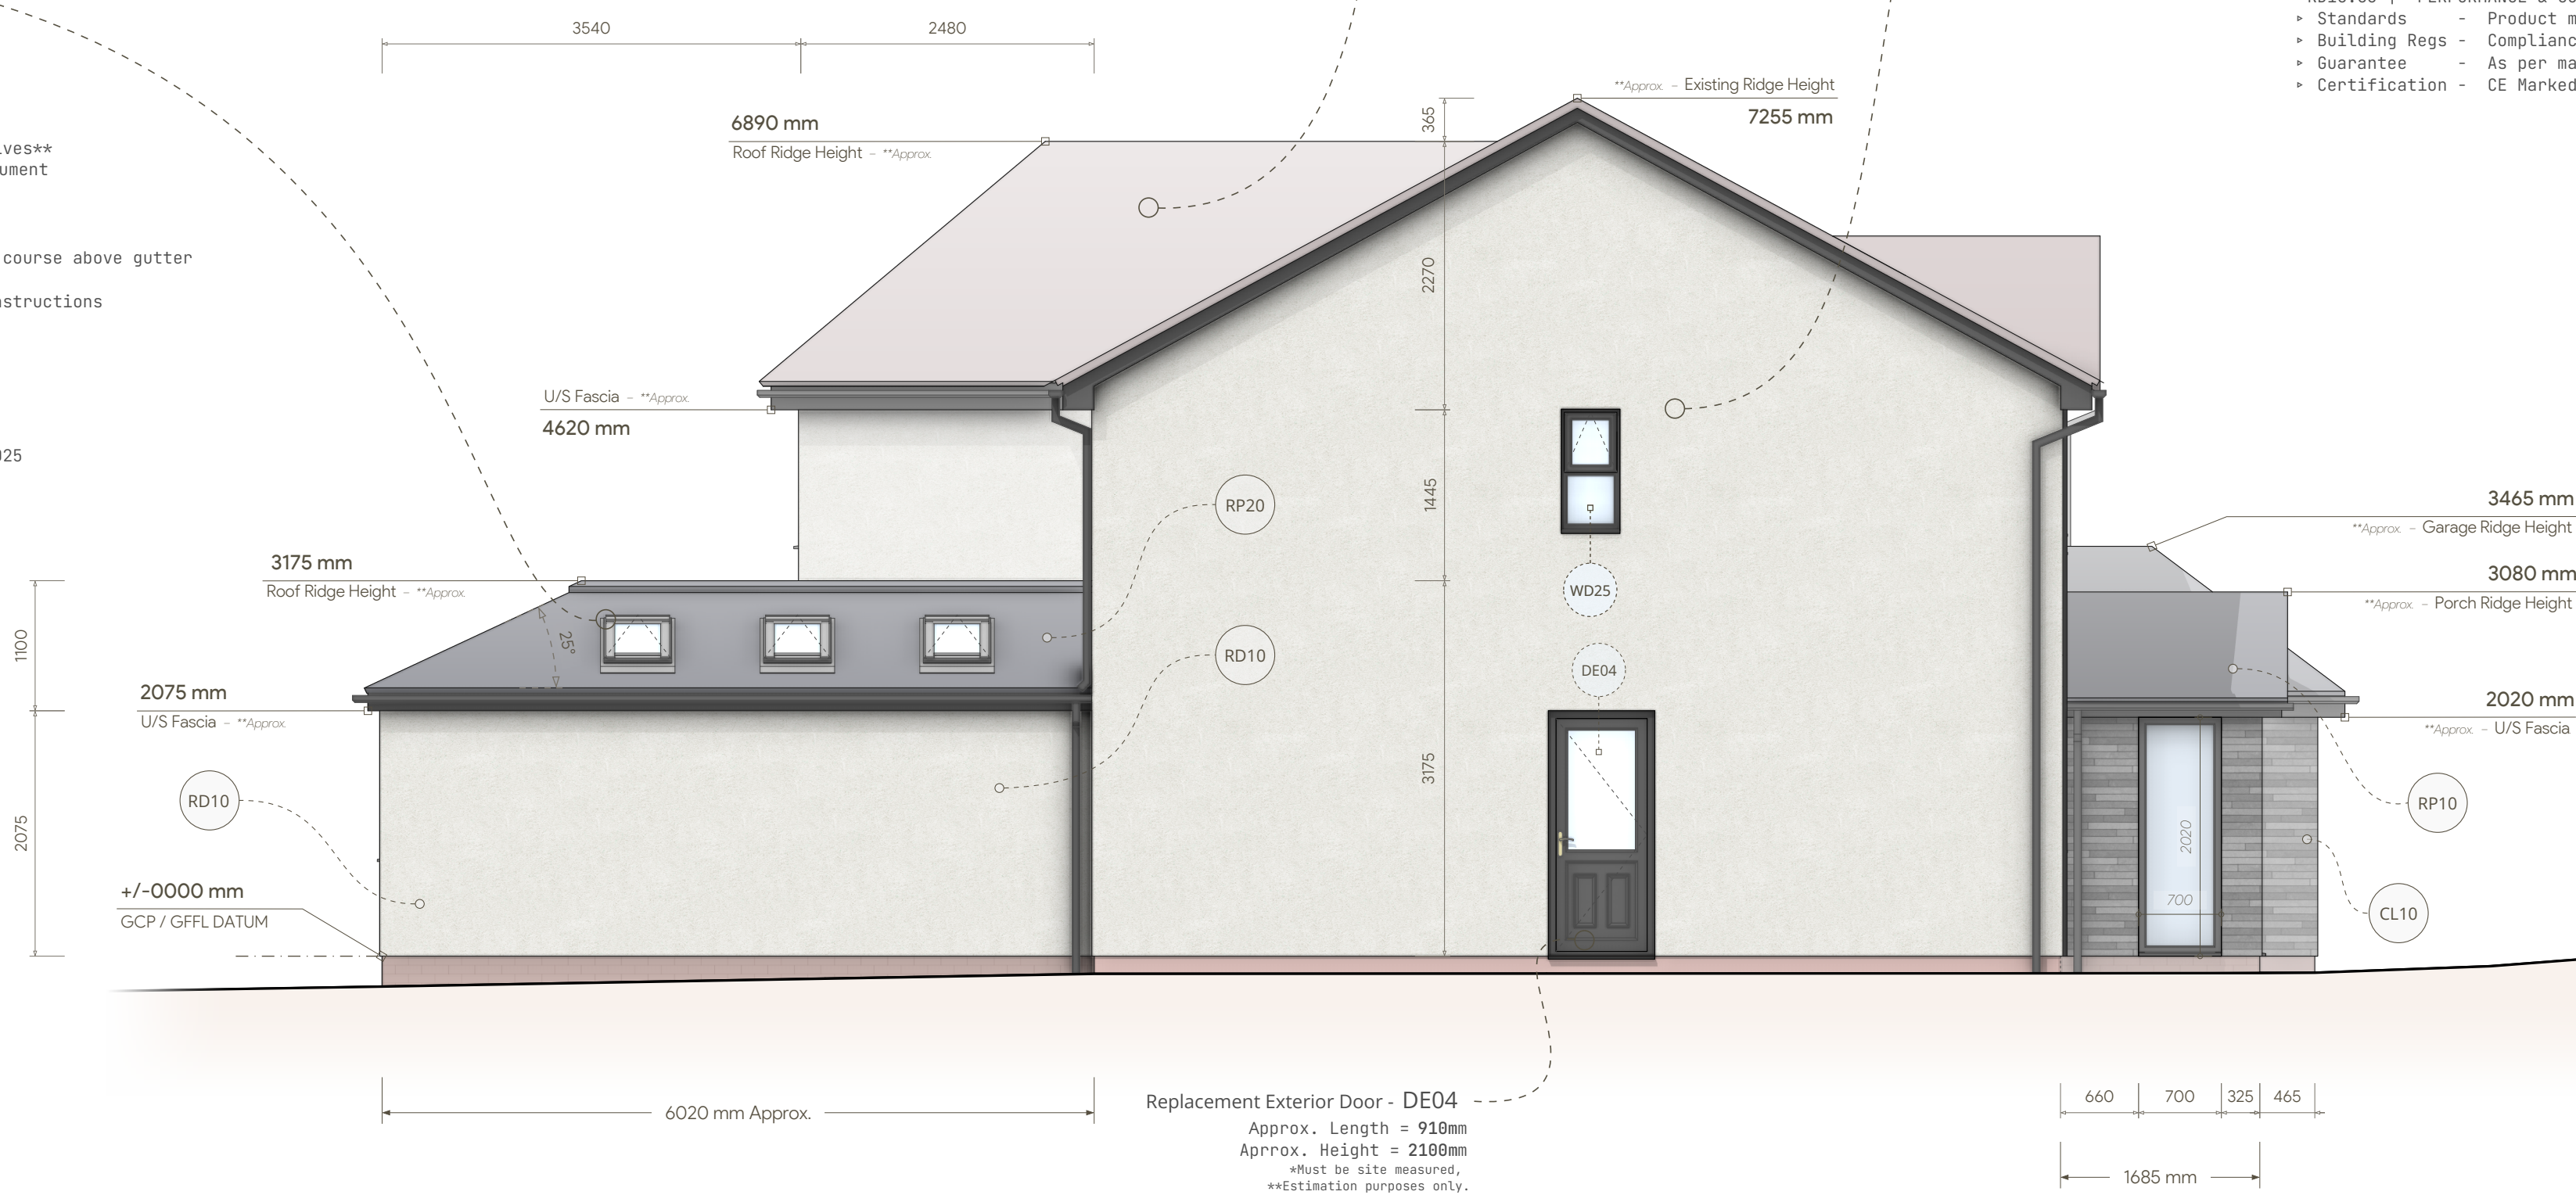

PE04 | West Elevation



RP40 | First Floor Rear Extension Roof Specification

- **RP40.01 | MATERIALS & PRODUCT DETAILS**
 - Roof Type - Pitched roof, Cold Roof construction, insulated at ceiling joist level, ventilated roof void.
 - Pitch - 40° Roof Pitch. - Hip End
 - Roof Tile - Interlocking concrete tile, Redish-brown finish to match host dwelling roof.
 - Rafters - 150mm x 50mm C24 graded timber joists at 400mm centres.
 - Underlay - BS EN 13859-1 LR (Low Resistance) breathable membrane, BBA certified, with eaves carrier tray.
 - Battens - 25 x 38 mm tanalised treated softwood roofing battens to BS 5534.
 - Wall Plate - 100 x 75 mm pressure-treated timber (UC3) securely fixed.
 - Ceiling - 12.5 mm plasterboard fixed to underside of ceiling joists.
 - Finish - 3mm skim coat plaster finish to ceiling board.
 - Insulation - Mineral wool; 300mm Total Thickness; Required product performance - Lambda Val.A-Value 0.037 W/mK.
 - VCL - 500 g (125 micron) polythene vapour control layer.
 - Flashings - Lead Code 4 (min) or approved proprietary flashing system to all abutments/penetrations.
 - Fixings - Tile/Batten; Stainless steel or galvanised nails per BS 5534 / manufacturer specs.
 - Structural: As per structural design.
- **RP40.02 | INSTALLATION REQUIREMENTS**
 - Insulation - Install 150 mm mineral wool between joists + 150 mm cross-laid over ceiling joists (total 300 mm). Fit tightly without gaps.
 - Ventilation - Provide 10,000 mm²/m continuous eaves and 5,000 mm²/m continuous ridge ventilation. Maintain a minimum 50 mm clear air gap above insulation.
 - Membrane - Install BS EN 13859-1 compliant breather membrane taut over rafters, lapped per manufacturer.
 - VCL - Install VCL to warm side of insulation. Tape all joints & seal penetrations/perimeters.
 - Battens - Install to correct gauge per tile manufacturer; fix securely per BS 5534.
 - Underlay - Install with correct laps & draps; ensure continuity into gutter with eaves support.
 - Flashings - Install correctly dressed flashings to all abutments, penetrations etc.
 - RW Goods - Install rainwater goods as per dedicated specification.
- **RP40.03 | STANDARDS & COMPLIANCE**
 - Standards - BS 5534, BS EN 1995-1-1, BS 5250, BS EN 13859-1, BS EN ISO 6946.
 - Building Regs - Meet or exceed Approved Document L, F, C, B, A (England & Wales) / Equivalent Regs.
 - Fire Rating - Tiles Euroclass A1; Mineral wool insulation Euroclass A1/A2.
 - Certification - CE/UKCA Marked materials; BBA Certified where available. Timber C24 graded.
 - Condensation - Comply with BS 5250 condensation control requirements.
 - Thermal req. - **Must Achieve - 0.15 W/m²K** - per Part L1B 2021.
 - U-Value - **0.14 W/m²K ✓ Achieved**

RD10 | Silicone Render System Specification

- **RD10.01 | PRODUCT DETAILS**
 - Product - Weber Monocouche Silicone Based Render
 - Finish - "Chalk" or "Silver Pearl" **Subject To Client Sample Approval**
 - Basecoat - Polymer-modified basecoat; Weberend LAC or similar
 - Thickness - Basecoat : 6-8mm over insulation
 - Thickness - Topcoat : 12-15mm over cured basecoat
 - Mesh - Alkali-resistant Fiberglass Mesh with 100mm minimum overlap at joints
 - Spec Note - This specification is a Quality Benchmark, **Contractor May Specify Alternatives** Any alternative must meet the same performance criteria specified on this document

- **RD10.02 | INSTALLATION REQUIREMENTS**
 - Substrate - Must be clean, sound and free from contaminants
 - Application - System to be applied directly to the existing wall surface
 - Basecoat - Apply polymer-modified basecoat at 6-8mm thickness
 - Mesh - Fully embed mesh into wet basecoat
 - Topcoat - Apply only after basecoat has fully cured
 - Temperature - External works must proceed only at ambient temperatures >5°C and rising

- **RD10.03 | PERFORMANCE & COMPLIANCE**
 - Standards - Product must be CE Marked and BBA Certified
 - Building Regs - Compliance with Parts B *Fire-Protection*, C *Moisture-Control*, L *Thermal-Performance*
 - Guarantee - As per manufacturer's agreement, 10 year product guarantee recommended.
 - Certification - CE Marked and BBA Certified