

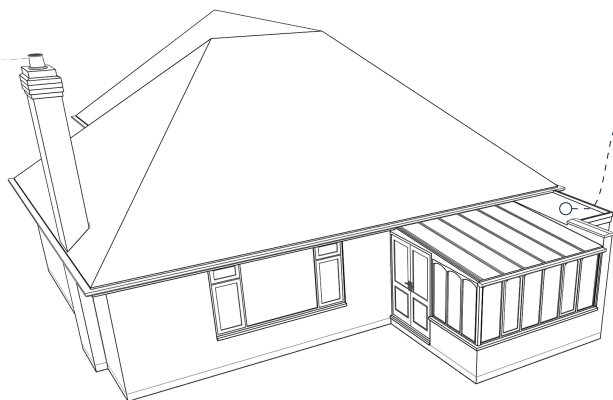
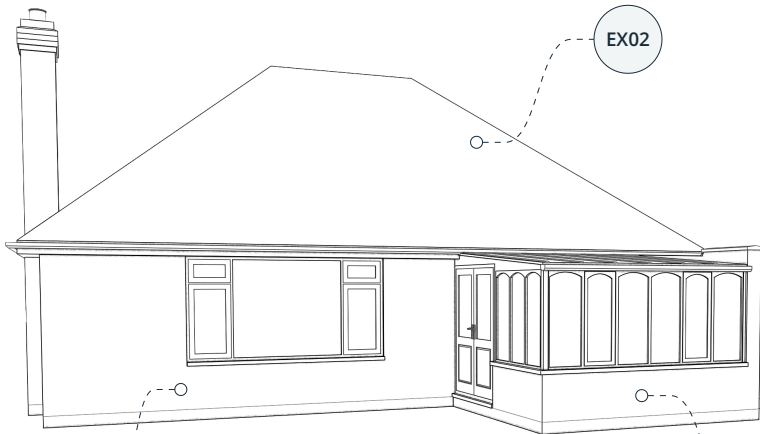
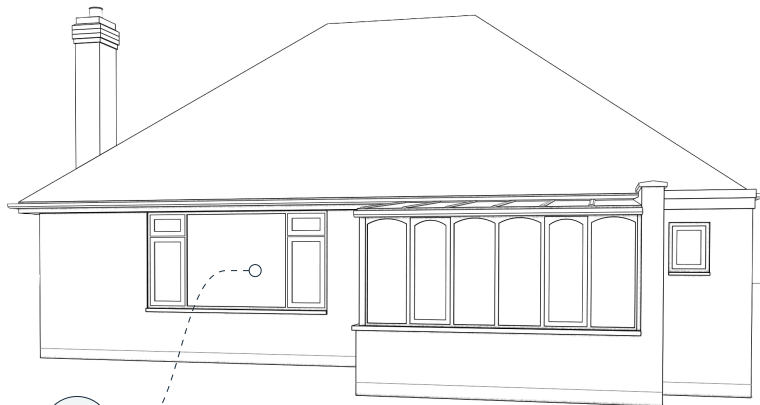
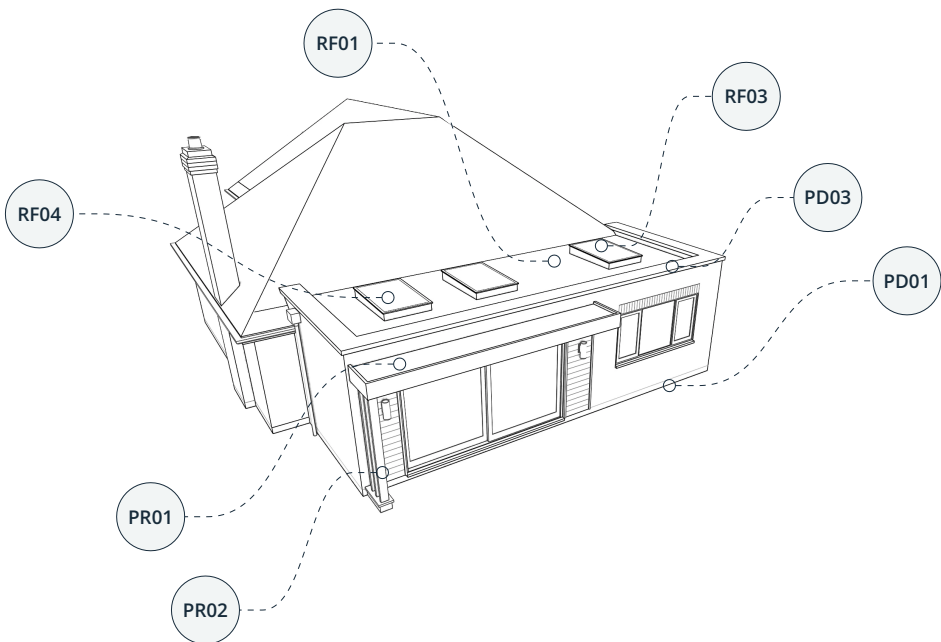


EXISTING CONDITIONS 3D VISUALS

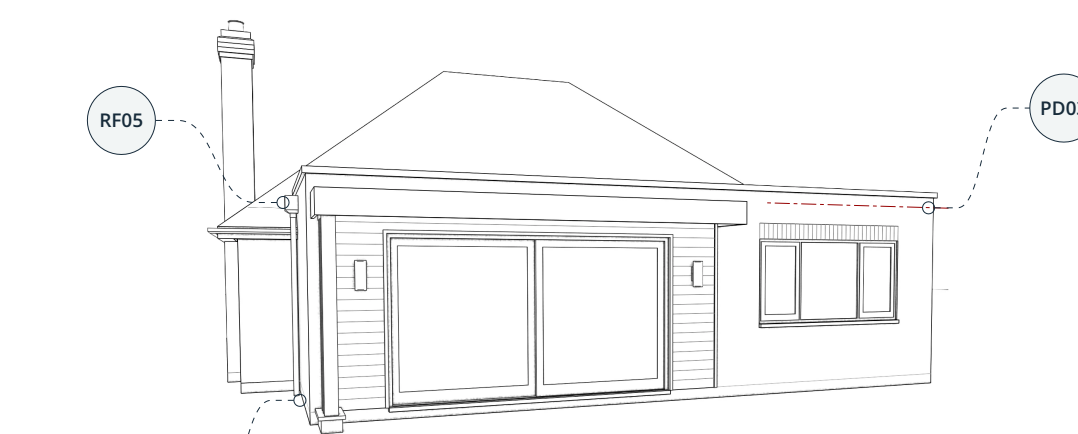

DESIGN PROPOSAL 3D VISUALS

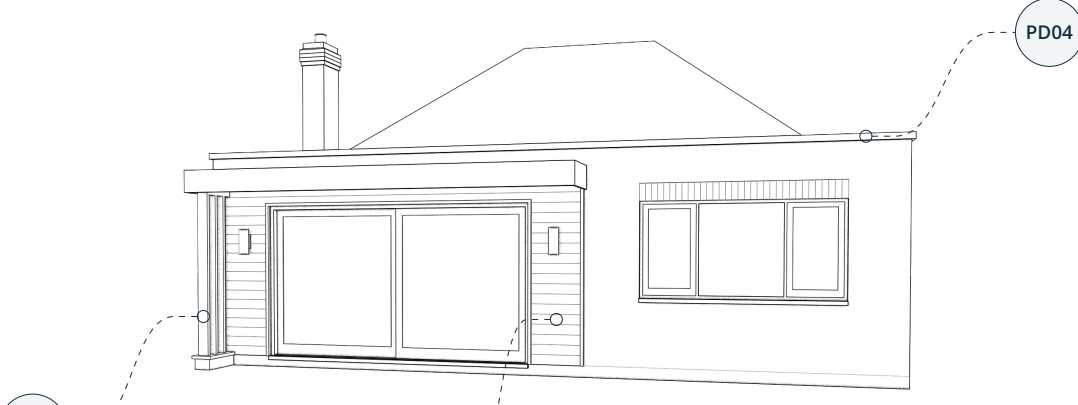

3D VISUALS & PROPOSAL NOTES

- EX01 | Existing external walls**
Existing house: mixed buff facing brickwork above a blue engineering-brick plinth to DPC level. Retain outside the indicated alterations; make good disturbed areas with matching bricks and mortar. Confirm brick types and DPC level on site.
- EX02 | Existing pitched roof**
Existing brown small-format tiles to pitched roof; clay or concrete composition to be confirmed on site. Retain roof covering outside the works. Match replacement tiles where disturbed and weather extension abutments without obstructing existing roof ventilation.
- EX03 | Existing windows and doors**
Existing windows and external doors comprise mixed white and brown frames, including uPVC, with varied glazing patterns. Retain except where removal or replacement is indicated. Confirm frame materials, opening arrangements and finishes on site.
- EX04 | Existing WC flat roof**
Existing felt-covered flat roof over the WC is reported to be at the end of its service life. Remove with the WC structure; inspect and make good retained abutments. Do not incorporate the existing covering into the new roof.
- EX05 | Conservatory and WC removal**
Remove existing conservatory and adjoining flat-roof WC, approximately 3,100 mm projection x 4,350 mm overall width. Isolate services and seal redundant drain connections. Protect retained walls and roof; make good exposed junctions. Confirm demolition extent and any retained foundations on site.
- WF03 | Horizontal composite cladding**
Horizontal composite cladding to the rear canopy surround as indicated. Manufacturer, profile and colour to be agreed from samples. Provide compatible support battens, drained and ventilated cavity, trims and movement allowances.
- PD01 | Rear extension projection**
Single-storey rear extension with an enclosed projection of 3,150 mm from the rear wall of the house. This dimension describes the enclosed accommodation; the external canopy is shown separately.
- PD03 | Flat-roof eaves measurement**
Finished roof surface: 2,650 mm above GFFL; 2,800 mm above proposed terrace. Eaves measured at the upper roof surface where it meets the external wall; parapet excluded. Reference: GOV.UK, Permitted development rights for householders: technical guidance (September 2019), Class A, paragraph A.1(d). Planning ground datum: PD05; existing-house eaves limit also applies.
- PD04 | Parapet coping level**
Parapet coping: 3,000 mm above proposed terrace, equivalent to 2,850 mm above GFFL. Coping is included in overall extension height, not eaves height. Terrace-relative dimensions are distinct from planning heights; use the ground datum described in PD05.
- RF01 | Warm flat roof**
Warm-roof construction behind a parapet, with insulation above the structural deck and a continuous vapour control layer below the insulation. Coordinate thermal performance, condensation control, waterproofing and abutments in the construction details. Form falls to outlets within the stated height envelope.
- RF03 | Flat rooflights**
Three flat rooflights, nominally 1,500 x 1,000 mm each: two over the dining/occasional seating area and one over the bedroom. Confirm whether dimensions refer to the opening or overall unit before ordering. Provide insulated upstands at least 150 mm above the adjacent finished roof surface.
- RF04 | Rooflight pitch and height**
Install rooflights at the manufacturer's required pitch; 5 degrees is indicative. Keep frames and glazing below the coping. The indicated roof-to-coping allowance is 200 mm: coordinate the minimum 150 mm upstand, frame depth and pitch within this envelope. Revise the roof detail if necessary; do not reduce the minimum upstand.
- RF05 | Rainwater drainage**
Form positive falls to sized roof outlets and rainwater pipes. Provide accessible outlets and an emergency overflow to the parapet-enclosed roof. Confirm discharge route and capacity before construction; keep all roof drainage within the site and clear of door thresholds.
- PR01 | Entrance canopy**
Flat-roof canopy outside the sliding doors; top 2,710 mm above proposed terrace (2,560 mm above GFFL). Provide weatherproof covering, falls, edge trims and drainage clear of the entrance. Structural support and cantilever to SN03; terrace and threshold levels to PR03.
- PR02 | Vertical metal screen**
Open screen of vertical powder-coated metal slats to one side of the canopy; metal type, section, spacing and colour to be agreed. Fix to a corrosion-protected supporting frame. Retain open gaps between slats. Canopy loads to be carried by the engineer-designed structure, not decorative infill.
- GN01 | Drawing scope**
Drawings describe the proposed development for planning assessment. They are not construction drawings or a complete Building Regulations specification. Obtain coordinated construction details, structural calculations and Building Control approval before relevant work starts. Refer discrepancies to Noble Architecture before proceeding.
- GN02 | Survey and dimensions**
Prepared from client-supplied photographs and measurements; Noble Architecture has not undertaken a measured site survey. Verify dimensions, levels, boundaries and existing construction on site before design, ordering or setting out. Use stated dimensions; do not scale for construction. Report discrepancies before work proceeds.