




(a) SBP (mmHg)
Accuracy = 91.0%, MAE = 13.18

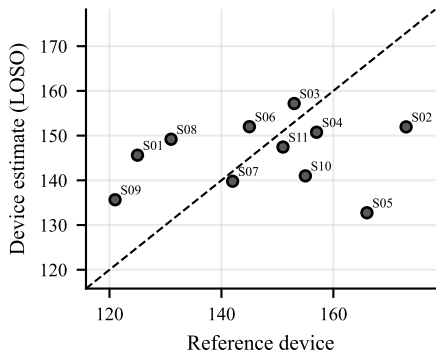


(b) DBP (mmHg)
Accuracy = 91.4%, MAE = 6.09

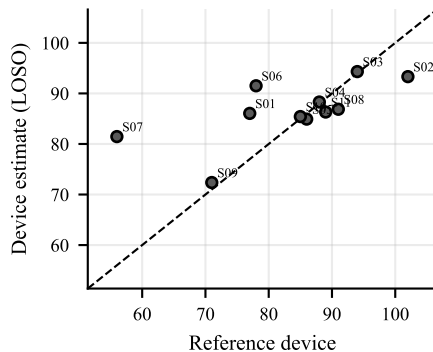


(c) Glucose (mg/dL)
Accuracy = 76.2%, MAE = 29.36

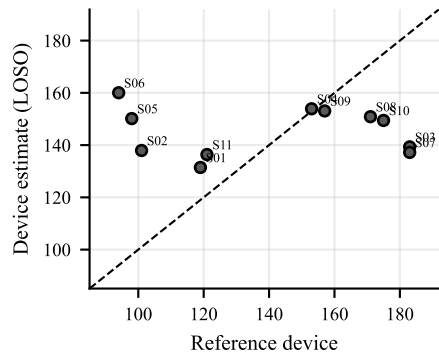

(d) Cholesterol (mg/dL)
Accuracy = 85.1%, MAE = 30.44

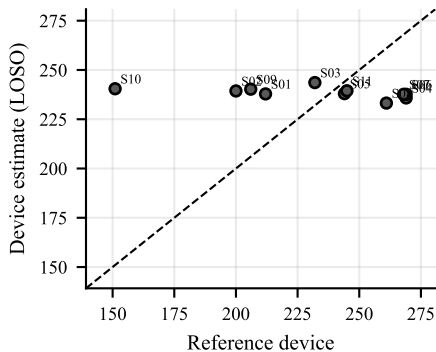

(e) Uric acid (mg/dL)
Accuracy = 86.2%, MAE = 0.75

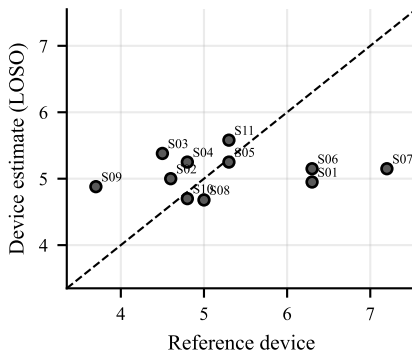

(f) LOSO accuracy per parameter

