

Harmonic Hunter

Power Quality Risk Report

Facility: Adyaan

Mode: Trend Risk Mode (Log Cadence)Generated: 2026-01-13 18:16

37

/100

Monitor

Executive verdict

Early warning indicators detected. Continued monitoring is recommended to prevent escalation during peak demand or future expansion.

Key observations

- Phase A: High variability → harmonic risk signature


Why you're seeing this result

- Observed current behavior reflects non-linear electrical loading patterns.
- Phase-level variability suggests uneven load distribution across monitored circuits.


Recommended next steps

- Priority: Current variability indicates pulsed load behavior; schedule a power quality capture (true waveform) during peak load.
- No urgent mitigation required based on trend indicators; continue periodic monitoring.

Phase A — Current vs Time

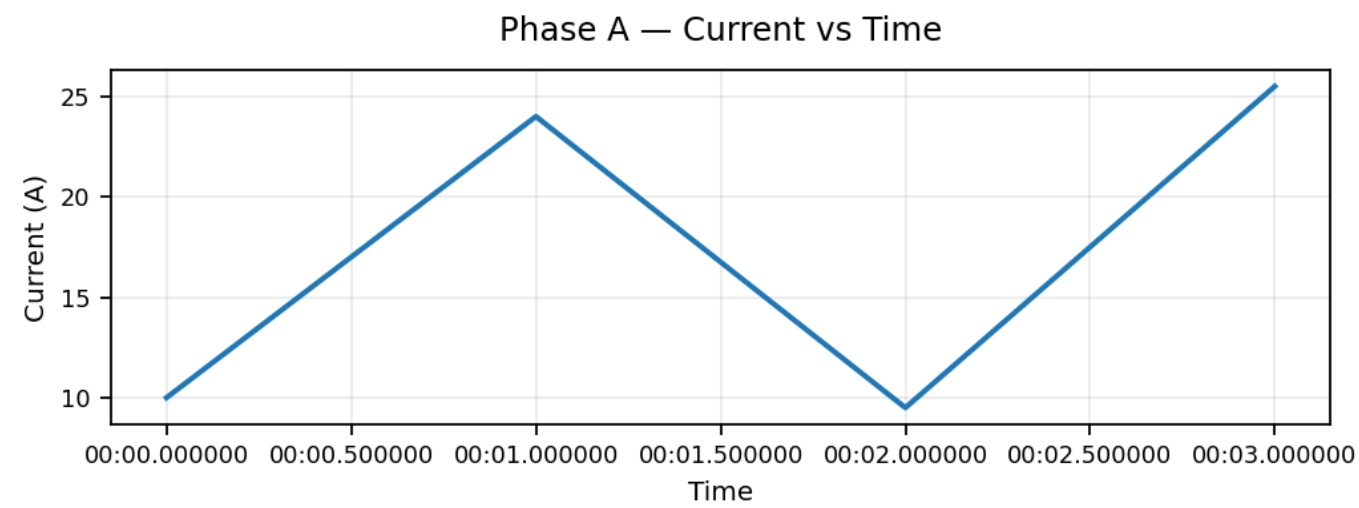

Phase B — Current vs Time

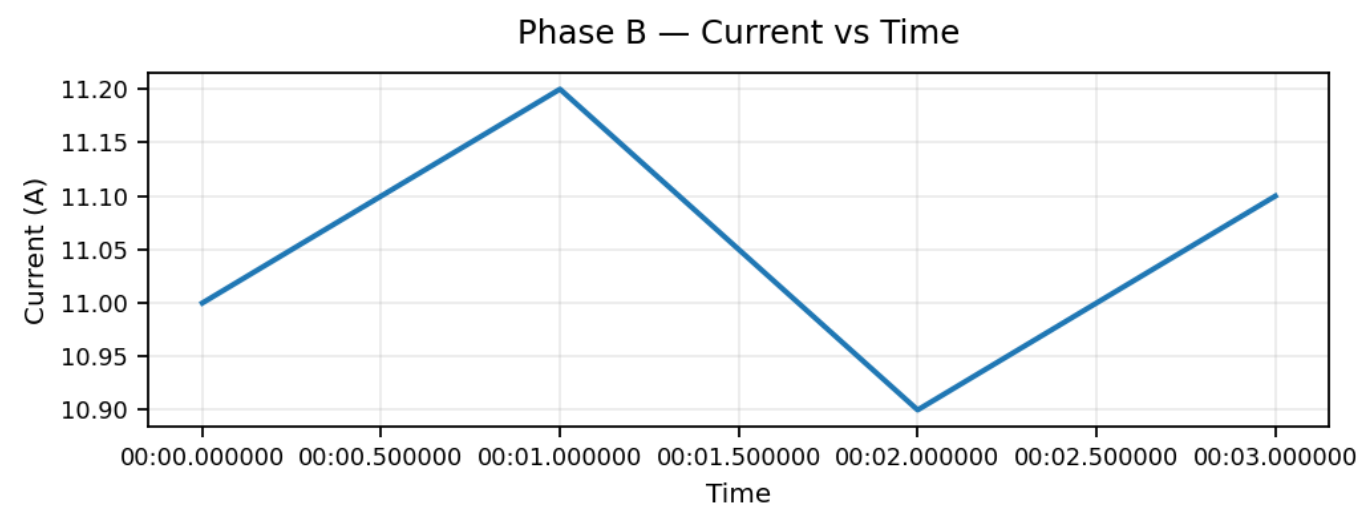

Phase C — Current vs Time

