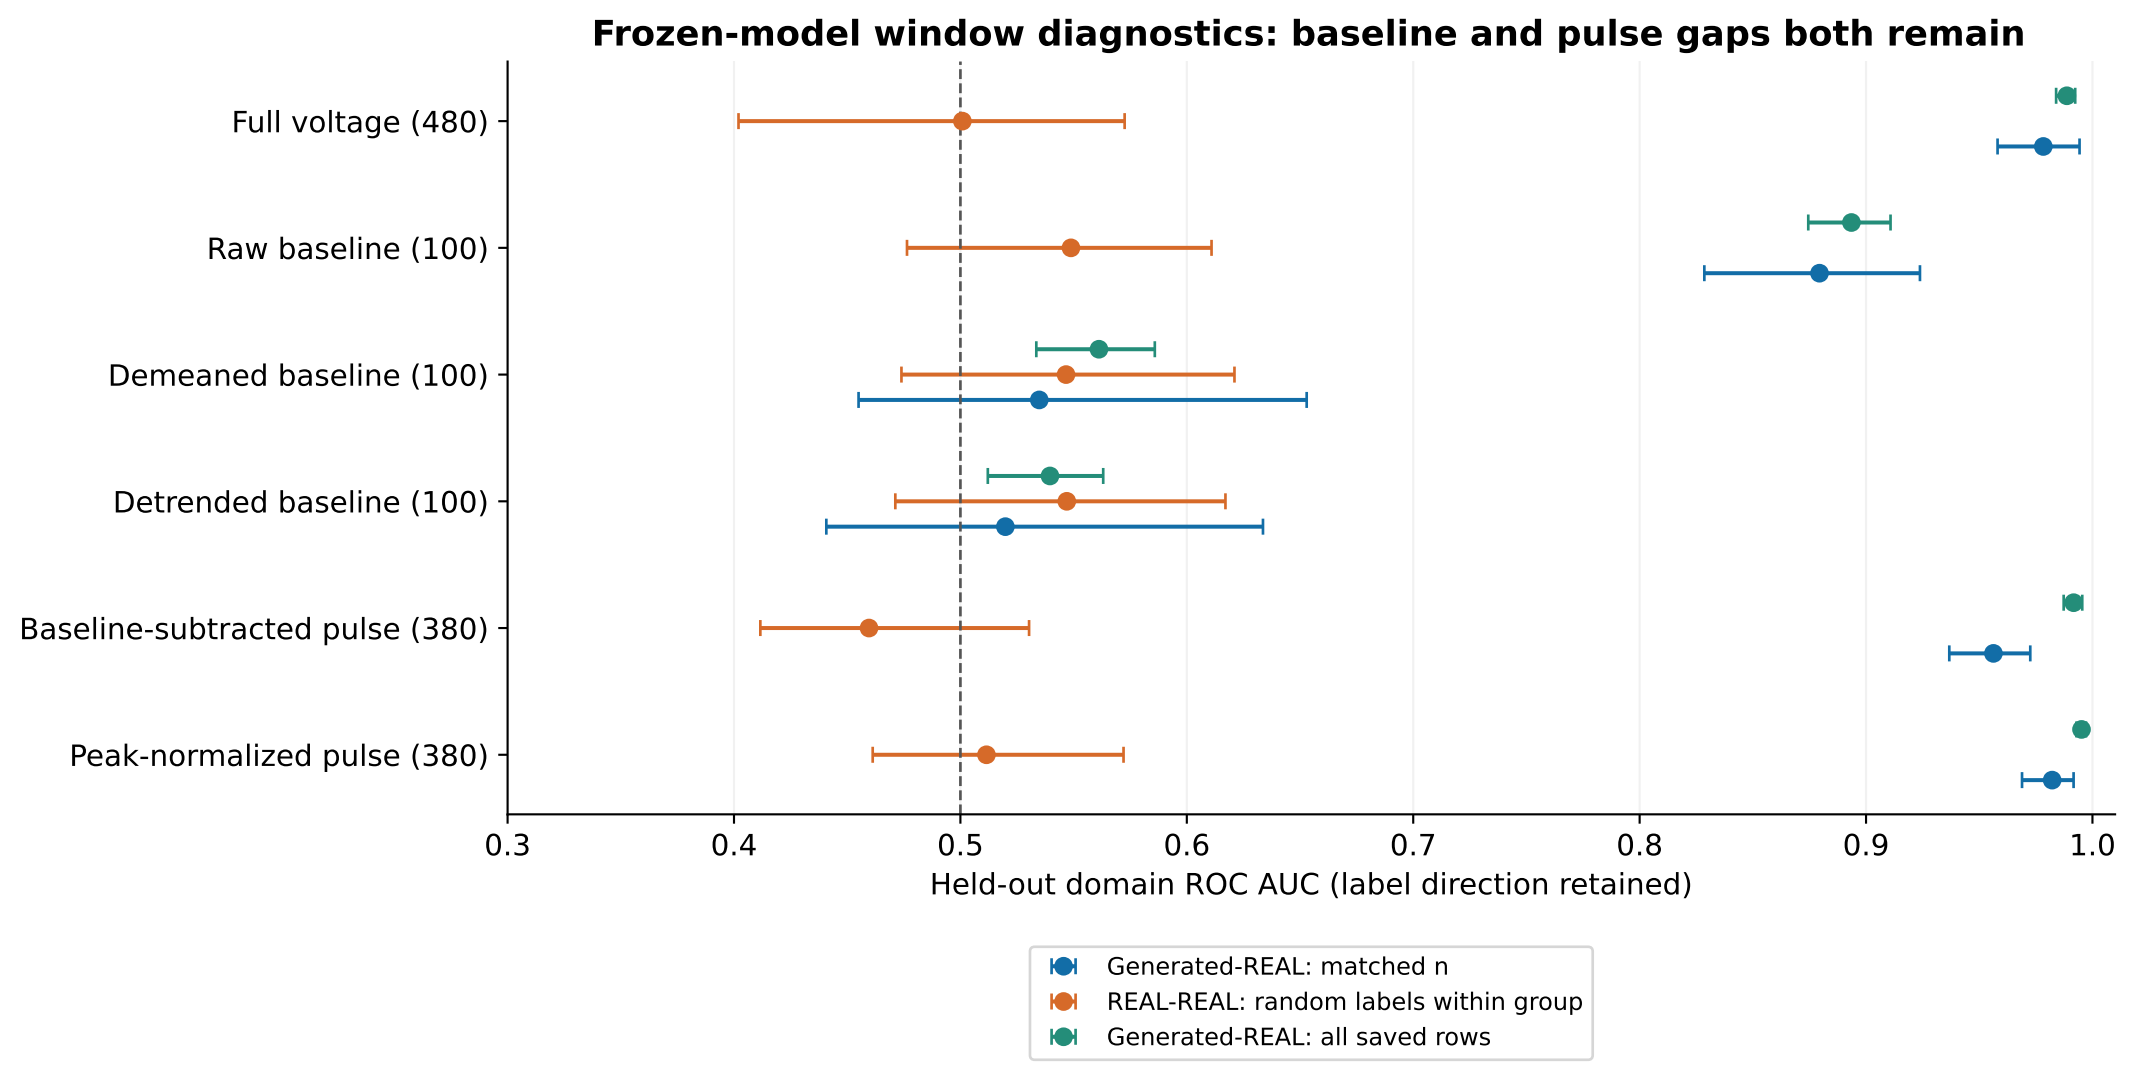
Frozen-model window diagnostics: baseline and pulse gaps both remain
Full voltage (480)
Raw baseline (100)
Demeaned baseline (100)
Detrended baseline (100)
Baseline-subtracted pulse (380)
Peak-normalized pulse (380)
0.3
0.4
0.5
0.6
0.7
0.8
0.9
1.0
Held-out domain ROC AUC (label direction retained)
Generated-REAL: matched n
REAL-REAL: random labels within group
Generated-REAL: all saved rows