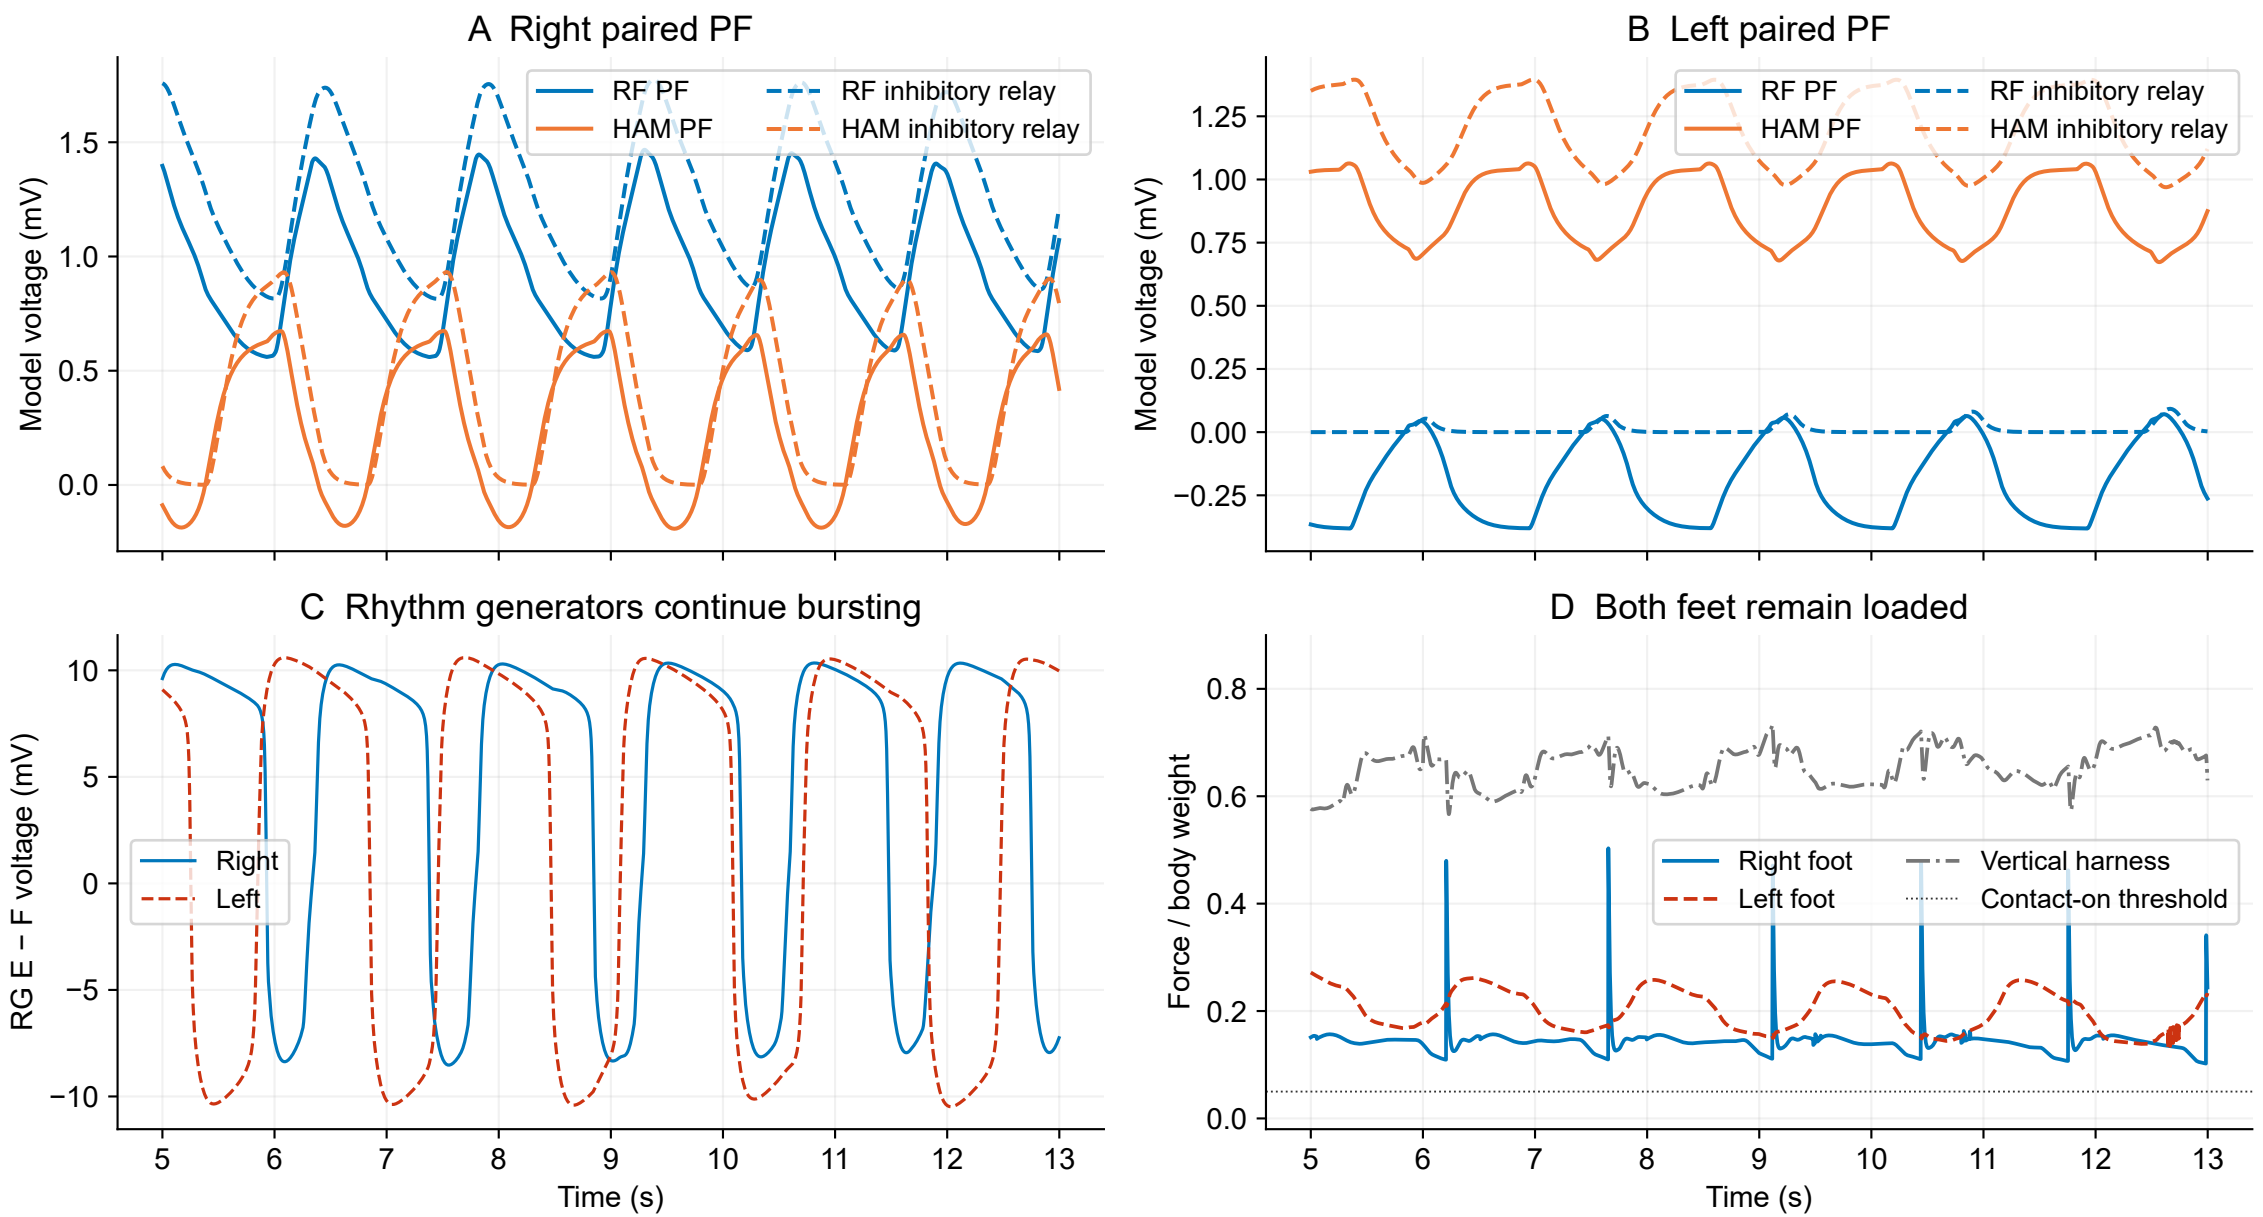

Four-cell RF/hamstring PF: grounded diagnostic, not successful walking
A Right paired PF
RF PF
HAM PF
RF inhibitory relay
HAM inhibitory relay
Model voltage (mV)
B Left paired PF
C Rhythm generators continue bursting
Right
Left
RG E − F voltage (mV)
Time (s)
D Both feet remain loaded
Right foot
Left foot
Vertical harness
Contact-on threshold
Force / body weight
Time (s)