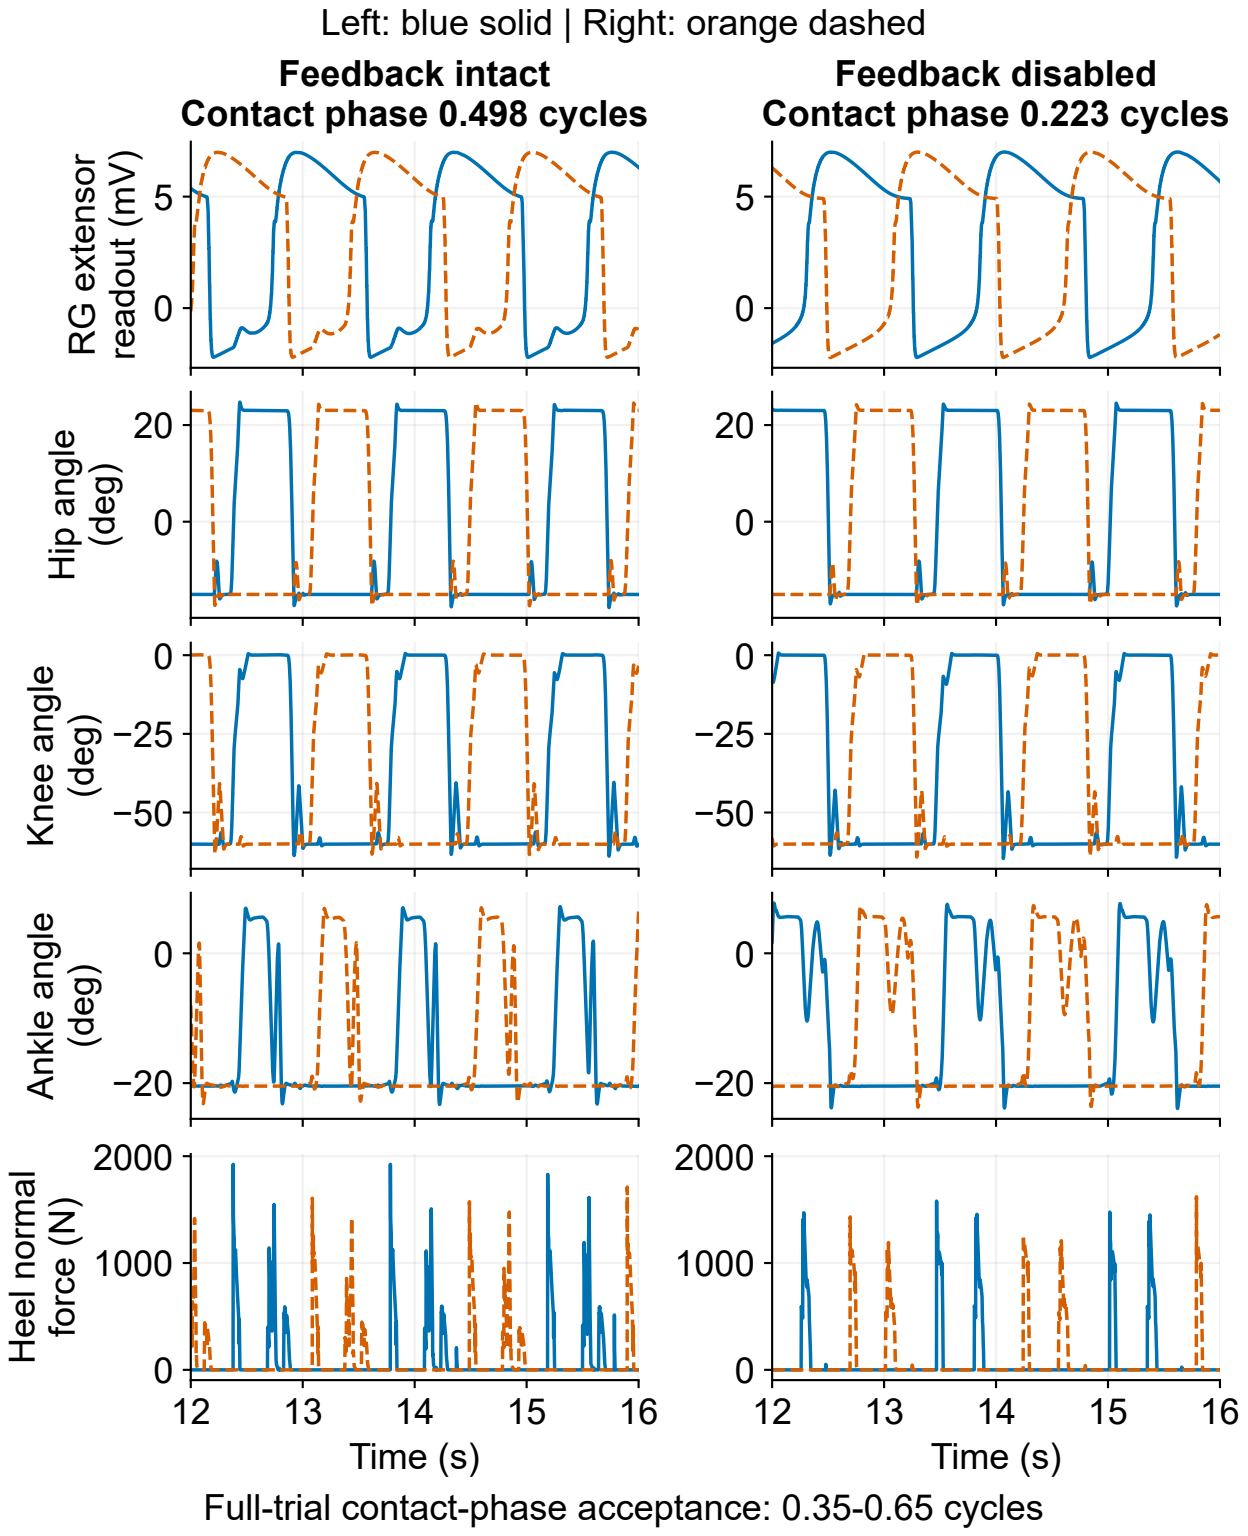

Left: blue solid | Right: orange dashed
Feedback intact
Contact phase 0.498 cycles
Feedback disabled
Contact phase 0.223 cycles
RG extensor readout (mV)
Hip angle (deg)
Knee angle (deg)
Ankle angle (deg)
Heel normal force (N)
Time (s)
Time (s)
Full-trial contact-phase acceptance: 0.35-0.65 cycles