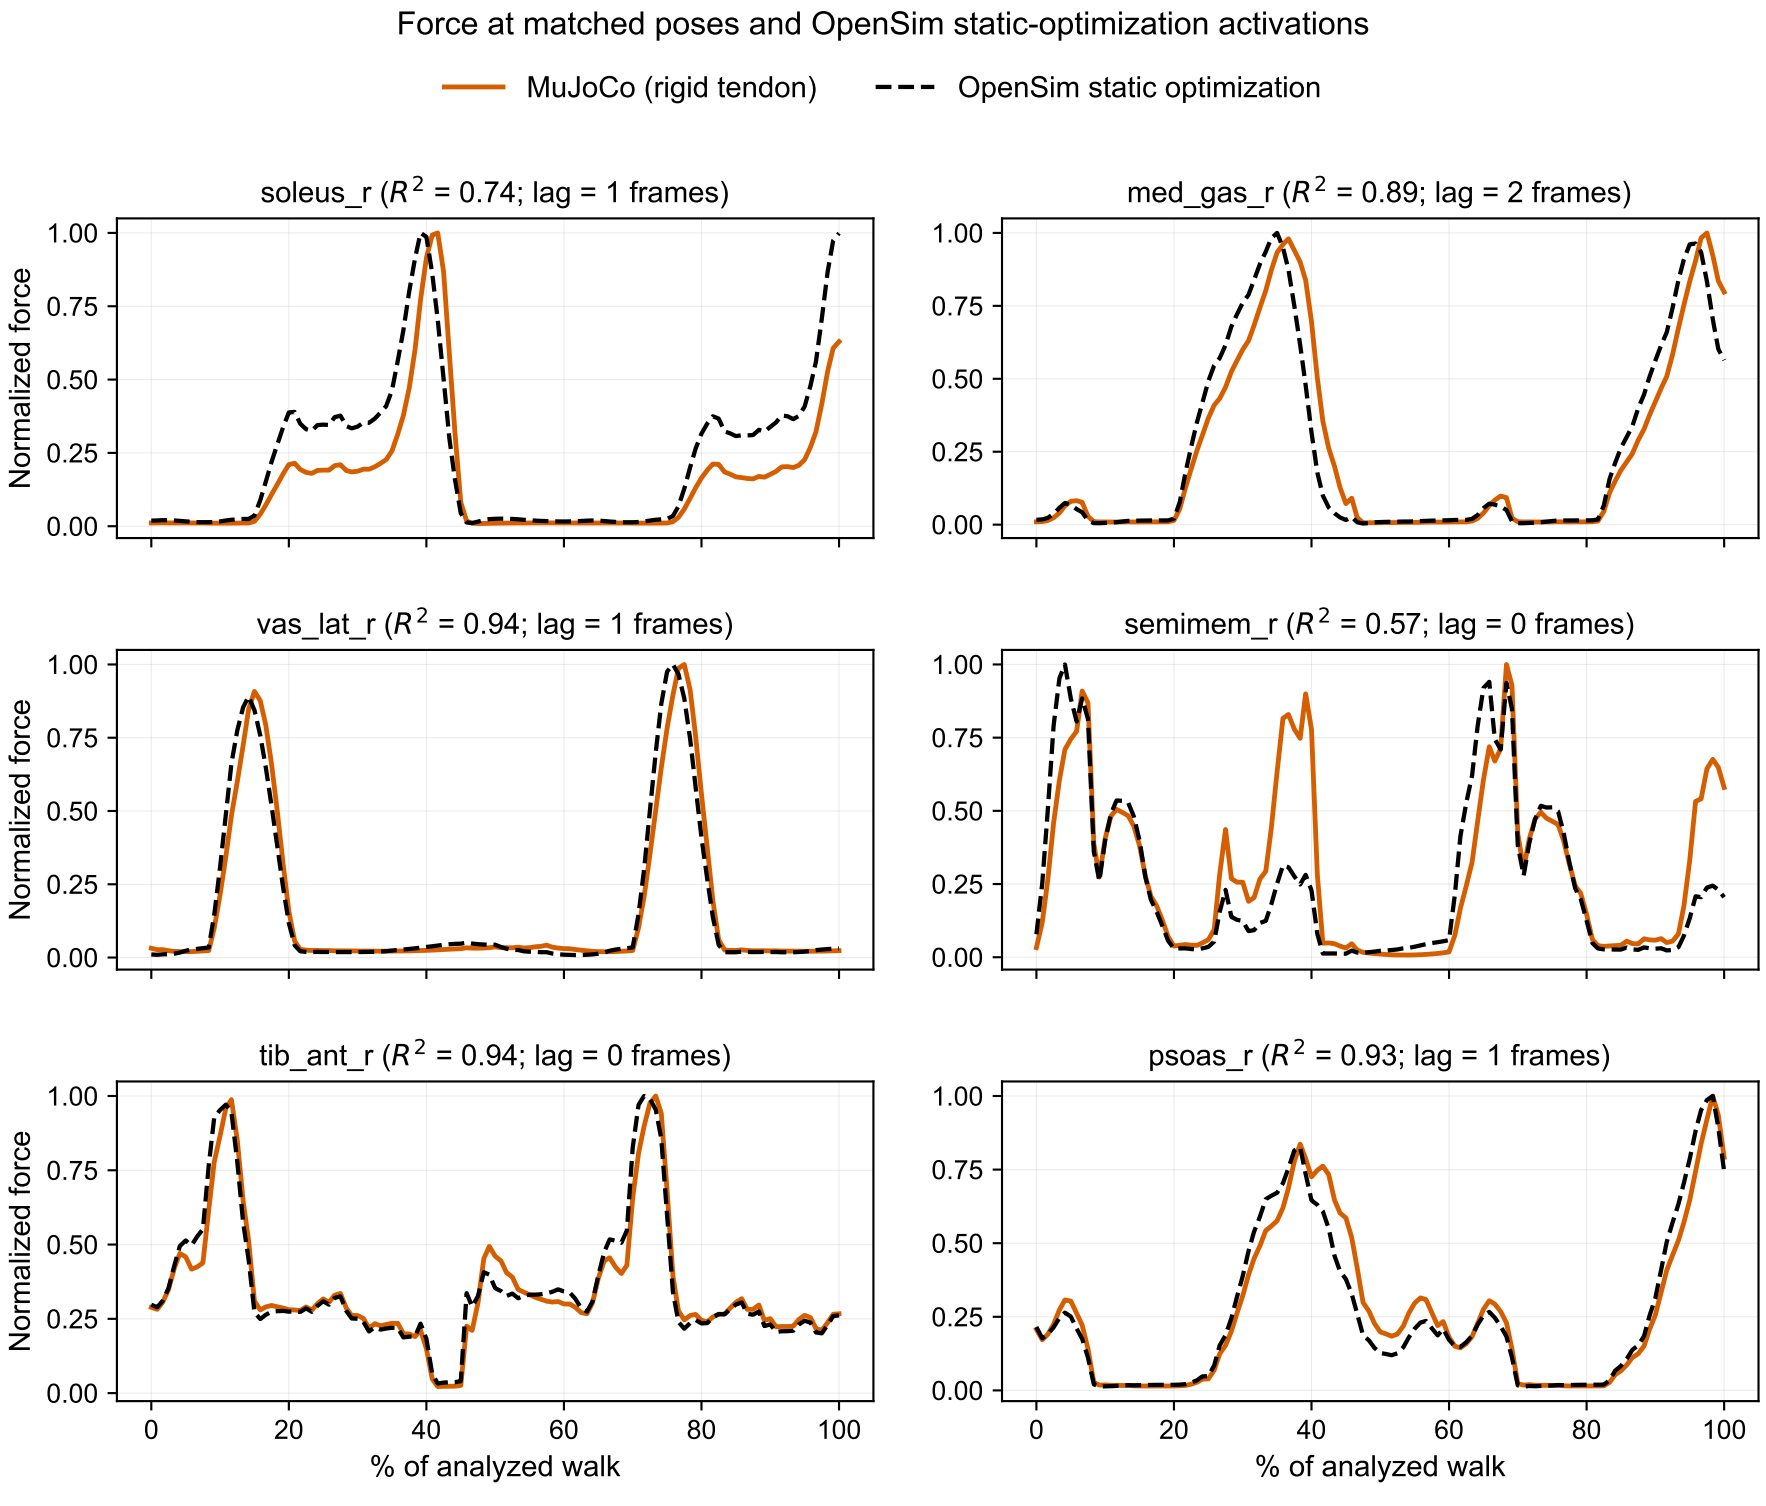
Force at matched poses and OpenSim static-optimization activations
MuJoCo (rigid tendon)
OpenSim static optimization
soleus_r (R^2 = 0.74; lag = 1 frames)
med_gas_r (R^2 = 0.89; lag = 2 frames)
vas_lat_r (R^2 = 0.94; lag = 1 frames)
semimem_r (R^2 = 0.57; lag = 0 frames)
tib_ant_r (R^2 = 0.94; lag = 0 frames)
psoas_r (R^2 = 0.93; lag = 1 frames)
Normalized force
0.00
0.25
0.50
0.75
1.00
0
20
40
60
80
100
% of analyzed walk