


Models` differences on the training set

LM – PLS

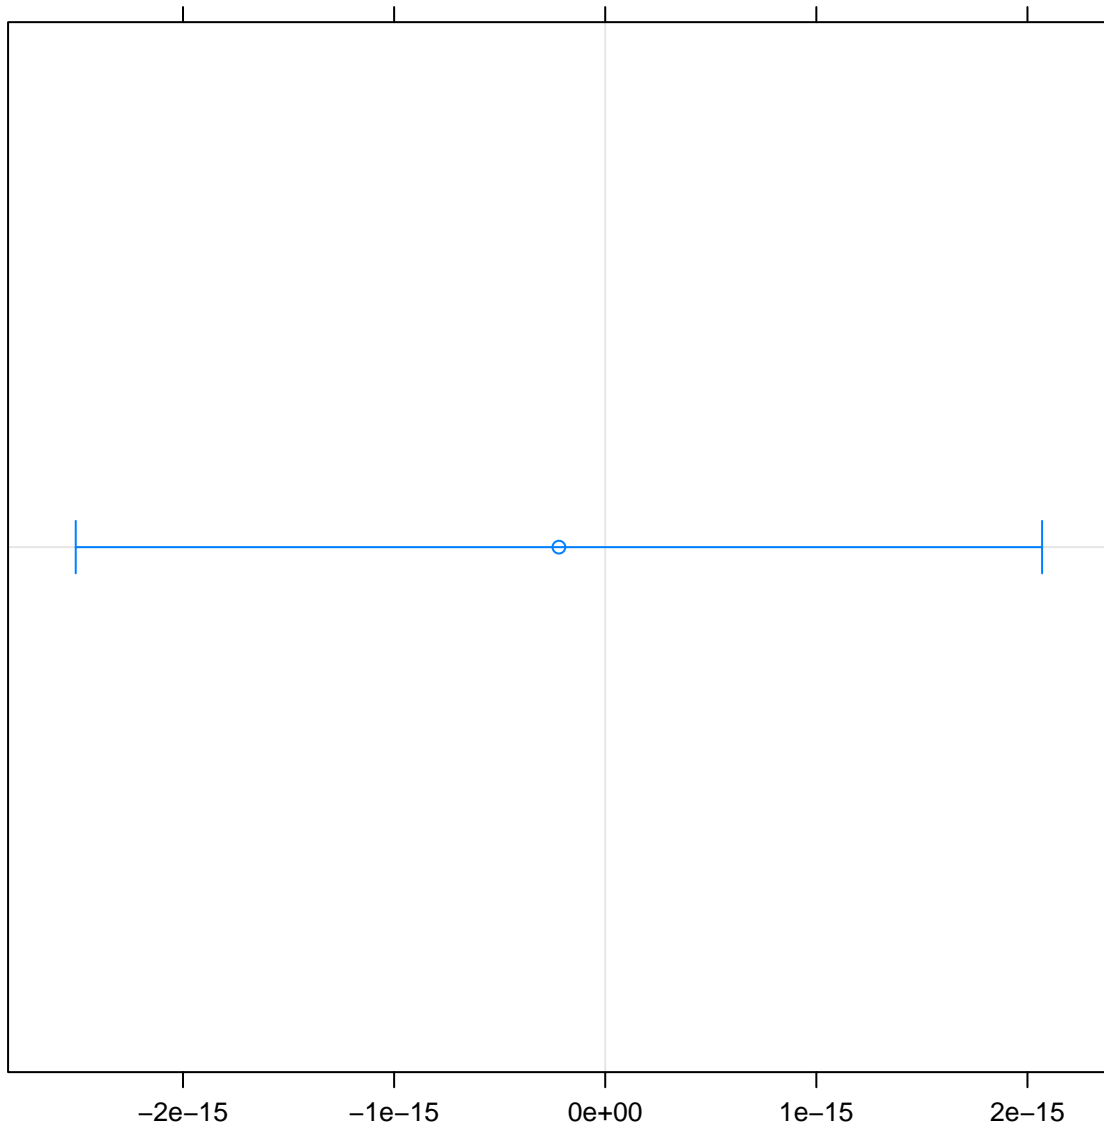

Difference in RMSE
Confidence Level 0.95 (multiplicity adjusted)