


LM - PLS

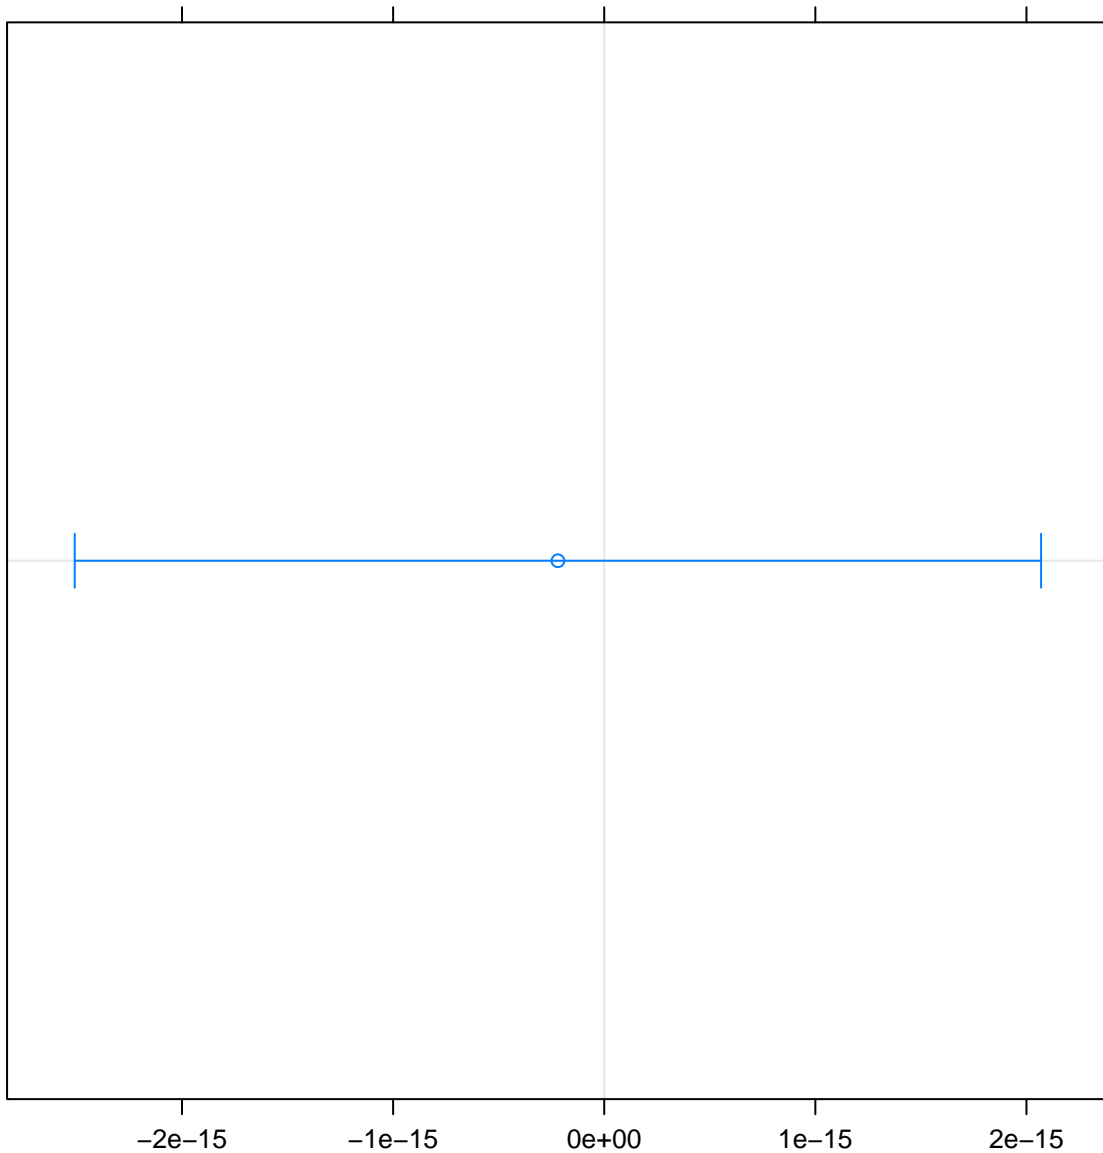

Difference in RMSE  
Confidence Level 0.95 (multiplicity adjusted)