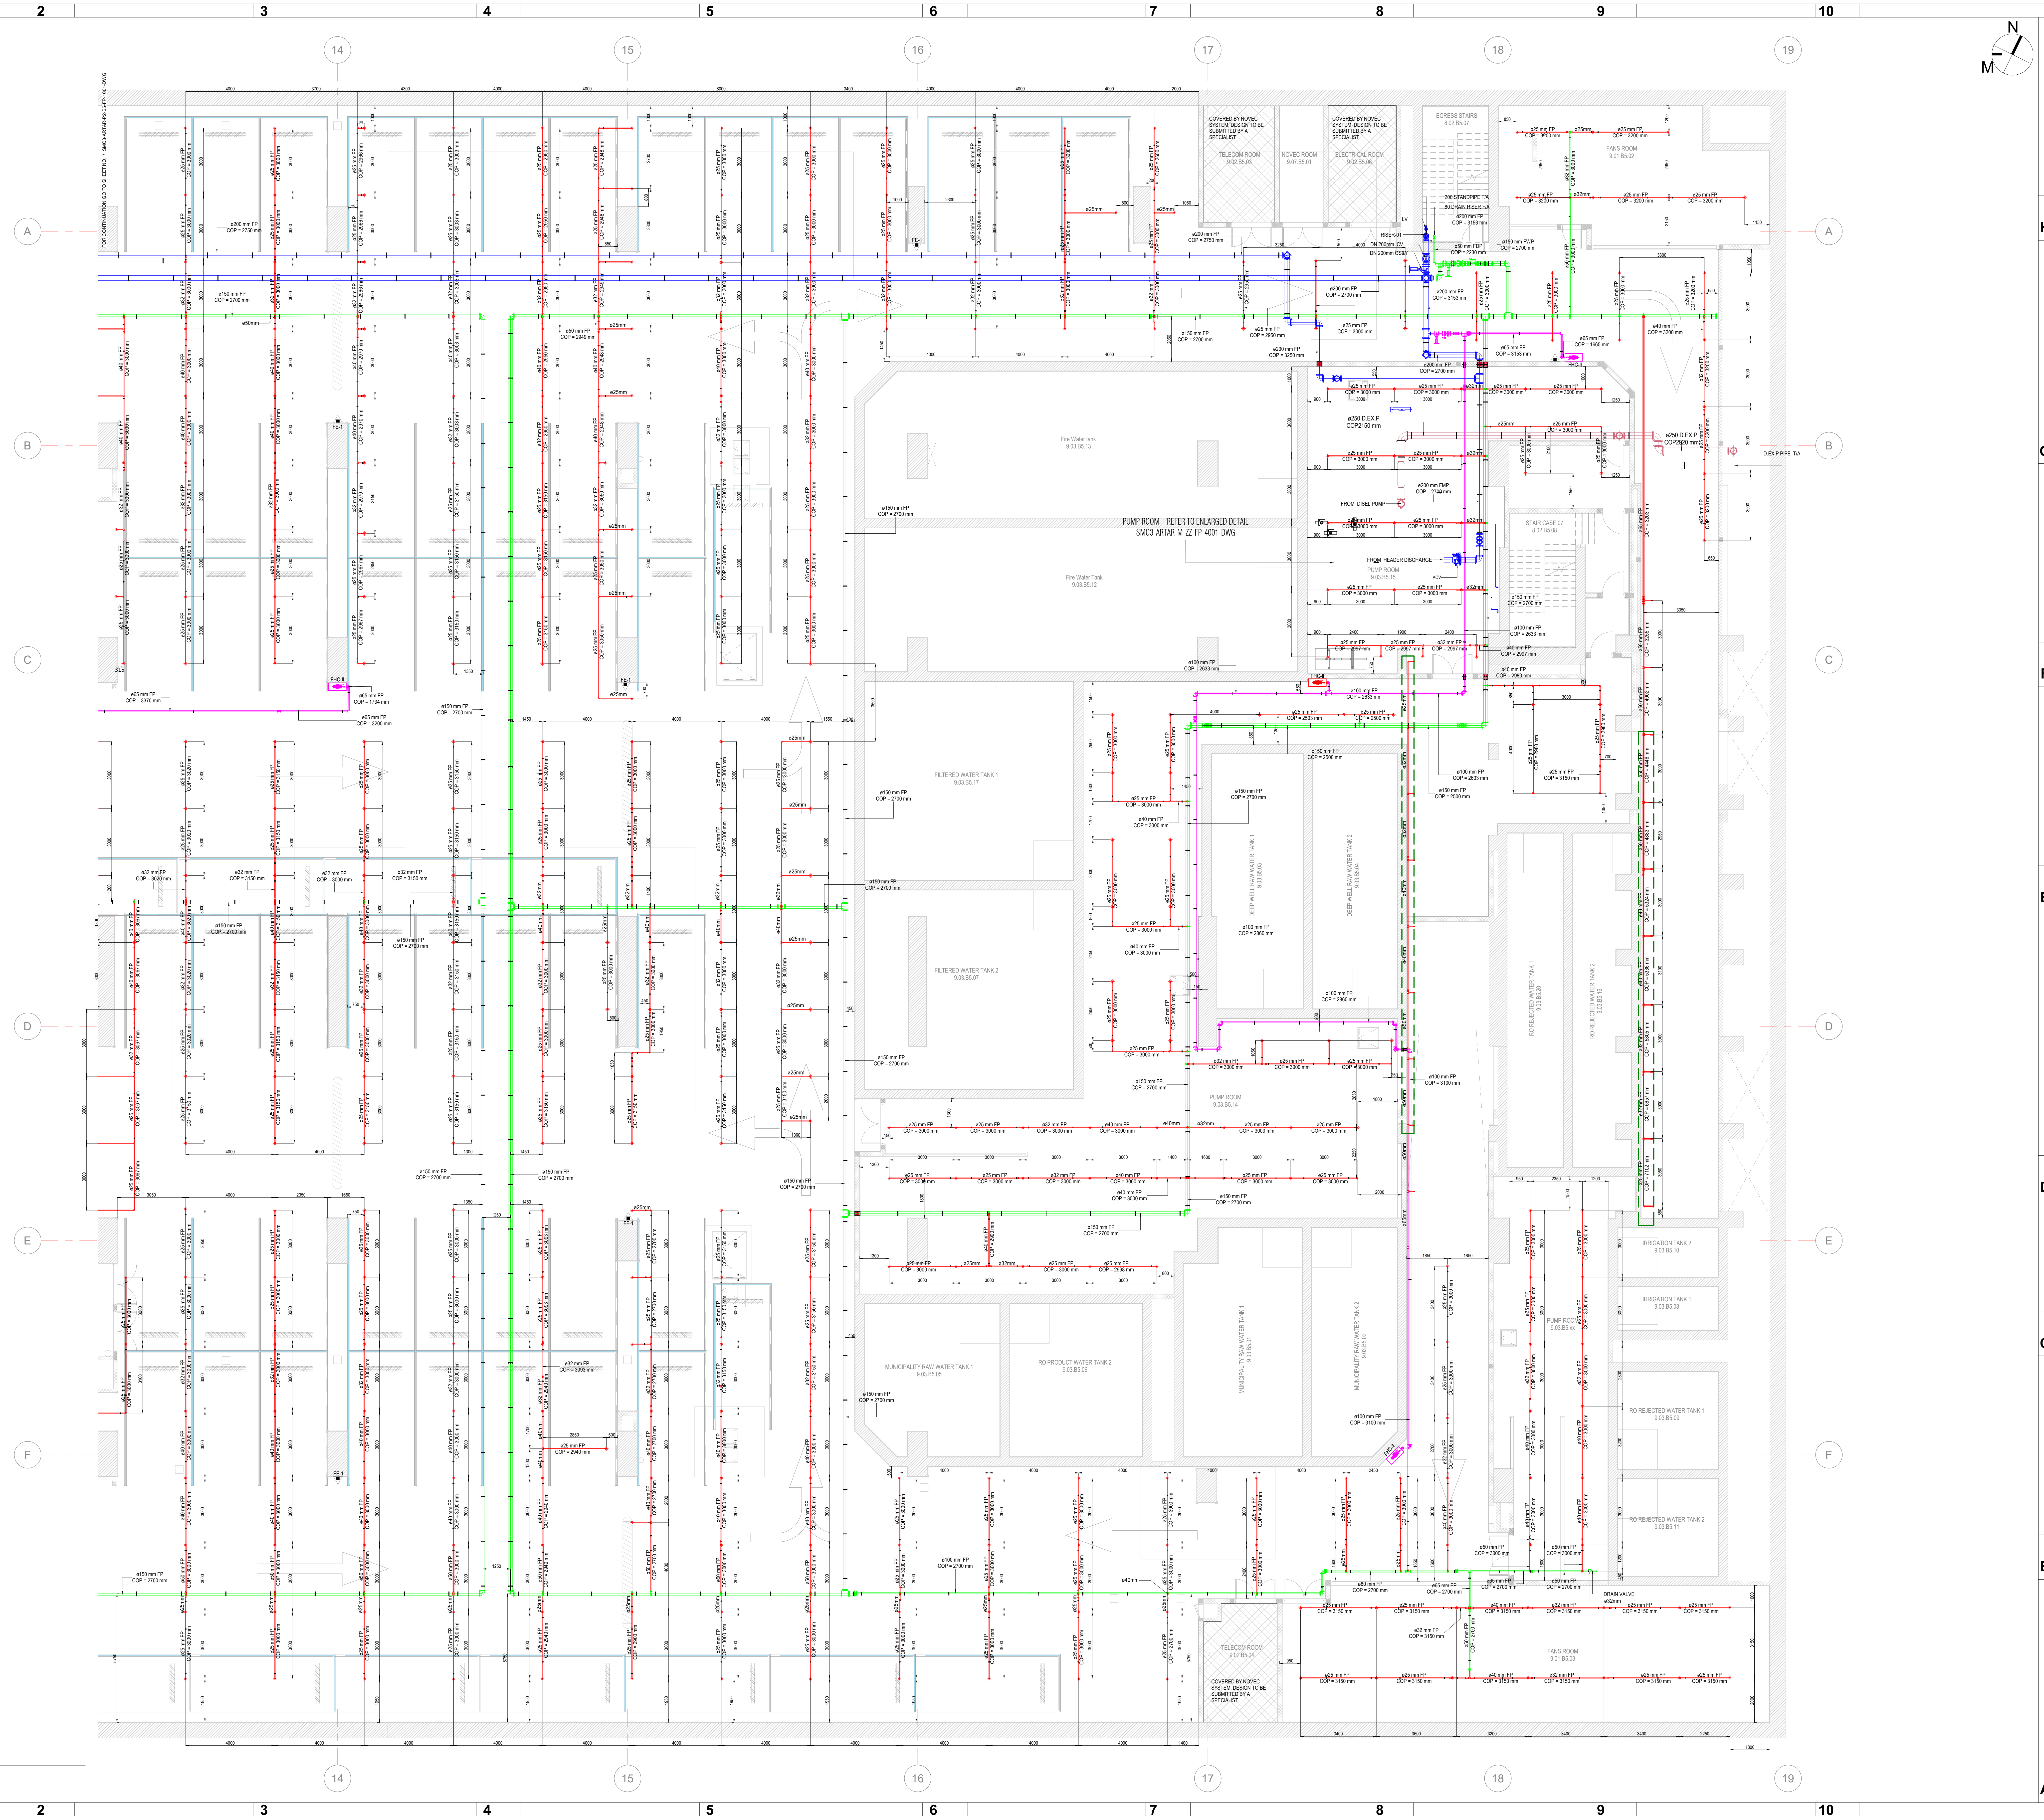
N
M
PUMP ROOM – REFER TO ENLARGED DETAIL
SMC3-ARTAR-M-ZZ-FP-4001-DWG
Fire Water tank
Filtered Water Tank 1
Filtered Water Tank 2
Deep Well Raw Water Tank 1
Deep Well Raw Water Tank 2
RO Rejected Water Tank 1
RO Rejected Water Tank 2
Irrigation Tank 1
Irrigation Tank 2
Municipality Raw Water Tank 1
Municipality Raw Water Tank 2
RO Product Water Tank 2
Pump Room
Telecom Room
Novec Room
Electrical Room
Fans Room
Egress Stairs
Stair Case 07
COVERED BY NOVEC SYSTEM, DESIGN TO BE SUBMITTED BY A SPECIALIST
D.EX.P PIPE T/A
ø250 D.EX.P
FROM DISEL PUMP
FROM HEADER DISCHARGE
FHC-II
FE-1
14
15
16
17
18
19
A
B
C
D
E
F

BASEMENT 05 PART 3

B05P03

1 : 100

Sheet size - ISO A0 (841x1189 mm)

0
50mm
100mm

CLIENT

smc Hospital مستشفى

PROJECT CONSULTANT

المركز المعماري
ARCH.CENTRE
CONSULTING ENGINEERS استشارات هندسية
SINCE 1977

الراشد العقارية
ALRASHID PROPERTIES

MAAP
Website:www.maapeg.com
Info@maapeg.com
Mobile: +201100607556
Landline: +20225657001
Address: St.17, New Cairo, Cairo, Egypt

KEY PLAN

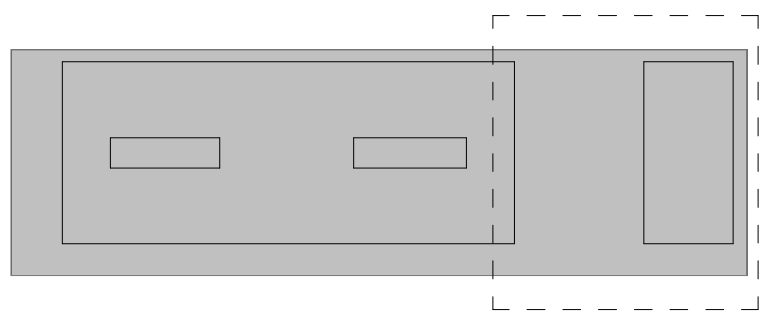

GENERAL NOTES

1. ALL DIMENALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
2. ALL MATERIAL ARE ACCORDING TO APPROVED MATERIAL SUBMITTAL.
3. ALL PIPE DIAMETERS ARE NOMINAL DIAMETER.
4. FITTINGS SHALL BE THREADED FOR PIPE SIZES EQUAL OR LESS THAN 50MM.
5. FITTINGS SHALL BE GROOVED FOR PIPE SIZES EQUAL OR MORE THAN 65MM.
6. EXTENDED COVERAGE SIDE WALL SPRINKLER DISTANCE AS PER MATERIAL SUBMITTAL & HYDRAULIC CALCULATION.
7. ORDINARY HAZARD WITH 1500FT² OPERATION AREA, 0.15 GPM/FT² DENSITY.

FIRE FIGHTING LEGEND

🟥	BLACK STEEL SCHEDULE 40 FIRE PIPE
⌖	UPRIGHT SPRINKLER
●	CONCEALED SPRINKLER
+	PENDENT SPRINKLER
•	SIDE WALL SPRINKLER
▭	FHC -II
▭	FE-1
○	NOVEC CYLINDER
▪	WATER FLOW SWITCH
▪	DRAIN VALVE
▪	Pressure Regulating Valve
▪	PRESSURE INDICATOR
▪	OS&Y
▪	CHECK VALVE
▪	LANDING VALVE
DV	DELUGE VALVE
FS	WATER FLOW SWITCH
CV	CHECK VALVE
LV	LANDING VALVE
FDP	FIRE DRAIN PIPE
FWP	FIRE WET PIPE
FHCP	FIRE HOSE CABINET PIPE
FWR	FIRE WET RISER
FDR	FIRE DRAIN RISER
D.EX.P	Diesel exhaust pipes
COP	CENTER OF PIPE
BOP	BOTTOM OF PIPE
F/B	FROM BELOW.
T/B	TO BELOW.
T/A	TO ABOVE
F/A	FROM ABOVE

ARTAR COORDINATION

CHECKED	NAME	SIGNATURE	DATE
PRINCIPAL MECHANICAL ENGINEER	Eng.Yaser Al Hafiz		
PRINCIPAL MECHANICAL ENGINEER	Eng.Freas Eloush		
ELECTRO-MECHANICAL MANAGER	Eng.Mamoun Jawad		

MAAP COORDINATION

CHECKED	NAME	SIGNATURE	DATE
OPERATIONAL MANAGER	Eng.Ola Magdy	Ola Magdi	
BIM MANAGER	Eng.Mohammed Hany	Mohammed Hany	
ARCHITECTURAL & ID	Eng.Mohammed Hany	Mohammed Hany	
STRUCTURE	Eng.Mahmoud Mounir		
ELECTRICAL & LC	Eng.Aly AlKazaz	Aly Alkazaz	
MECHANICAL/FF/PL	Eng.Mohammed Kamal	M.kamal	

RELATED DOCUMENTS, LETTERS & RFI'S REFERENCES

NO.	DOC. NO.	DOC. DESCRIPTION	REV	DATE
01	DB142-DAR-TD-B01-DWG-FP-1001M	BASEMENT-05 MASTER PLAN	00	OCT-24
02	DB142-DAR-TD-B01-DWG-FP-1001P1	BASEMENT-05 PARTIAL PLAN-01	00	OCT-24
03	DB142-DAR-TD-B01-DWG-FP-1001P2	BASEMENT-05 PARTIAL PLAN-02	00	OCT-24
04	DB142-DAR-TD-B01-DWG-FP-1001P3	BASEMENT-05 PARTIAL PLAN-03	00	OCT-24
05				
06				
07				
08				
09				
10				
11				

REVISION

REV	DATE	ISSUED FOR	DRW	CHK	PM	BIMM
00	10.2026	SHOPDRAWING	A.SH	A.KH	M.K	1

PROJECT TITLE

SPECIALIZED MEDICAL CENTER - 3 (SMC 3)
AL RIYADH - KSA - AL WADI DISTRICT
B01-MAIN HOSPITAL

DISCIPLINE FIRE PROTECTION

SHEET TYPE 1-FIRE PROTECTION PLANS
BIM DRAWING -LOD 350

SHEET TITLE BASEMENT-05 FIRE PROTECTION PARTIAL PLAN-03

PROJECT NO	BLDG. NO	SHEET NO	SCALE	REV MARK
SMC3	B01	1001	1 : 100	00

DRAWING NO SMC3-ARTAR-P3-B5-FP-1001-DWG