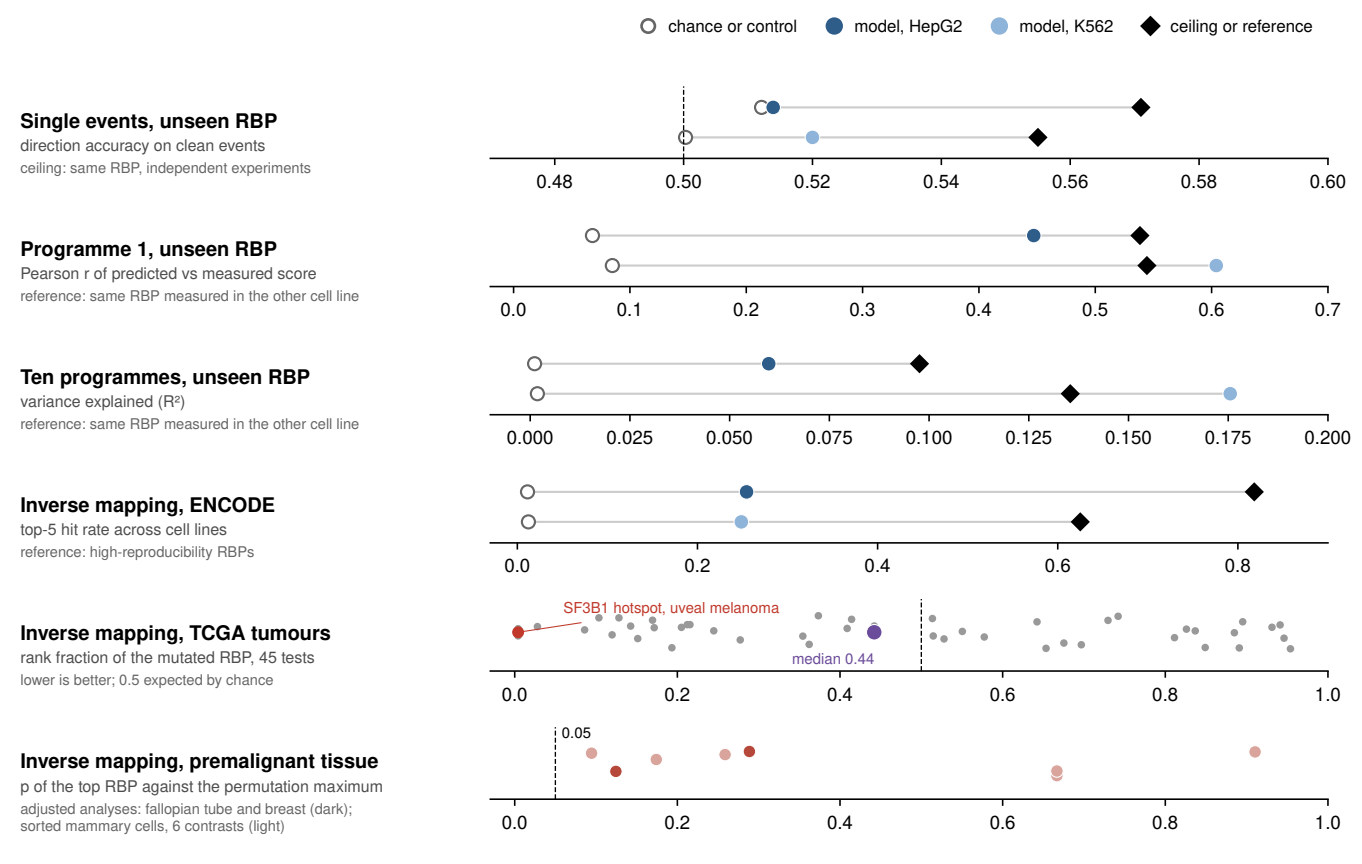
chance or control
model, HepG2
model, K562
ceiling or reference
Single events, unseen RBP
direction accuracy on clean events
ceiling: same RBP, independent experiments
0.48
0.50
0.52
0.54
0.56
0.58
0.60
Programme 1, unseen RBP
Pearson r of predicted vs measured score
reference: same RBP measured in the other cell line
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
Ten programmes, unseen RBP
variance explained (R²)
reference: same RBP measured in the other cell line
0.000
0.025
0.050
0.075
0.100
0.125
0.150
0.175
0.200
Inverse mapping, ENCODE
top-5 hit rate across cell lines
reference: high-reproducibility RBPs
0.0
0.2
0.4
0.6
0.8
Inverse mapping, TCGA tumours
rank fraction of the mutated RBP, 45 tests
lower is better; 0.5 expected by chance
SF3B1 hotspot, uveal melanoma
median 0.44
0.0
0.2
0.4
0.6
0.8
1.0
Inverse mapping, premalignant tissue
p of the top RBP against the permutation maximum
adjusted analyses: fallopian tube and breast (dark);
sorted mammary cells, 6 contrasts (light)
0.05
0.0
0.2
0.4
0.6
0.8
1.0