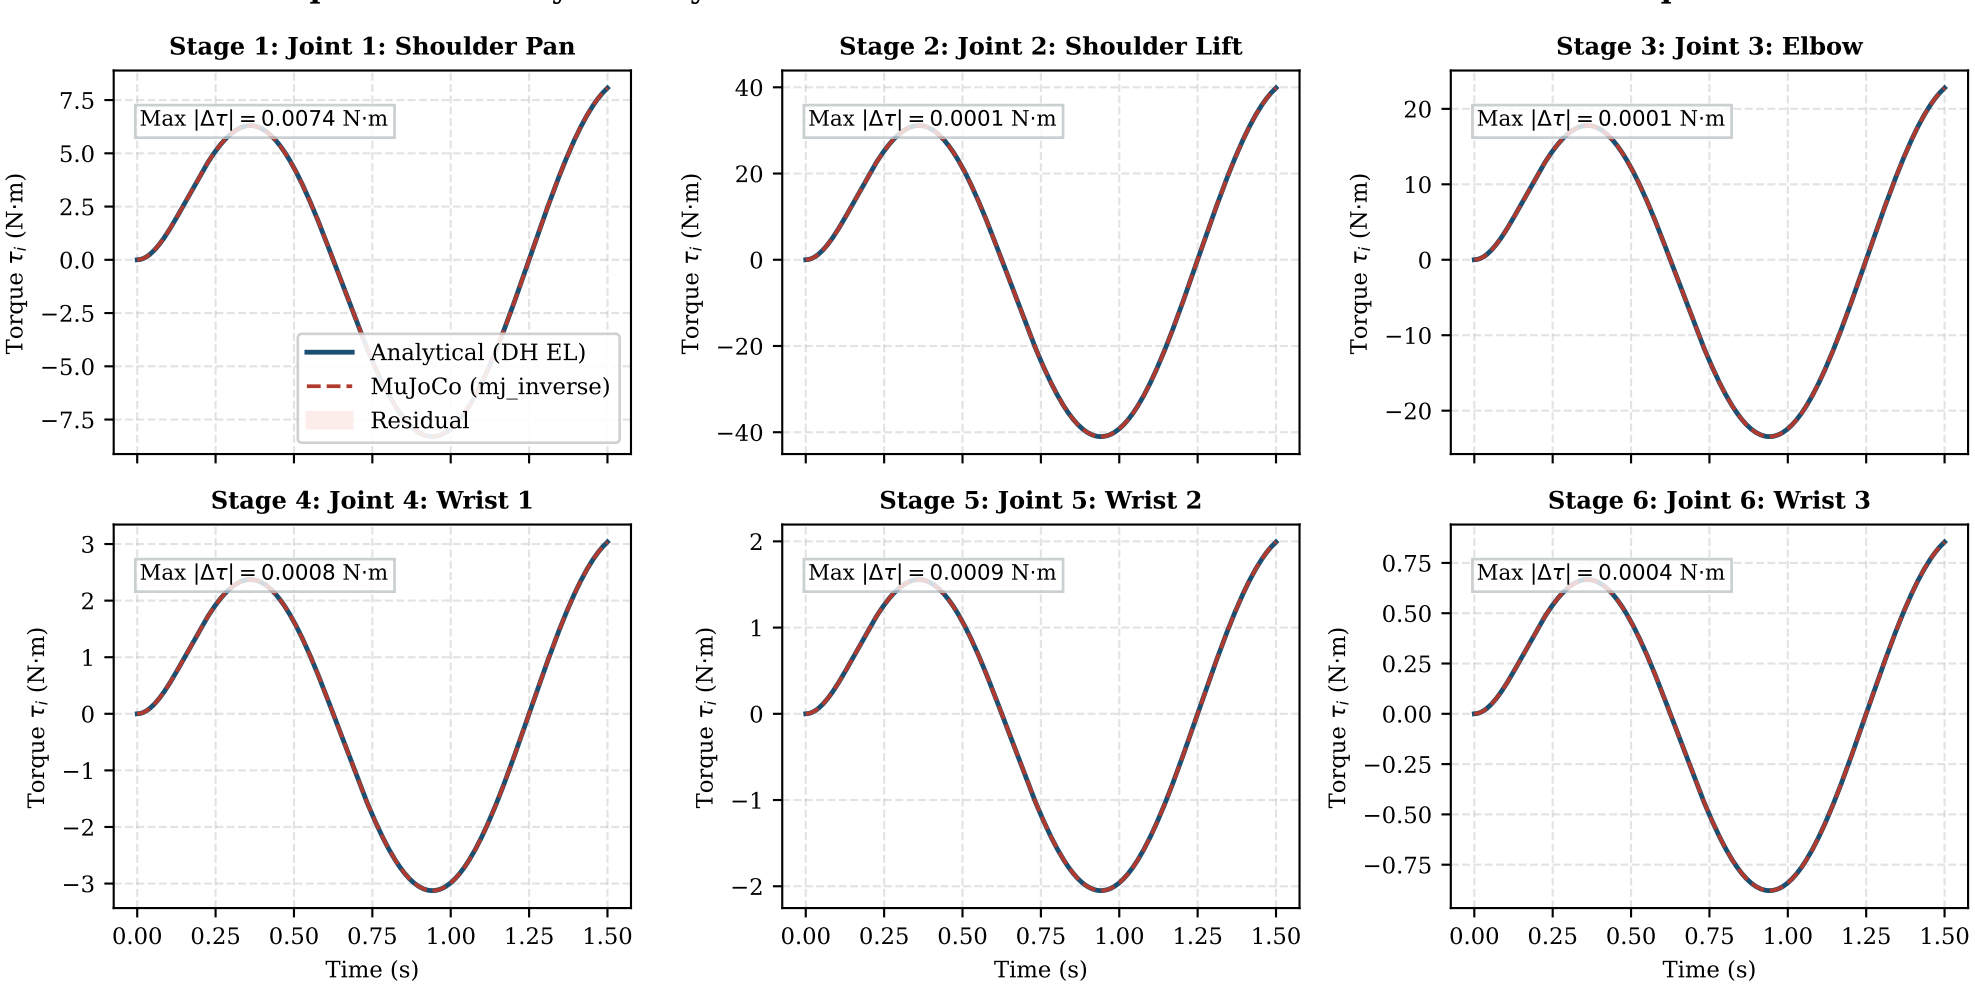

Sequential Link-by-Link Dynamic Isolation Protocol: Per-Link Isolated Actuation Torque
Stage 1: Joint 1: Shoulder Pan
Max |Δτ| = 0.0074 N·m
Analytical (DH EL)
MuJoCo (mj_inverse)
Residual
Stage 2: Joint 2: Shoulder Lift
Max |Δτ| = 0.0001 N·m
Stage 3: Joint 3: Elbow
Max |Δτ| = 0.0001 N·m
Stage 4: Joint 4: Wrist 1
Max |Δτ| = 0.0008 N·m
Stage 5: Joint 5: Wrist 2
Max |Δτ| = 0.0009 N·m
Stage 6: Joint 6: Wrist 3
Max |Δτ| = 0.0004 N·m
Torque τ_i (N·m)
Time (s)