



Measurement Report

Name: Record 1

Duration: 30s

Time: Feb 21, 2025 At 11:59 Am

Location: Montréal

Device: iPhone 15, iOS 17.5.1

Notes:


Measurement configurations

Frequency weighting	A
Response time	Fast (0.2s)
Calibration	+0.0 dB
Avg/Leq	88.5 dB
Min	34.8 dB
Max	102.7 dB
Peak	112.5 dB

Measurement results

Standard	NIOSH
Threshold	85 dB
Exchange rate	3 dB
TWA	60.3 dB
Dose	0.3 %
Projected dose	223.3 %

Graph

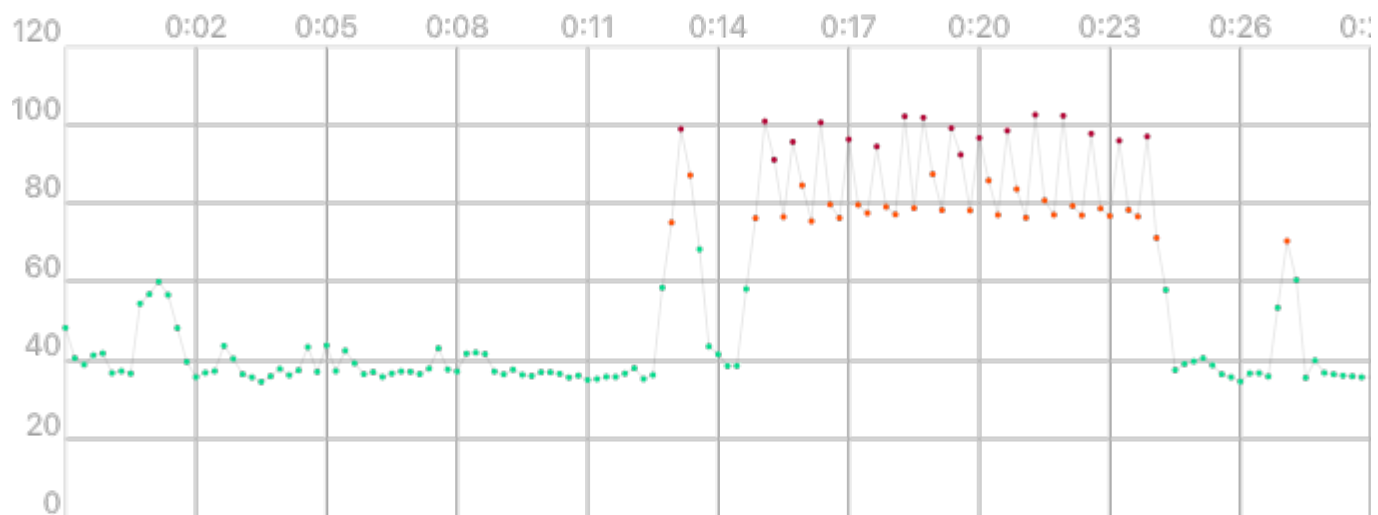

Created by Decibel X
www.skypaw.com