



Measurement Report

Name: Record 1

Duration: 30s

Time: Feb 21, 2025 At 11:19 Am

Location: Montréal

Device: iPhone 15, iOS 17.5.1

Notes:


Measurement configurations

Frequency weighting	A
Response time	Fast (0.2s)
Calibration	+0.0 dB
Avg/Leq	73.4 dB
Min	35.0 dB
Max	92.2 dB
Peak	102.0 dB

Measurement results

Standard	NIOSH
Threshold	85 dB
Exchange rate	3 dB
TWA	50.1 dB
Dose	0.0 %
Projected dose	5.0 %

Graph

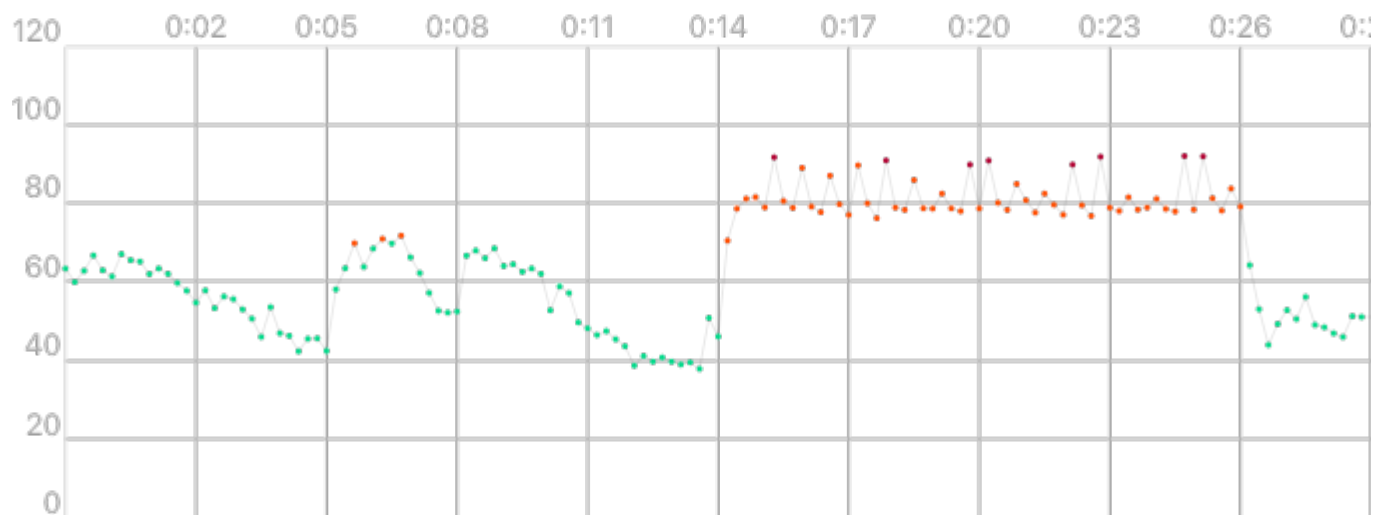

Created by Decibel X
www.skypaw.com