

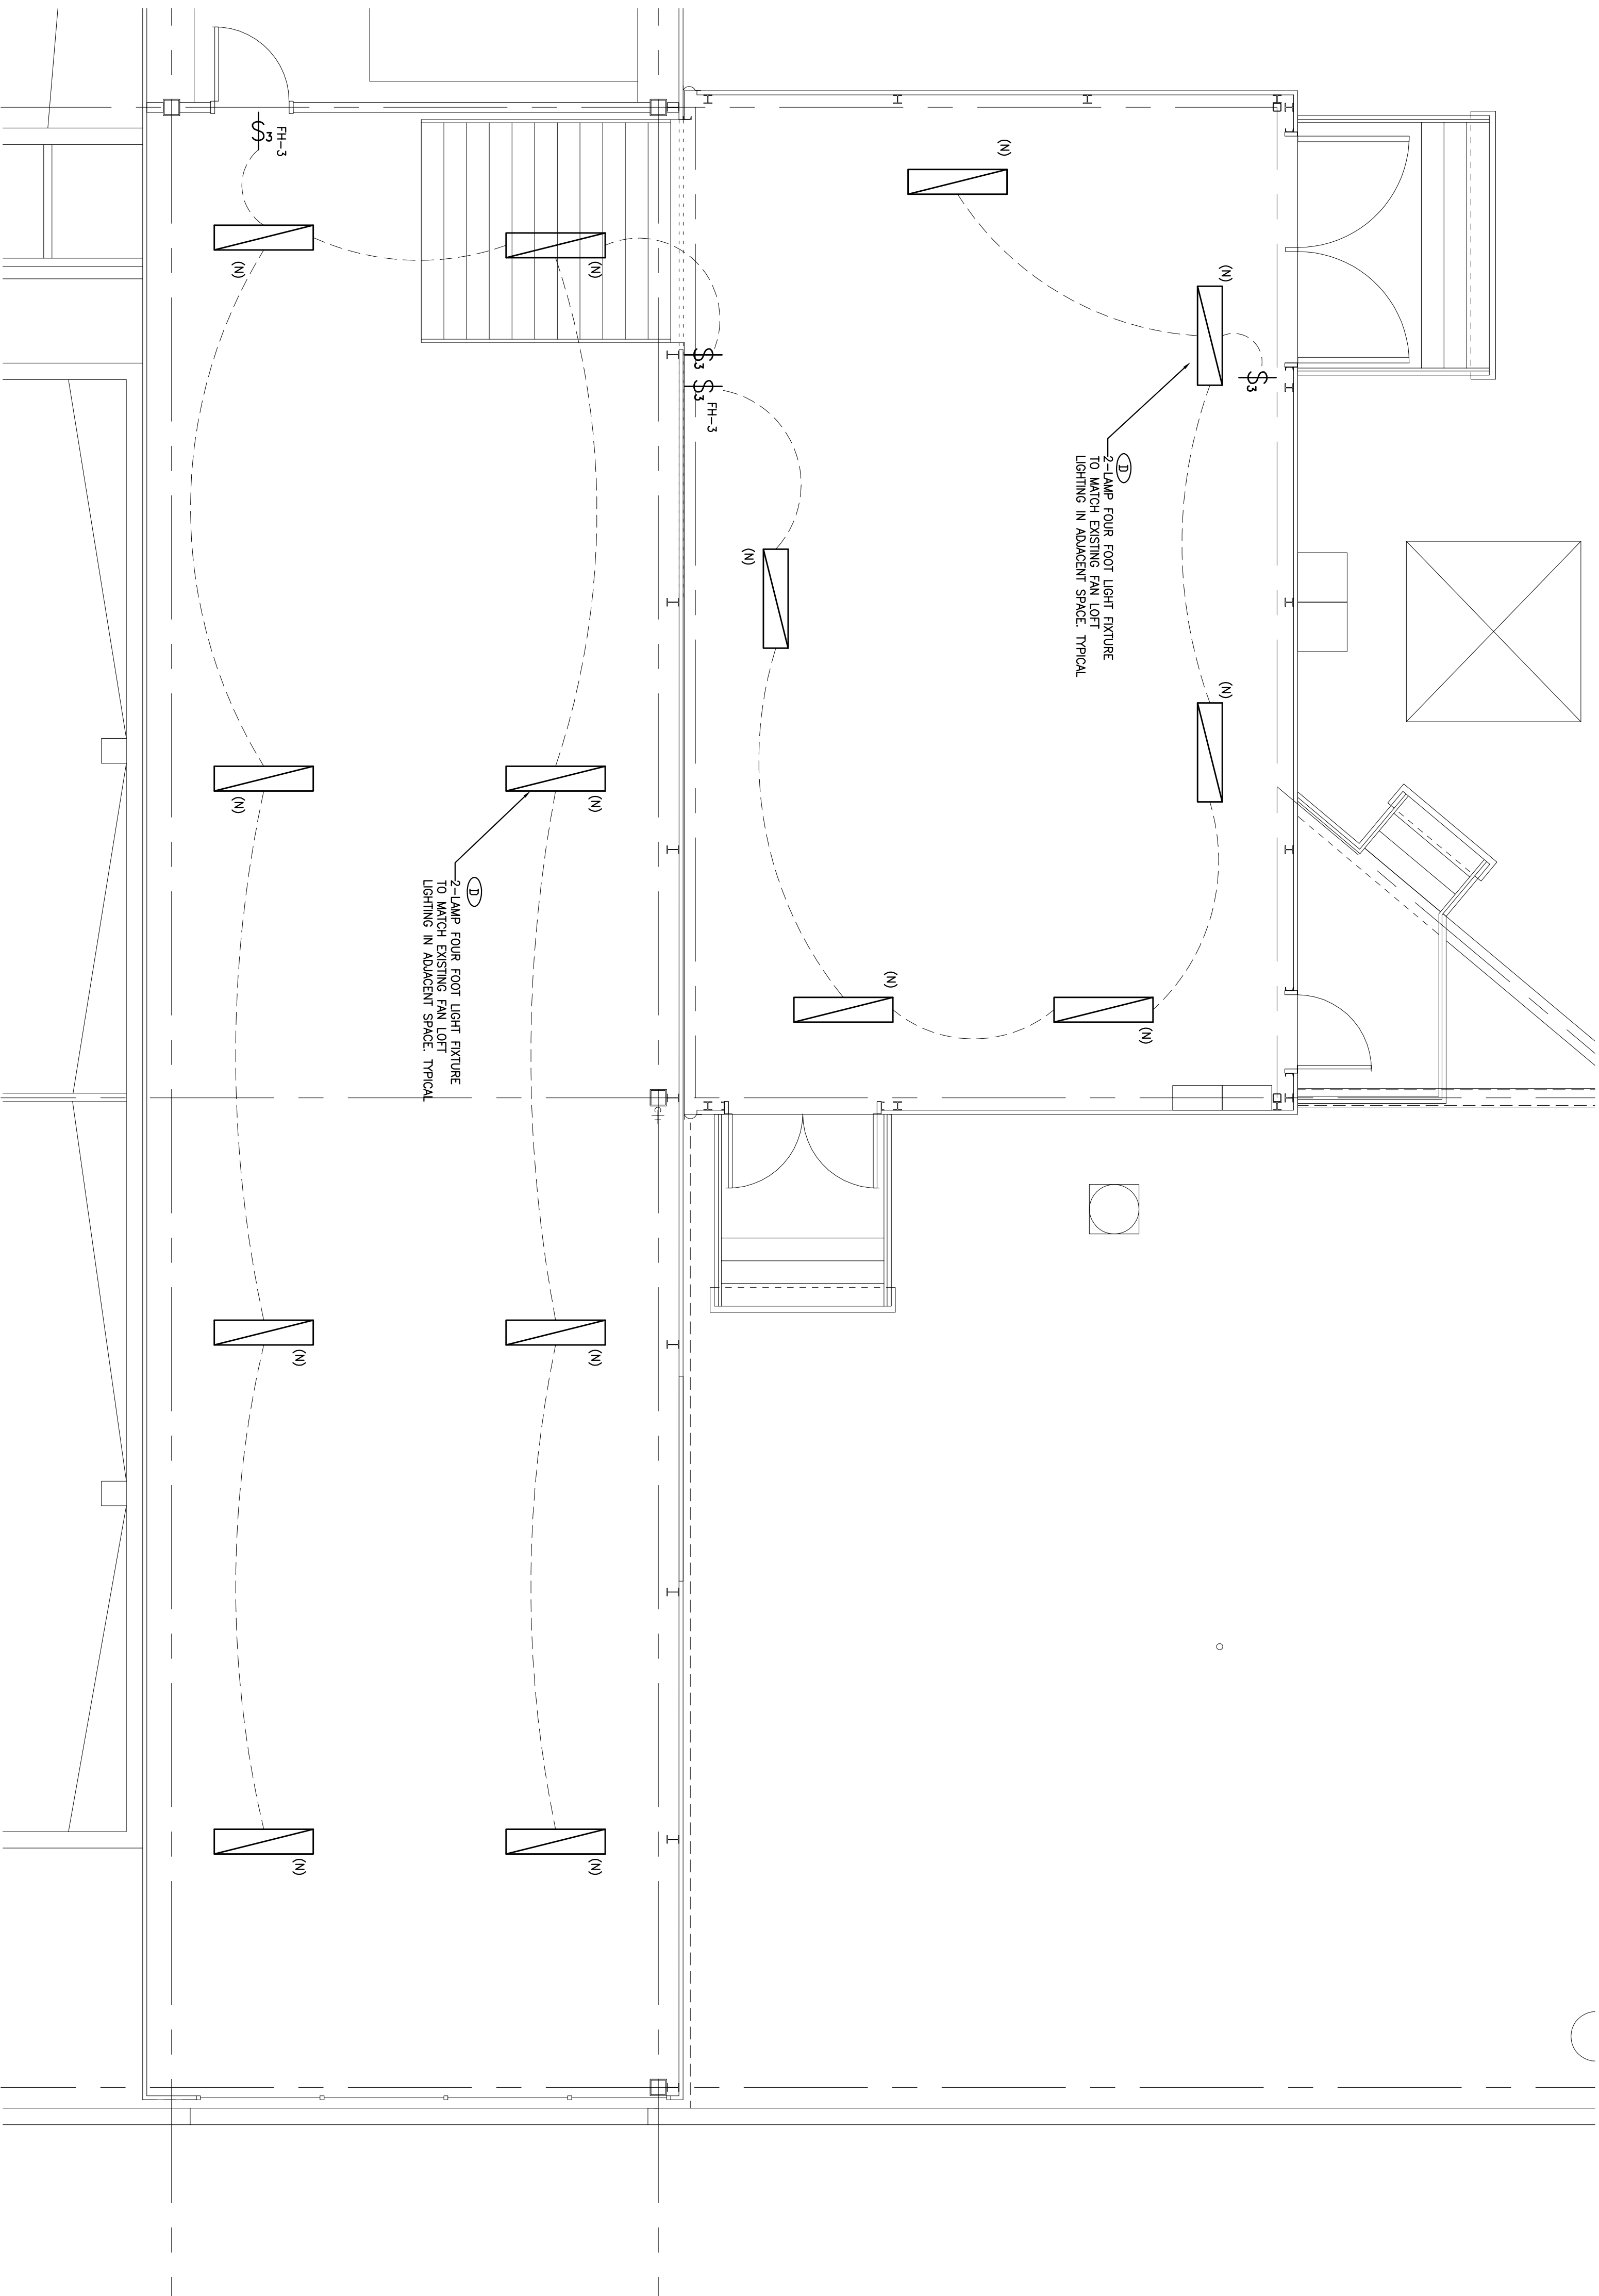


GENERAL NOTES:

1. MOUNT SURFACE LIGHT FIXTURE FROM THE NEW STRUCTURE. COORDINATE WITH MECHANICAL PIPING AND DUCT WORK TO ALLOW FOR THE BEST LAYOUT WHILE MISSING ADJACENT WORK.

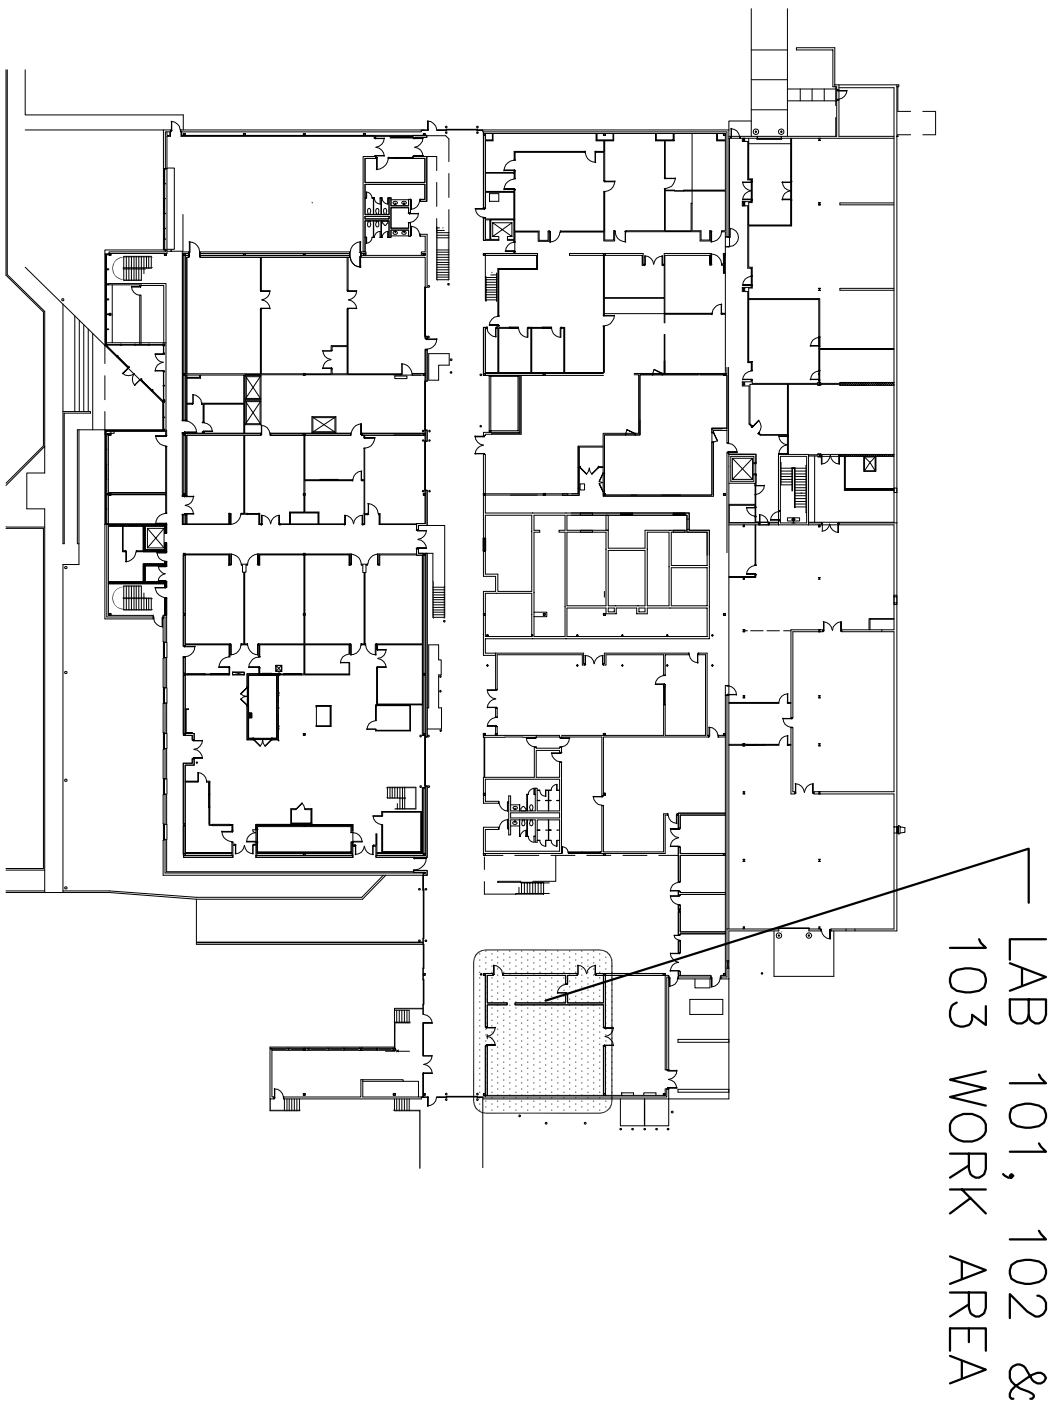

1 ELECTRICAL LIGHTING UPPER ROOM 101



2 KEY PLAN

SCALE: 1\"/>

| REVISIONS | | | | REVISIONS | | | | FILE INFORMATION | | | | ENGINEERING REVIEW | | | |
|-----------|-----------------------------|----------|----|-----------|-----|-----|----------------------------|------------------|----|--------|-----|--------------------|-------|-------|--------|
| NO. | | DATE | BY | APP'D. | BAE | NO. | | DATE | BY | APP'D. | BAE | USER: | DATE: | TIME: | MET'S: |
| 0 | 50% CONSTRUCTION DOCUMENTS | 08-12-11 | . | . | . | . | | . | . | . | . | DESIGNER | ?? | . | . |
| 1 | 90% CONSTRUCTION DOCUMENTS | 09-29-11 | . | . | . | . | DWG. FILE: | . | . | . | . | ENGINEER | . | . | . |
| 2 | 100% CONSTRUCTION DOCUMENTS | 11-3-11 | . | . | . | . | DWG. FOLDER: | . | . | . | . | CHECKED BY | . | . | . |
| 3 | FOR CONSTRUCTION | 01-20-12 | . | . | . | . | ADOX VERSION: AUTOCAD 2007 | . | . | . | . | A/E APPROVED BY | . | . | . |
| . | . | . | . | . | . | . | PLATFORM: | . | . | . | . | NREL APPROVED BY | . | . | . |
| . | . | . | . | . | . | . | BORDER: | Z8022340-3.DWG | . | . | . | PLOT SCALE: 1:1 | . | . | . |
| . | . | . | . | . | . | . | PLOT INFO: | NREL STB | . | . | . | UNITS: | ARCH | . | . |
| . | . | . | . | . | . | . | | | . | . | . | BLDG. AREA ENG. | . | . | . |



National Renewable Energy Laboratory
1977 Oak Boulevard
Golden, Colorado 80401-3335
U.S. Department of Energy
by Midwest Research Institute • Boulder • Colorado

FTLB
THERMO-CHEM LABORATORY 101 CONVERSION
LAB 101 PENTHOUSE LEVEL LIGHTING

| | | |
|---------------------|---------------------|-----------------|
| ISSUING NO. PER SET | DRAWING NO. | REVISION NO. |
| FTLB-135- | E-06 | 0 |
| NREL PROJECT NO. | NREL WORK ORDER NO. | A/E PROJECT NO. |
| EX2010034 | 13 | |