

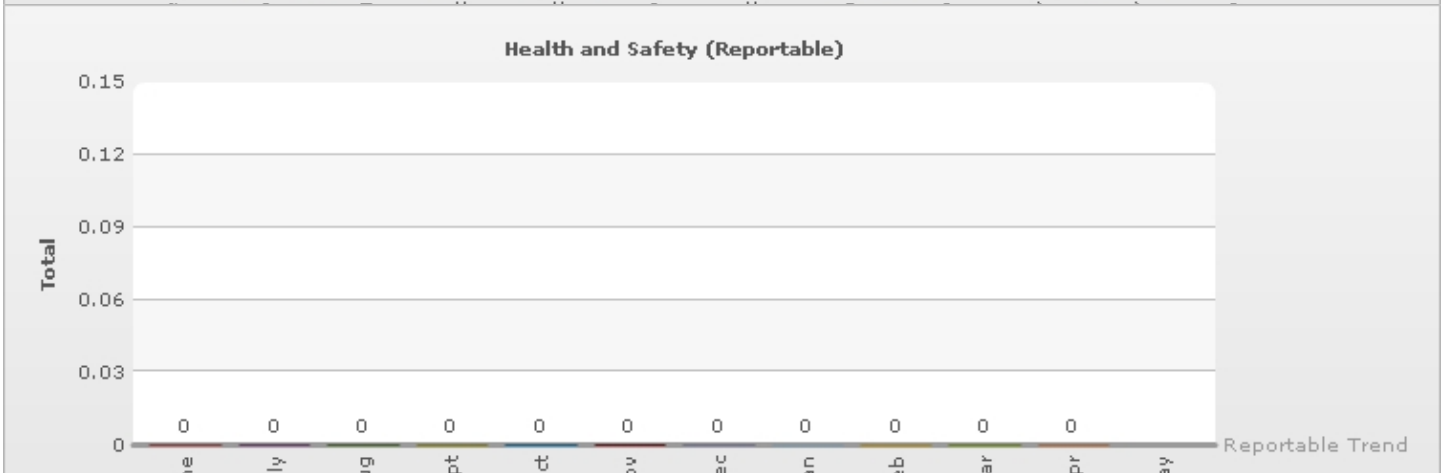
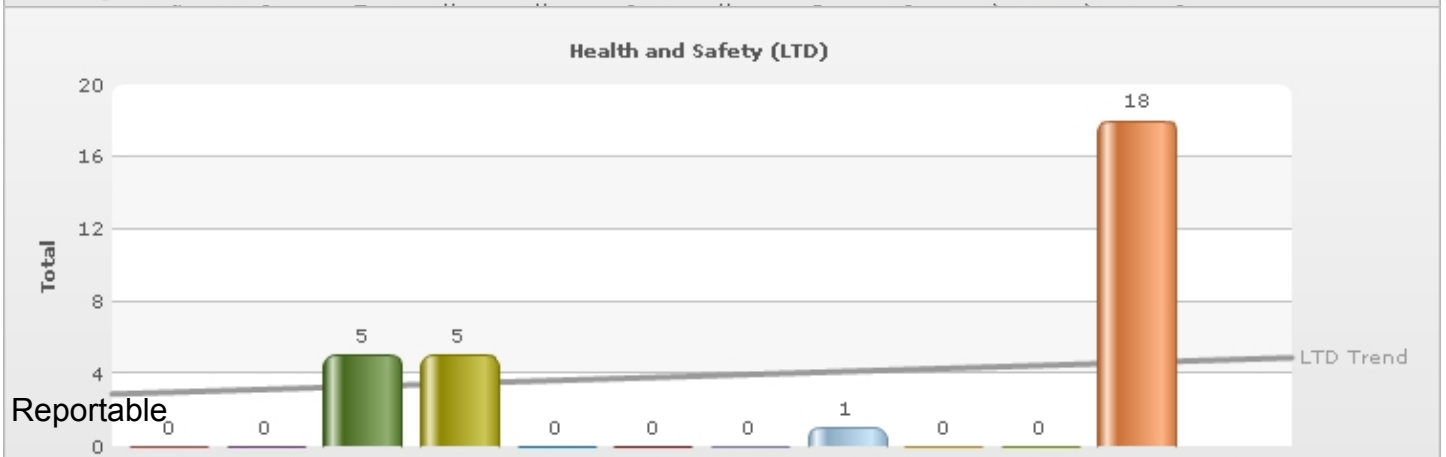


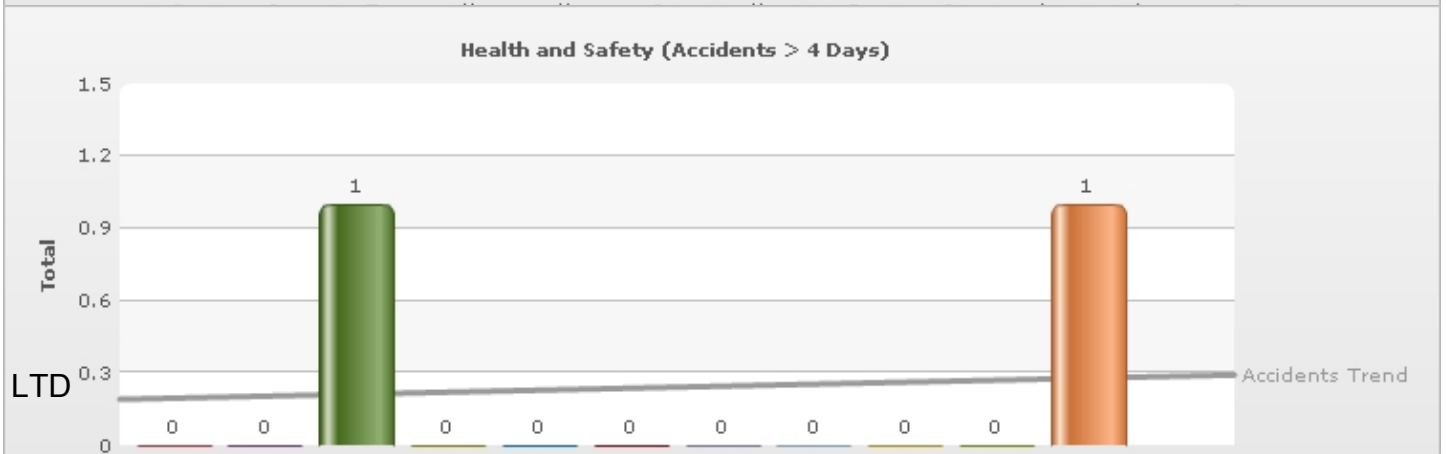


# Health and Safety Windsor Report

Generated By: John McGann  
Generated On: 13/05/2010 - April

LTA

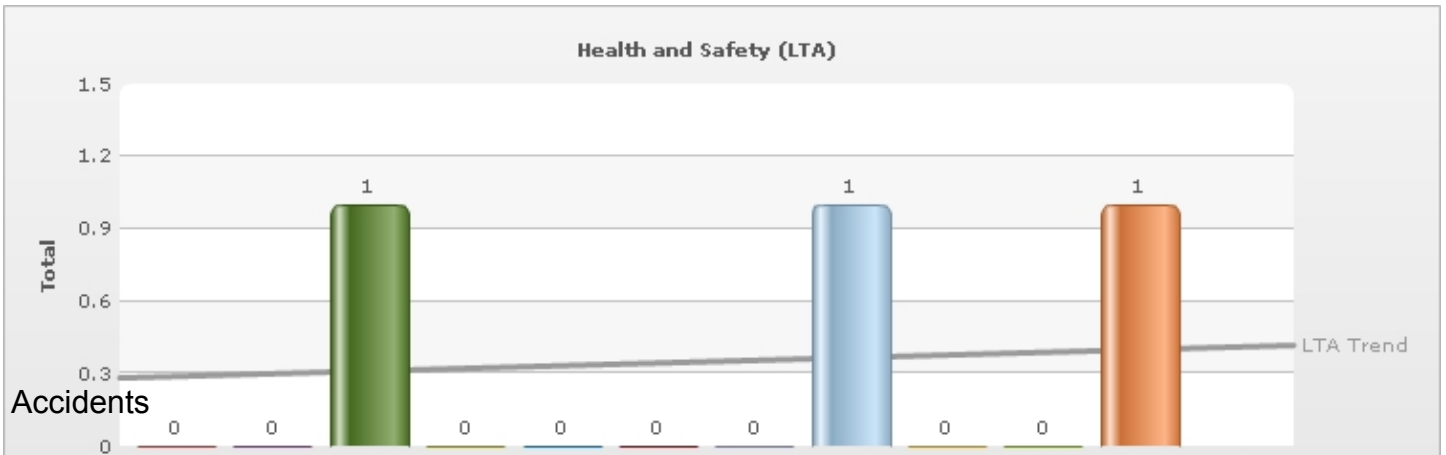

Safety Opportunities

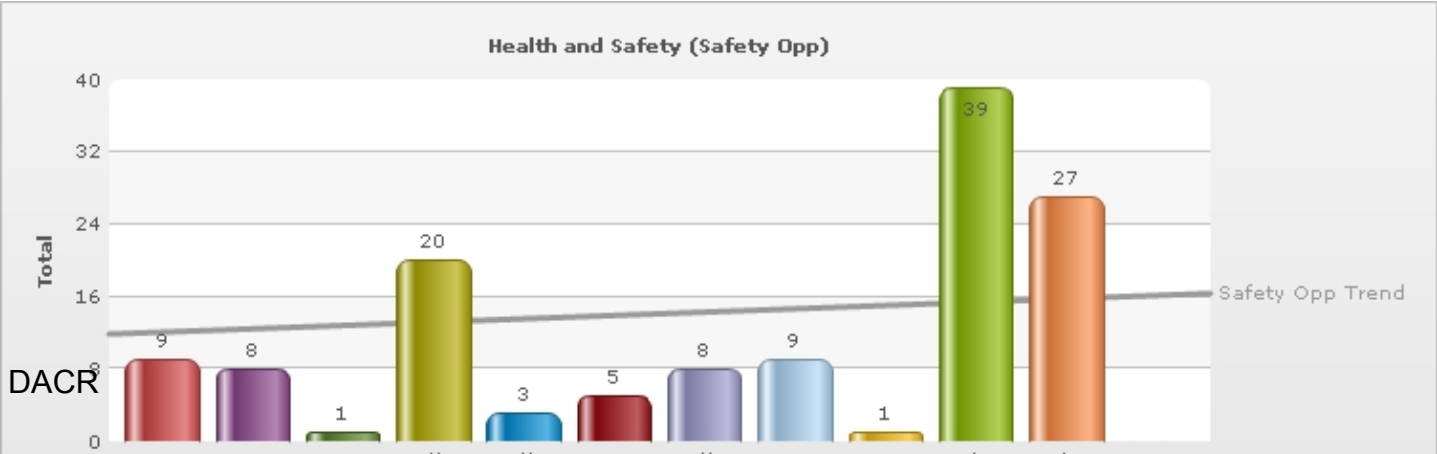

The Windsor site experienced a serious lost time injury on April 12th, 2010, in which an employee leaned on a handicapped assist railing in a bathroom, and the railing wall fasteners pulled out, causing the employee to lose balance and fall to the floor, fracturing his shoulder.

As a corrective measure, the fastener systems for all handicap assist railings in the Windsor facility were removed, examined for any weakness or deficiencies, and then replaced and the railings were then load tested.