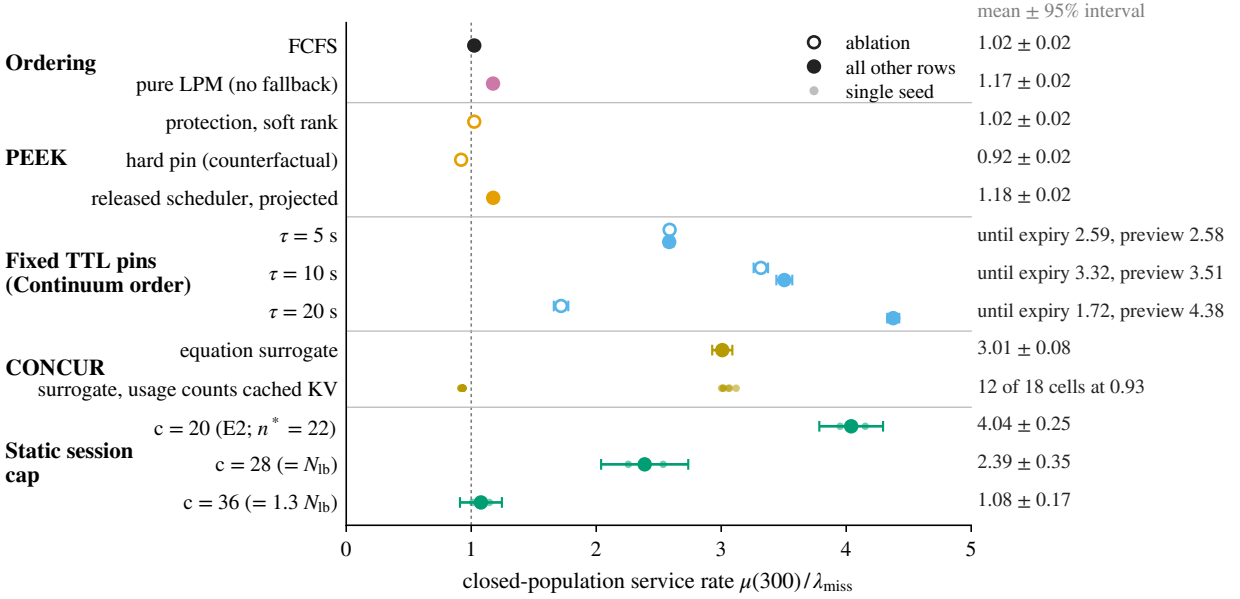
mean ± 95% interval
ablation
all other rows
single seed
Ordering
FCFS
1.02 ± 0.02
pure LPM (no fallback)
1.17 ± 0.02
PEEK
protection, soft rank
1.02 ± 0.02
hard pin (counterfactual)
0.92 ± 0.02
released scheduler, projected
1.18 ± 0.02
Fixed TTL pins (Continuum order)
τ = 5 s
until expiry 2.59, preview 2.58
τ = 10 s
until expiry 3.32, preview 3.51
τ = 20 s
until expiry 1.72, preview 4.38
CONCUR
equation surrogate
3.01 ± 0.08
surrogate, usage counts cached KV
12 of 18 cells at 0.93
Static session cap
c = 20 (E2; n* = 22)
4.04 ± 0.25
c = 28 (= N_lb)
2.39 ± 0.35
c = 36 (= 1.3 N_lb)
1.08 ± 0.17
0
1
2
3
4
5
closed-population service rate μ(300)/λ_miss