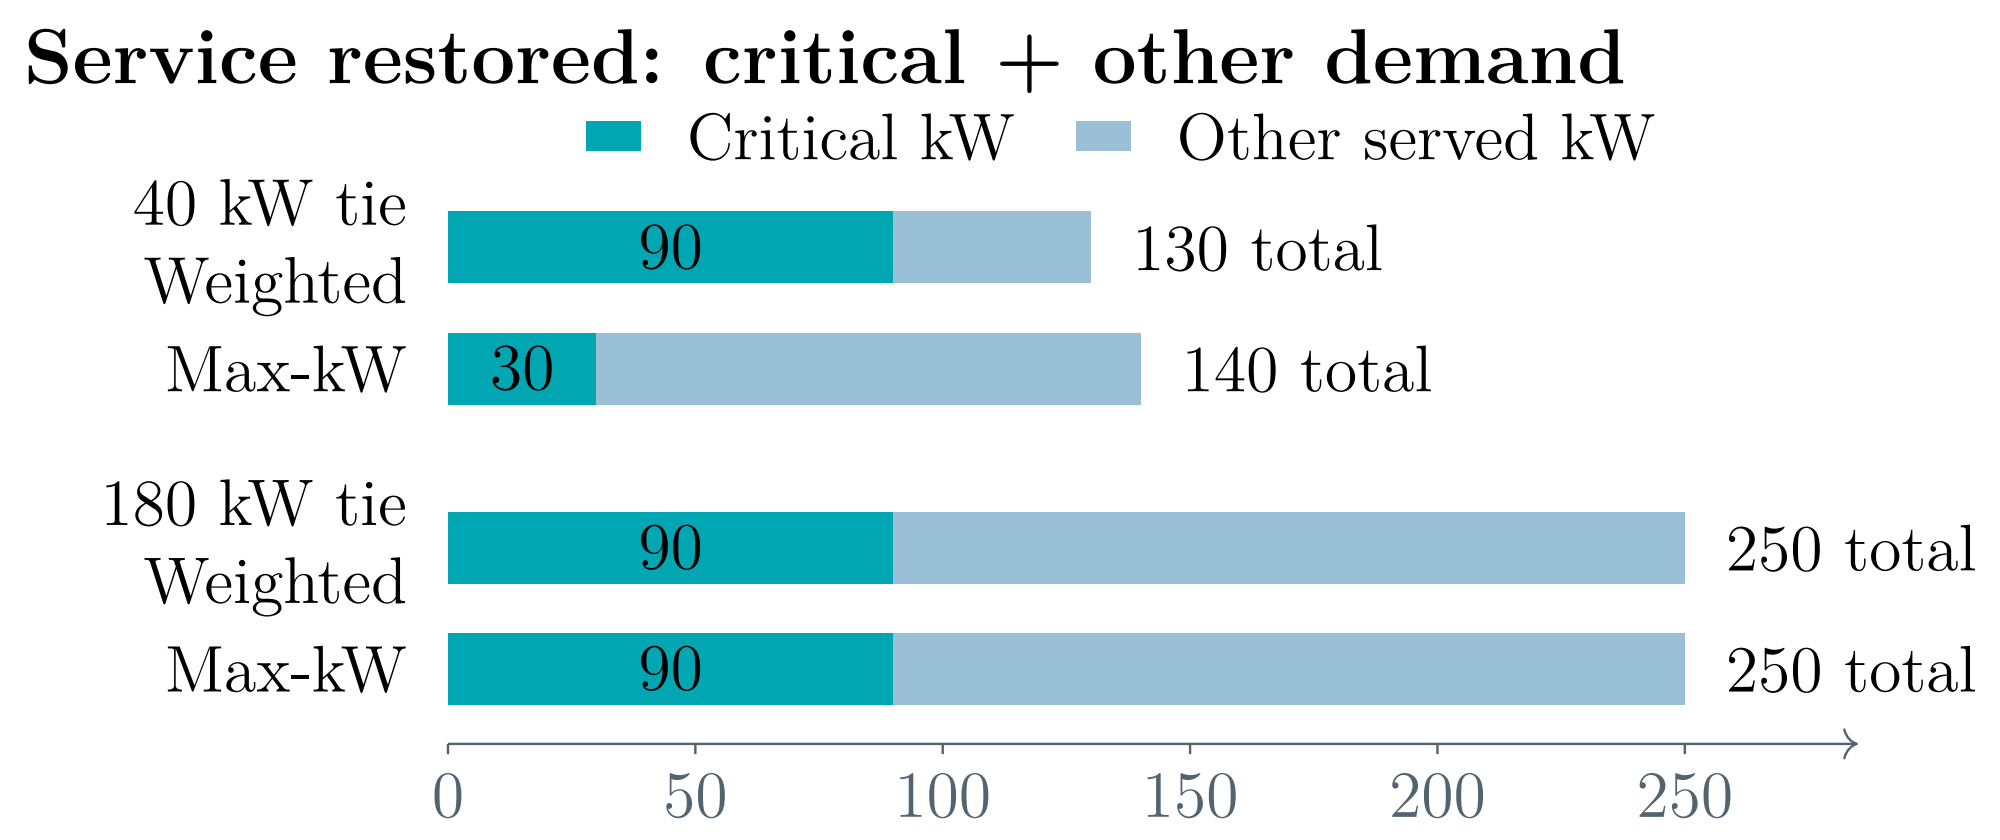
Service restored: critical + other demand
Critical kW
Other served kW
40 kW tie
Weighted
90
130 total
Max-kW
30
140 total
180 kW tie
Weighted
90
250 total
Max-kW
90
250 total
0
50
100
150
200
250