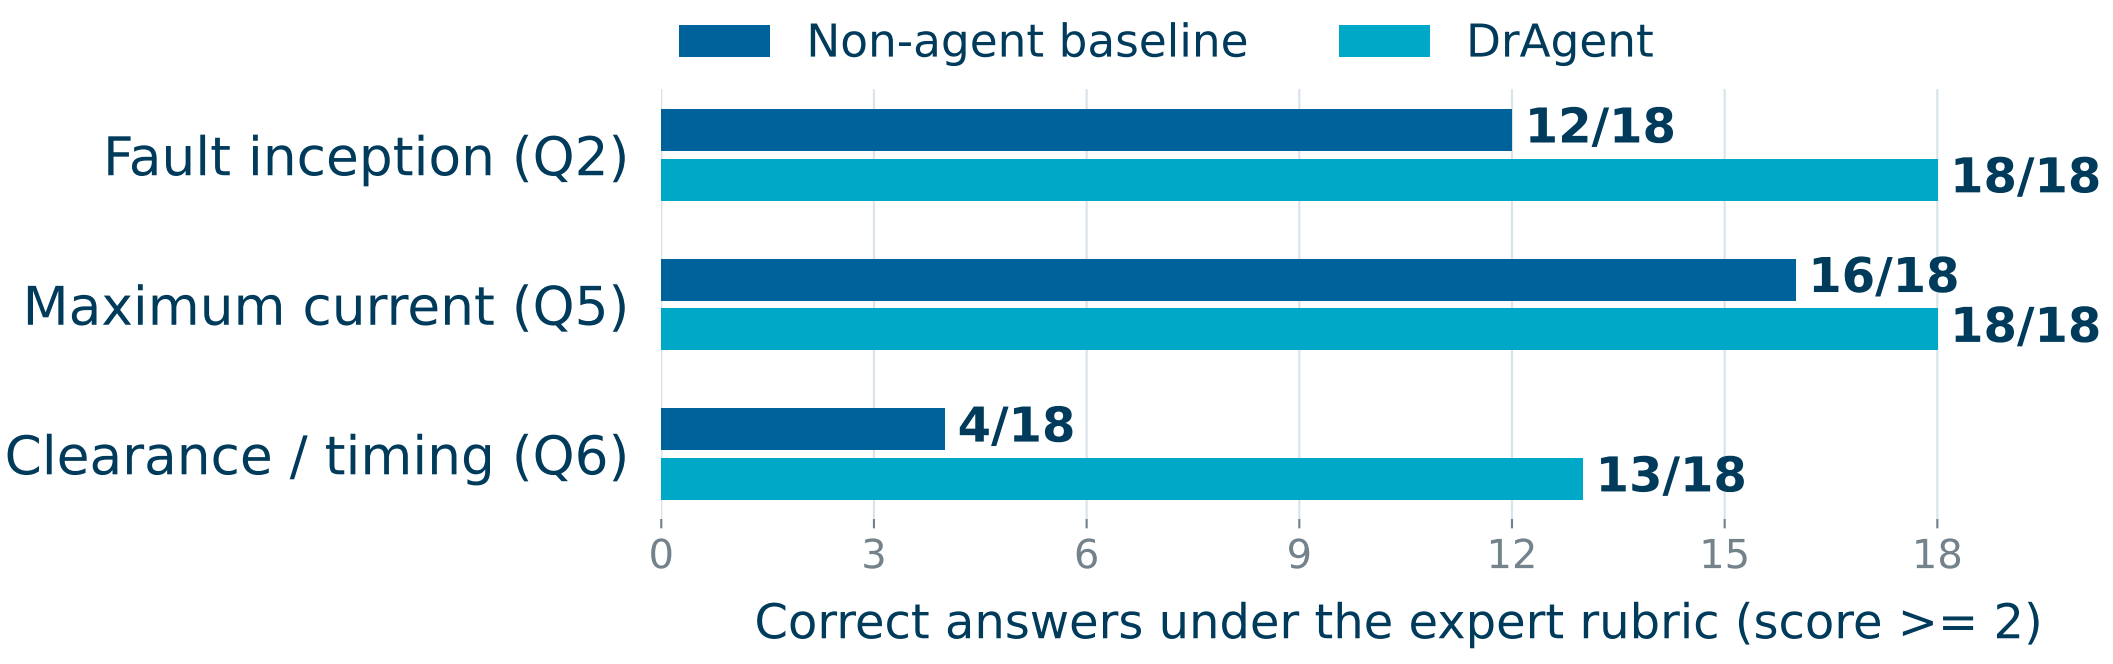
Non-agent baseline
DrAgent
Fault inception (Q2)
12/18
18/18
Maximum current (Q5)
16/18
18/18
Clearance / timing (Q6)
4/18
13/18
0
3
6
9
12
15
18
Correct answers under the expert rubric (score >= 2)