


➤ Visual Inspection

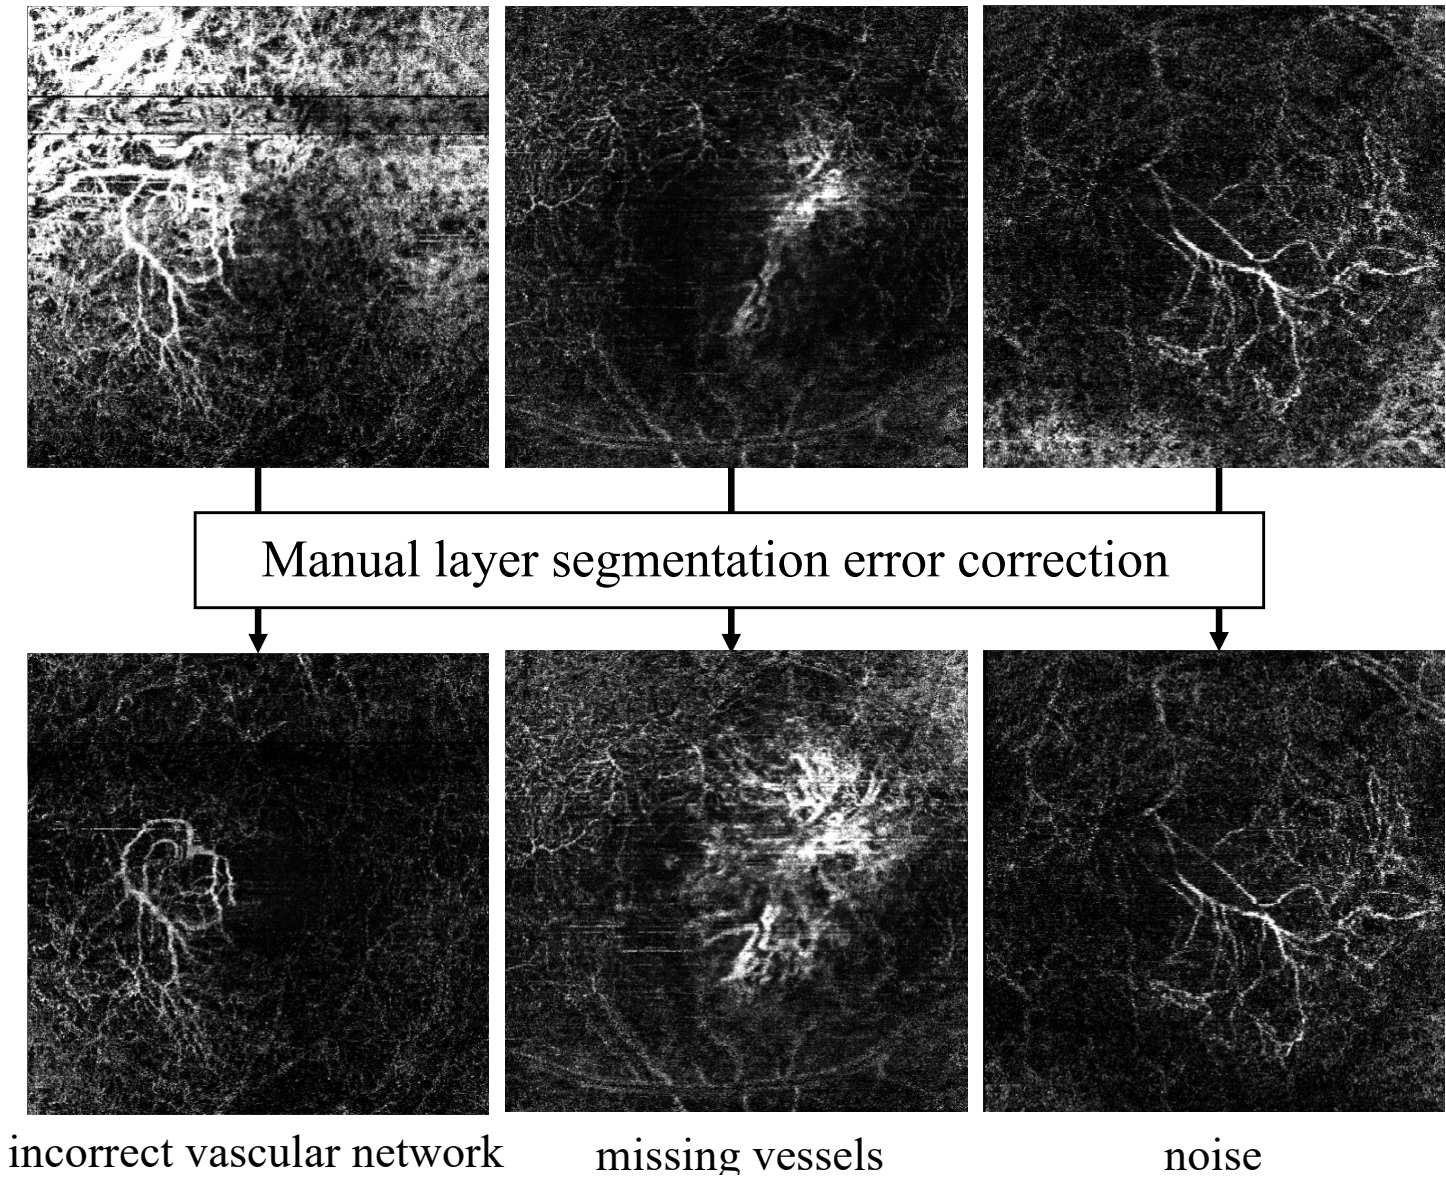

➤ Error Population

sample type	Active	Remission	Dry	Normal	Total
# w/ seg. error	138	91	57	2	288
# w/o seg. error	52	39	90	61	242
error percentage	72.6%	70%	38.8%	3.2%	54.3%

➤ Classification Accuracy

Train on	Test on	Accuracy
Clean set	Clean set	69.64%
Clean set	Mixed set	53.57%
Mixed set	Clean set	64.29%
Mixed set	Mixed set	57.14%

- R1,2: Hard to generalize from clean to mixed
- R1,2,4: Possible to learn the joint distribution
- R3,4 Samples with errors are hard to learn.